

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911834

Luminaire Tested: DFN2DIP-SQ3F0-050D040US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911834
REPORT IS A COMBINATION OF REPORTS P899864 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D040US850-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8639.1 lumens
Efficiency: N/A
Efficacy: 119.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 72.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911834

CATALOG NUMBER: DFN2DIP-SQ3F0-050D040US850-RLLFLL

Luminous Intensity Polar Plot

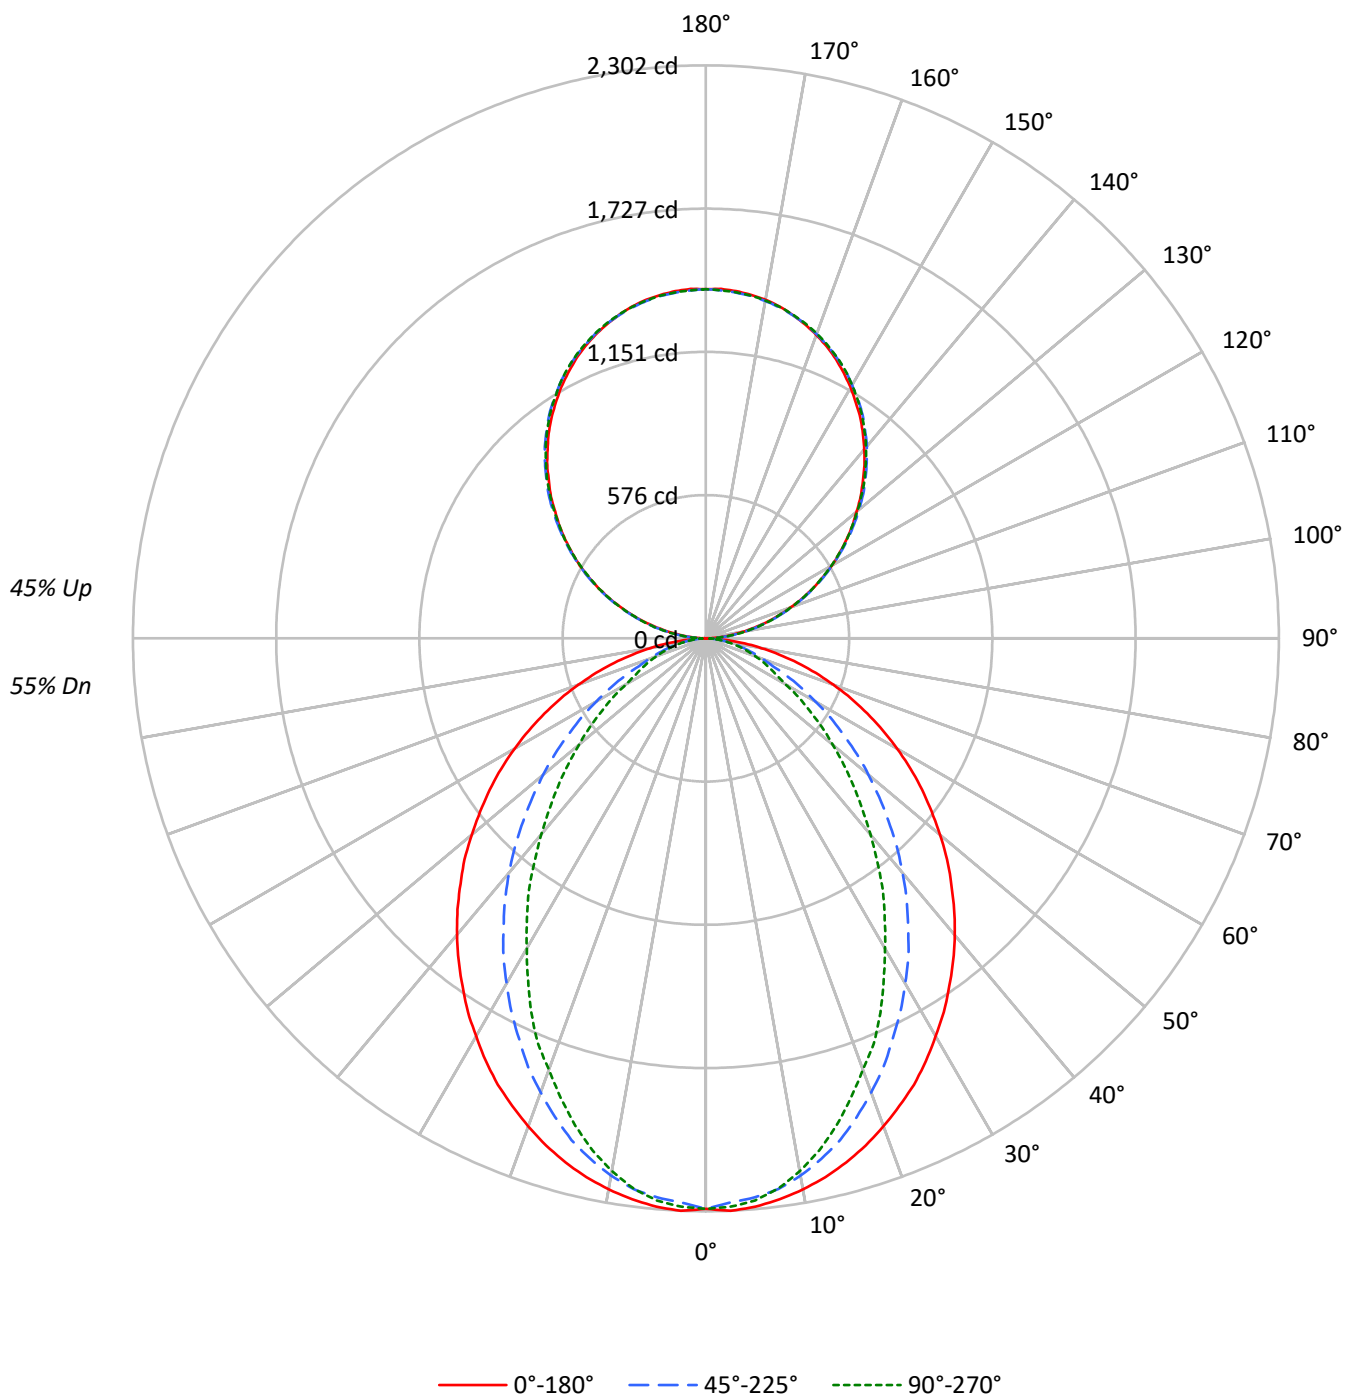

TEST NUMBER: P911834

CATALOG NUMBER: DFN2DIP-SQ3F0-050D040US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2626	2626	2626
5°	2628	2583	2600
10°	2601	2530	2514
15°	2563	2445	2383
20°	2514	2328	2222
25°	2464	2197	2066
30°	2397	2063	1869
35°	2331	1919	1696
40°	2265	1771	1498
45°	2187	1606	1318
50°	2107	1440	1142
55°	2023	1263	974
60°	1925	1078	801
65°	1813	890	720
70°	1677	715	650
75°	1506	627	590
80°	1258	520	508
85°	854	339	377

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2187 cd/sqm

TEST NUMBER: P911834

CATALOG NUMBER: DFN2DIP-SQ3F0-050D040US850-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	2.5
10°-20°	589.6	6.8
20°-30°	827.8	9.6
30°-40°	902.4	10.4
40°-50°	829.4	9.6
50°-60°	651.3	7.5
60°-70°	424.0	4.9
70°-80°	218.2	2.5
80°-90°	59.7	0.7
90°-100°	86.8	1.0
100°-110°	275.8	3.2
110°-120°	472.0	5.5
120°-130°	620.8	7.2
130°-140°	696.8	8.1
140°-150°	683.3	7.9
150°-160°	573.2	6.6
160°-170°	380.1	4.4
170°-180°	132.9	1.5
0°-30°	1632.2	18.9
0°-40°	2534.6	29.3
0°-60°	4015.3	46.5
0°-90°	4717.3	54.6
90°-120°	834.7	9.7
90°-150°	2835.6	32.8
90°-180°	3922.0	45.4
0°-180°	8639.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2281	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	1	15	42	39	40	8
95°	62	74	76	76	74	69
105°	255	258	260	263	263	269
115°	474	480	478	477	474	469
125°	689	700	696	692	691	616
135°	891	904	907	906	902	689
145°	1082	1090	1097	1098	1094	676
155°	1237	1240	1244	1250	1246	569
165°	1346	1345	1345	1353	1347	380
175°	1400	1397	1394	1403	1396	133
180°	1403	1403	1403	1403	1403	

TEST NUMBER: P911834

CATALOG NUMBER: DFN2DIP-SQ3F0-050D040US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.7	2291.7	2291.7	2291.7	2291.7
2.5°	2302.1	2291.7	2268.9	2289.8	2285.5
5°	2291.7	2281.4	2254.4	2273.0	2266.9
7.5°	2273.0	2260.7	2231.6	2239.8	2229.4
10°	2248.2	2233.6	2192.3	2185.9	2173.5
12.5°	2217.1	2198.5	2142.4	2130.1	2107.1
15°	2179.7	2156.9	2086.5	2047.1	2026.4
17.5°	2136.2	2103.0	2015.8	1970.2	1937.0
20°	2086.5	2044.9	1941.2	1889.5	1843.7
22.5°	2032.6	1984.8	1864.5	1794.0	1763.0
25°	1978.6	1912.1	1775.3	1690.3	1659.1
27.5°	1914.4	1843.7	1692.3	1594.9	1547.2
30°	1845.9	1767.0	1601.1	1495.4	1439.3
32.5°	1779.5	1684.0	1514.1	1389.6	1337.7
35°	1704.9	1599.1	1416.6	1285.9	1240.2
37.5°	1632.2	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.8	1082.6	1028.7
42.5°	1476.7	1344.0	1134.5	980.9	929.2
45°	1393.8	1254.7	1037.0	889.6	839.8
47.5°	1314.9	1167.8	943.8	796.4	750.8
50°	1227.9	1080.6	852.5	709.2	665.8
52.5°	1142.7	987.1	765.3	628.5	589.1
55°	1059.8	898.0	673.9	549.6	510.3
57.5°	974.8	808.9	593.2	477.1	443.8
60°	887.6	721.7	508.0	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.5	547.5	360.9	290.4	284.1
67.5°	632.6	464.6	290.4	255.1	248.9
70°	545.5	383.7	240.5	219.8	211.5
72.5°	462.6	309.0	201.2	184.6	180.4
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.8	122.3	118.1
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.2	45.6	39.4	39.4	39.4
87.5°	33.3	16.5	16.5	14.5	14.5
90°	1.2	15.2	41.5	38.9	40.1
92.5°	26.2	35.5	36.8	38.0	38.0
95°	61.8	73.6	75.7	75.7	73.6
97.5°	102.8	113.8	118.4	118.4	118.4
100°	150.2	159.9	163.2	163.2	162.0
102.5°	200.1	207.3	211.9	213.1	211.9
105°	254.6	258.0	260.5	262.6	262.6
107.5°	308.7	313.8	313.8	314.6	308.7
110°	361.2	368.0	368.0	368.0	364.6



TEST NUMBER: P911834

CATALOG NUMBER: DFN2DIP-SQ3F0-050D040US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	417.9	425.1	423.7	420.4	417.9
115°	473.7	480.5	478.3	477.1	473.7
117.5°	529.1	538.4	532.5	529.1	525.8
120°	585.0	594.2	585.0	585.0	581.1
122.5°	635.7	647.5	641.7	638.2	635.7
125°	689.0	699.6	696.2	692.3	691.1
127.5°	741.0	754.1	749.5	744.4	741.0
130°	789.6	804.9	802.8	800.3	795.6
132.5°	844.2	856.0	856.9	850.9	847.6
135°	891.2	904.3	906.8	905.5	902.2
137.5°	943.6	954.2	956.3	955.4	950.4
140°	989.7	1000.3	1006.2	1006.2	1001.5
142.5°	1037.1	1047.7	1051.0	1052.3	1047.7
145°	1081.9	1090.4	1097.1	1098.5	1093.8
147.5°	1122.1	1132.6	1137.7	1139.8	1135.2
150°	1163.6	1170.8	1175.4	1179.2	1175.4
152.5°	1200.4	1207.5	1213.5	1218.1	1213.5
155°	1237.1	1240.5	1244.3	1250.3	1246.4
157.5°	1268.9	1271.4	1273.5	1282.0	1276.0
160°	1297.2	1299.7	1301.0	1308.2	1303.1
162.5°	1323.4	1323.4	1324.7	1332.7	1326.8
165°	1345.9	1344.6	1344.6	1353.0	1347.1
167.5°	1366.2	1362.3	1362.3	1370.8	1364.8
170°	1381.4	1377.9	1376.7	1385.1	1377.9
172.5°	1391.9	1388.6	1387.2	1395.8	1388.6
175°	1400.4	1397.0	1394.5	1402.9	1395.8
177.5°	1405.1	1401.7	1399.1	1406.3	1399.1
180°	1402.9	1402.9	1402.9	1402.9	1402.9

TEST NUMBER: P911834

CATALOG NUMBER: DFN2DIP-SQ3F0-050D040US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.89	11.76	11.81	12.69	13.90	6.85	7.72	7.77	8.65	9.86
	3H	12.56	13.34	13.50	14.29	15.52	8.03	8.81	8.97	9.76	10.99
	4H	13.17	13.90	14.12	14.85	16.09	8.48	9.21	9.43	10.16	11.41
	6H	13.59	14.27	14.55	15.22	16.47	8.80	9.47	9.76	10.43	11.68
	8H	13.71	14.36	14.68	15.33	16.58	8.89	9.53	9.85	10.50	11.75
	12H	13.78	14.39	14.75	15.35	16.63	8.93	9.54	9.90	10.51	11.78
4H	2H	10.91	11.64	11.86	12.59	13.83	7.44	8.18	8.40	9.13	10.37
	3H	12.73	13.34	13.70	14.33	15.58	8.79	9.40	9.76	10.38	11.64
	4H	13.42	13.98	14.40	14.96	16.23	9.34	9.89	10.31	10.87	12.15
	6H	13.94	14.42	14.92	15.41	16.69	9.75	10.23	10.74	11.23	12.50
	8H	14.11	14.56	15.10	15.55	16.84	9.87	10.32	10.86	11.31	12.60
	12H	14.20	14.61	15.21	15.62	16.91	9.94	10.34	10.94	11.35	12.65
8H	4H	13.39	13.84	14.38	14.83	16.12	9.62	10.06	10.60	11.05	12.35
	6H	13.96	14.32	14.97	15.36	16.65	10.13	10.50	11.14	11.53	12.82
	8H	14.17	14.49	15.19	15.52	16.82	10.31	10.64	11.33	11.66	12.97
	12H	14.31	14.59	15.33	15.61	16.96	10.43	10.71	11.45	11.73	13.08
12H	4H	13.35	13.75	14.35	14.76	16.05	9.62	10.02	10.63	11.03	12.33
	6H	13.93	14.26	14.95	15.28	16.59	10.17	10.50	11.20	11.52	12.83
	8H	14.15	14.44	15.17	15.45	16.80	10.38	10.67	11.40	11.68	13.04

END OF REPORT