

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911864

Luminaire Tested: DFN2DIP-SQ3F0-050D120US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911864
REPORT IS A COMBINATION OF REPORTS P900007 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D120US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17267.1 lumens
Efficiency: N/A
Efficacy: 126.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 136.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911864

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US850-FLLFLL

Luminous Intensity Polar Plot

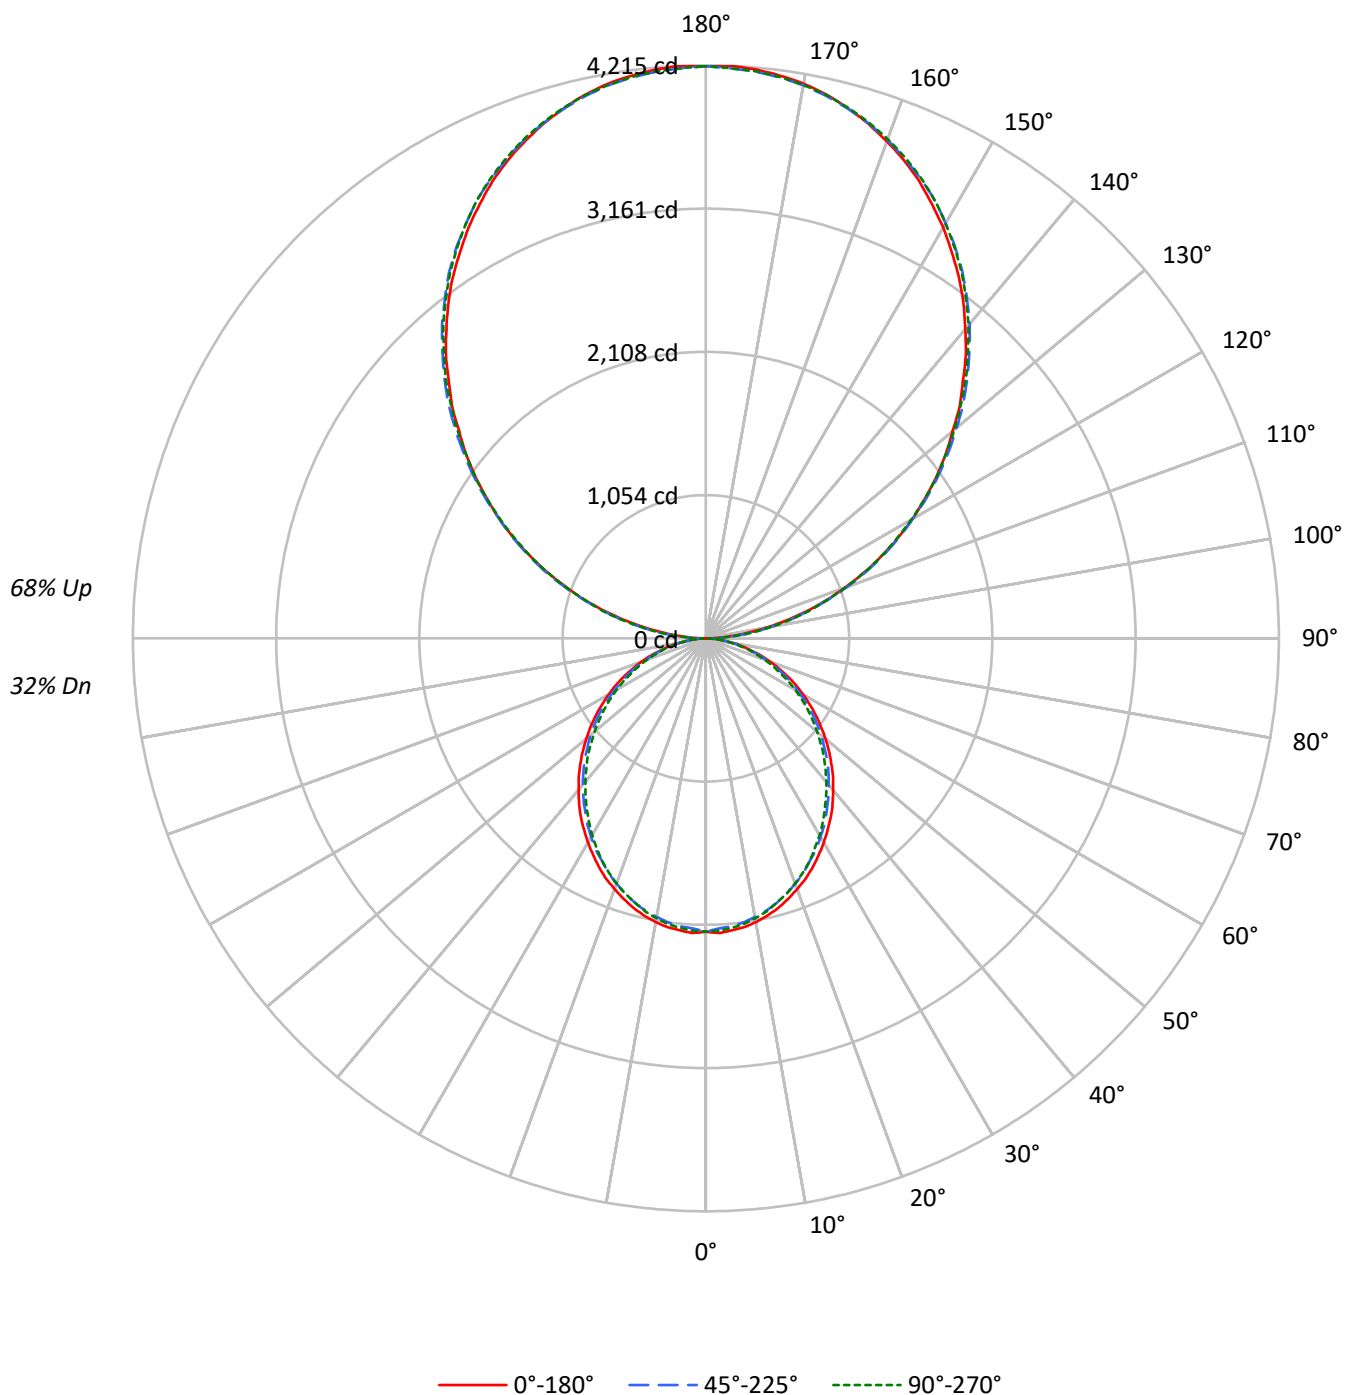

TEST NUMBER: P911864

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	39	39	39
1	94	89	86	82	84	81	77	75	64	62	60	49	47	46	35	34	33
2	85	78	72	67	76	70	65	61	56	53	50	43	41	39	31	29	28
3	78	69	62	56	70	62	56	51	49	45	42	38	35	33	27	25	24
4	71	61	53	47	64	55	48	43	44	39	35	34	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	27	24	22	20	18
6	60	48	40	35	54	44	37	32	35	30	26	27	24	21	20	17	16
7	55	43	36	30	50	39	33	28	32	27	23	25	21	19	18	16	14
8	51	39	32	27	46	36	29	25	29	24	20	23	19	16	17	14	12
9	48	36	29	24	43	33	26	22	26	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	20	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2472	2472	2472
5°	2475	2436	2453
10°	2453	2402	2419
15°	2415	2360	2367
20°	2365	2304	2313
25°	2315	2237	2250
30°	2252	2174	2172
35°	2193	2100	2088
40°	2121	2025	2009
45°	2048	1951	1927
50°	1969	1872	1833
55°	1885	1781	1746
60°	1791	1673	1647
65°	1688	1561	1530
70°	1557	1425	1404
75°	1375	1261	1286
80°	1156	1052	1063
85°	813	697	695

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 4232 cd/sqm

TEST NUMBER: P911864

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.2
10°-20°	571.4	3.3
20°-30°	839.7	4.9
30°-40°	975.2	5.6
40°-50°	974.0	5.6
50°-60°	849.3	4.9
60°-70°	627.9	3.6
70°-80°	355.2	2.1
80°-90°	105.7	0.6
90°-100°	260.4	1.5
100°-110°	827.5	4.8
110°-120°	1416.1	8.2
120°-130°	1862.4	10.8
130°-140°	2090.5	12.1
140°-150°	2050.0	11.9
150°-160°	1719.6	10.0
160°-170°	1140.4	6.6
170°-180°	398.6	2.3
0°-30°	1614.1	9.3
0°-40°	2589.4	15.0
0°-60°	4412.7	25.6
0°-90°	5501.5	31.9
90°-120°	2504.0	14.5
90°-150°	8506.9	49.3
90°-180°	11766.0	68.1
0°-180°	17267.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	4	46	124	117	120	17
95°	185	221	227	227	221	206
105°	764	774	782	788	788	806
115°	1421	1442	1435	1431	1421	1406
125°	2067	2099	2089	2077	2073	1847
135°	2674	2713	2720	2717	2706	2066
145°	3246	3271	3291	3295	3281	2028
155°	3711	3722	3733	3751	3739	1708
165°	4038	4034	4034	4059	4041	1139
175°	4201	4191	4184	4209	4187	399
180°	4209	4209	4209	4209	4209	

TEST NUMBER: P911864

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	3.8	45.7	124.3	116.8	120.5
92.5°	78.6	106.6	110.3	114.2	114.2
95°	185.2	220.8	227.1	227.1	220.8
97.5°	308.3	341.4	355.3	355.3	355.3
100°	450.5	479.6	489.7	489.7	486.0
102.5°	600.2	621.7	635.7	639.6	635.7
105°	763.9	774.0	781.6	787.9	787.9
107.5°	926.2	941.5	941.5	944.0	926.2
110°	1083.6	1103.9	1103.9	1103.9	1093.8

TEST NUMBER: P911864

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US850-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1253.6	1275.2	1271.4	1261.3	1253.6
115°	1421.1	1441.5	1435.0	1431.3	1421.1
117.5°	1587.3	1615.3	1597.5	1587.3	1577.2
120°	1754.9	1782.7	1754.9	1754.9	1743.5
122.5°	1907.1	1942.6	1924.9	1914.7	1907.1
125°	2067.0	2098.7	2088.6	2077.2	2073.3
127.5°	2223.1	2262.4	2248.4	2233.2	2223.1
130°	2368.9	2414.6	2408.3	2400.7	2386.7
132.5°	2532.6	2568.2	2570.7	2552.9	2542.8
135°	2673.5	2712.8	2720.5	2716.6	2706.5
137.5°	2830.8	2862.6	2868.9	2866.3	2851.1
140°	2969.1	3000.8	3018.6	3018.6	3004.6
142.5°	3111.3	3143.0	3153.1	3156.9	3143.0
145°	3245.7	3271.1	3291.4	3295.3	3281.3
147.5°	3366.3	3398.0	3413.3	3419.6	3405.6
150°	3490.7	3512.2	3526.2	3537.6	3526.2
152.5°	3601.0	3622.5	3640.4	3654.4	3640.4
155°	3711.4	3721.6	3733.0	3750.7	3739.3
157.5°	3806.6	3814.2	3820.5	3845.9	3828.2
160°	3891.6	3899.2	3903.0	3924.6	3909.3
162.5°	3970.2	3970.2	3974.1	3998.2	3980.4
165°	4037.5	4033.8	4033.8	4059.1	4041.3
167.5°	4098.4	4087.0	4087.0	4112.4	4094.6
170°	4144.1	4133.9	4130.1	4155.5	4133.9
172.5°	4175.8	4165.6	4161.9	4187.3	4165.6
175°	4201.2	4191.0	4183.5	4208.8	4187.3
177.5°	4215.2	4205.0	4197.3	4219.0	4197.3
180°	4208.8	4208.8	4208.8	4208.8	4208.8

TEST NUMBER: P911864

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.41	9.13	9.51	10.23	11.74	7.97	8.69	9.07	9.78	11.29
	3H	10.06	10.70	11.17	11.81	13.33	9.57	10.21	10.68	11.32	12.84
	4H	10.64	11.25	11.75	12.35	13.88	10.14	10.75	11.26	11.86	13.39
	6H	11.03	11.59	12.15	12.70	14.24	10.53	11.09	11.65	12.20	13.74
	8H	11.12	11.66	12.25	12.78	14.32	10.62	11.16	11.75	12.28	13.82
	12H	11.17	11.67	12.30	12.79	14.35	10.66	11.17	11.79	12.28	13.84
4H	2H	8.85	9.46	9.98	10.57	12.10	8.50	9.11	9.62	10.22	11.75
	3H	10.70	11.21	11.83	12.34	13.89	10.29	10.80	11.42	11.93	13.48
	4H	11.41	11.87	12.54	13.00	14.56	10.98	11.45	12.12	12.57	14.13
	6H	11.91	12.31	13.05	13.45	15.01	11.48	11.88	12.62	13.02	14.58
	8H	12.05	12.43	13.19	13.56	15.13	11.61	11.99	12.76	13.13	14.70
	12H	12.12	12.46	13.27	13.60	15.18	11.67	12.01	12.82	13.15	14.73
8H	4H	11.59	11.96	12.73	13.10	14.67	11.21	11.58	12.35	12.72	14.29
	6H	12.20	12.52	13.37	13.69	15.26	11.82	12.13	12.98	13.31	14.88
	8H	12.42	12.69	13.59	13.85	15.44	12.03	12.30	13.20	13.46	15.04
	12H	12.54	12.78	13.71	13.93	15.56	12.13	12.37	13.30	13.52	15.15
12H	4H	11.56	11.90	12.72	13.05	14.63	11.20	11.54	12.35	12.68	14.26
	6H	12.23	12.50	13.40	13.66	15.25	11.86	12.13	13.03	13.29	14.88
	8H	12.46	12.70	13.63	13.86	15.48	12.08	12.32	13.25	13.47	15.10