

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911871

Luminaire Tested: DFN2DIP-SQ3F0-060D040US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911871
REPORT IS A COMBINATION OF REPORTS P901386 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D040US850-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10047.6 lumens
Efficiency: N/A
Efficacy: 120.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 83.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911871

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US850-RLLONL

Luminous Intensity Polar Plot

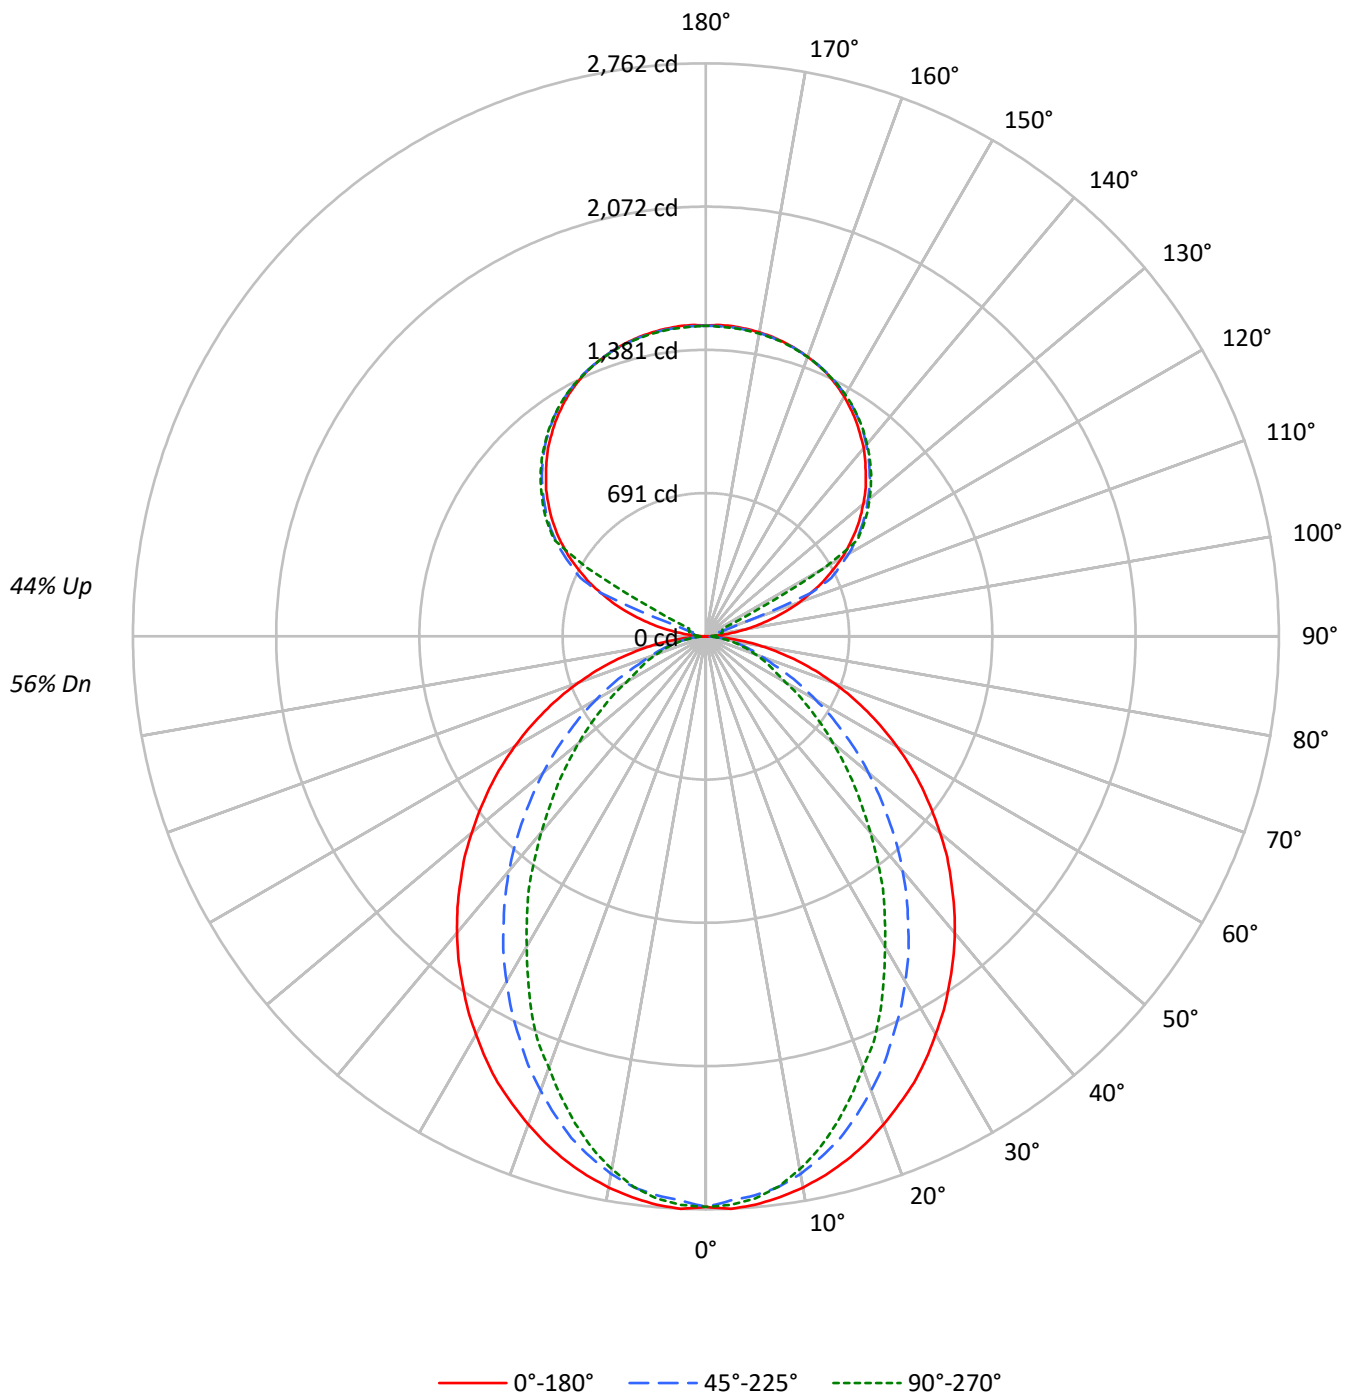

TEST NUMBER: P911871

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	56	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	50	48	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	31
6	65	54	46	40	61	50	43	38	44	39	34	39	34	31	33	30	27
7	61	49	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3151	3151	3151
5°	3154	3099	3120
10°	3121	3036	3017
15°	3076	2934	2859
20°	3017	2794	2666
25°	2957	2637	2479
30°	2877	2476	2243
35°	2798	2303	2035
40°	2718	2125	1797
45°	2625	1928	1582
50°	2528	1728	1371
55°	2427	1516	1169
60°	2310	1294	961
65°	2176	1068	864
70°	2012	858	780
75°	1807	752	708
80°	1510	624	610
85°	1024	406	452

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2625 cd/sqm

TEST NUMBER: P911871

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.7	2.6
10°-20°	707.6	7.0
20°-30°	993.4	9.9
30°-40°	1082.8	10.8
40°-50°	995.2	9.9
50°-60°	781.6	7.8
60°-70°	508.8	5.1
70°-80°	261.9	2.6
80°-90°	69.5	0.7
90°-100°	49.4	0.5
100°-110°	184.0	1.8
110°-120°	488.1	4.9
120°-130°	809.5	8.1
130°-140°	859.9	8.6
140°-150°	799.2	8.0
150°-160°	642.5	6.4
160°-170°	414.0	4.1
170°-180°	142.5	1.4
0°-30°	1958.7	19.5
0°-40°	3041.5	30.3
0°-60°	4818.4	48.0
0°-90°	5658.6	56.3
90°-120°	721.5	7.2
90°-150°	3190.0	31.7
90°-180°	4389.0	43.7
0°-180°	10047.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2750	2750	2750	2750	2750	
5°	2750	2738	2705	2728	2720	261
15°	2616	2588	2504	2456	2432	737
25°	2374	2295	2130	2028	1991	1092
35°	2046	1919	1700	1543	1488	1281
45°	1672	1506	1244	1068	1008	1292
55°	1272	1078	809	660	612	1136
65°	859	657	433	349	341	851
75°	458	284	199	182	179	484
85°	107	55	47	47	47	123
90°	1	13	22	27	29	9
95°	70	35	42	48	47	83
105°	329	362	66	78	82	352
115°	623	641	668	167	89	613
125°	881	895	915	923	926	785
135°	1090	1107	1117	1128	1126	842
145°	1264	1263	1281	1289	1284	791
155°	1392	1382	1395	1402	1393	641
165°	1467	1460	1464	1471	1464	414
175°	1500	1493	1495	1502	1492	143
180°	1497	1497	1497	1497	1497	

TEST NUMBER: P911871

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.1	2750.1	2750.1	2750.1	2750.1
2.5°	2762.5	2750.1	2722.6	2747.7	2742.7
5°	2750.1	2737.7	2705.2	2727.7	2720.3
7.5°	2727.7	2712.8	2678.0	2687.8	2675.4
10°	2697.8	2680.3	2630.8	2623.1	2608.3
12.5°	2660.6	2638.1	2570.8	2556.0	2528.5
15°	2615.7	2588.2	2503.7	2456.4	2431.6
17.5°	2563.5	2523.5	2419.0	2364.3	2324.5
20°	2503.7	2453.8	2329.5	2267.4	2212.5
22.5°	2439.0	2381.7	2237.3	2152.8	2115.5
25°	2374.4	2294.6	2130.4	2028.5	1991.0
27.5°	2297.3	2212.5	2030.8	1913.8	1856.6
30°	2215.1	2120.3	1921.2	1794.5	1727.2
32.5°	2135.4	2020.8	1817.0	1667.5	1605.2
35°	2045.9	1918.9	1700.0	1543.1	1488.2
37.5°	1958.7	1821.6	1590.4	1418.5	1356.4
40°	1866.6	1717.4	1475.7	1299.1	1234.4
42.5°	1772.1	1612.8	1361.4	1177.1	1115.1
45°	1672.5	1505.6	1244.5	1067.5	1007.9
47.5°	1578.0	1401.3	1132.5	955.6	901.0
50°	1473.4	1296.8	1022.9	851.0	799.0
52.5°	1371.2	1184.5	918.4	754.1	706.9
55°	1271.7	1077.6	808.8	659.6	612.3
57.5°	1169.8	970.6	711.9	572.5	532.5
60°	1065.2	866.1	609.7	483.0	443.0
62.5°	963.3	764.2	522.6	403.2	383.4
65°	858.7	657.0	433.1	348.6	340.9
67.5°	759.1	557.4	348.6	306.1	298.7
70°	654.5	460.5	288.6	263.8	253.7
72.5°	555.1	370.7	241.3	221.6	216.5
75°	457.9	283.6	199.1	181.7	179.3
77.5°	361.0	201.5	156.8	146.8	141.8
80°	271.2	144.4	119.3	109.6	109.6
82.5°	189.1	97.1	82.1	77.1	77.1
85°	106.9	54.7	47.2	47.2	47.2
87.5°	39.9	19.9	19.9	17.4	17.4
90°	1.0	13.0	21.6	27.2	29.2
92.5°	27.2	22.7	26.0	28.2	29.2
95°	70.3	34.6	42.1	47.7	46.6
97.5°	126.8	37.9	55.2	58.6	59.6
100°	191.7	43.4	61.8	70.3	72.5
102.5°	263.2	261.2	63.9	75.7	79.1
105°	329.3	361.9	66.1	78.0	82.3
107.5°	406.2	433.3	68.3	80.2	84.5
110°	480.0	502.6	189.6	81.3	85.5

TEST NUMBER: P911871

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	549.3	568.7	550.3	83.4	86.7
115°	622.8	641.2	668.4	166.8	88.9
117.5°	686.8	708.4	726.9	571.9	288.1
120°	758.3	774.5	794.0	807.1	660.9
122.5°	818.9	836.3	858.0	864.5	865.6
125°	880.7	894.9	915.4	923.0	926.2
127.5°	937.0	952.2	968.5	979.4	980.4
130°	990.1	1007.5	1019.3	1031.3	1030.3
132.5°	1044.2	1058.4	1070.3	1080.1	1079.1
135°	1089.8	1107.2	1116.9	1127.7	1125.6
137.5°	1137.4	1150.4	1161.3	1172.1	1168.9
140°	1184.0	1192.7	1204.6	1214.4	1208.9
142.5°	1223.1	1230.7	1244.7	1253.3	1248.0
145°	1264.3	1263.2	1281.4	1289.1	1283.7
147.5°	1299.9	1296.6	1315.1	1320.5	1316.3
150°	1334.6	1327.0	1344.4	1350.9	1345.4
152.5°	1363.8	1355.2	1371.4	1377.9	1370.4
155°	1392.0	1382.4	1395.3	1401.8	1393.1
157.5°	1414.8	1406.1	1416.0	1423.5	1414.8
160°	1434.3	1427.7	1434.3	1440.7	1433.2
162.5°	1451.6	1445.1	1450.6	1458.1	1448.4
165°	1466.8	1460.3	1463.5	1471.1	1463.5
167.5°	1478.7	1472.1	1475.5	1483.1	1473.3
170°	1488.5	1482.0	1484.1	1491.7	1482.0
172.5°	1494.9	1488.5	1490.7	1498.3	1488.5
175°	1500.3	1492.7	1494.9	1502.5	1491.7
177.5°	1502.5	1494.9	1496.0	1503.7	1493.9
180°	1497.2	1497.2	1497.2	1497.2	1497.2

TEST NUMBER: P911871

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.67	12.56	12.58	13.48	14.66	7.63	8.52	8.54	9.44	10.62
	3H	13.35	14.14	14.27	15.07	16.28	8.82	9.61	9.74	10.54	11.75
	4H	13.96	14.70	14.89	15.64	16.86	9.27	10.01	10.20	10.95	12.17
	6H	14.38	15.06	15.32	16.01	17.24	9.59	10.27	10.53	11.22	12.44
	8H	14.50	15.16	15.46	16.12	17.34	9.67	10.33	10.63	11.29	12.51
	12H	14.56	15.19	15.52	16.14	17.39	9.72	10.34	10.67	11.29	12.54
4H	2H	11.69	12.44	12.63	13.38	14.59	8.23	8.98	9.17	9.92	11.13
	3H	13.52	14.14	14.47	15.11	16.34	9.58	10.20	10.53	11.17	12.40
	4H	14.21	14.78	15.17	15.74	17.00	10.12	10.69	11.08	11.65	12.91
	6H	14.73	15.21	15.70	16.20	17.45	10.54	11.03	11.51	12.01	13.27
	8H	14.90	15.36	15.88	16.33	17.60	10.67	11.12	11.64	12.10	13.37
	12H	15.00	15.41	15.99	16.40	17.67	10.73	11.14	11.72	12.13	13.41
8H	4H	14.18	14.64	15.16	15.62	16.88	10.41	10.86	11.38	11.84	13.11
	6H	14.75	15.12	15.75	16.14	17.41	10.92	11.29	11.92	12.31	13.58
	8H	14.96	15.29	15.97	16.30	17.58	11.10	11.43	12.11	12.44	13.73
	12H	15.10	15.39	16.11	16.39	17.72	11.22	11.51	12.23	12.51	13.84
12H	4H	14.14	14.55	15.13	15.54	16.82	10.41	10.82	11.41	11.82	13.09
	6H	14.72	15.05	15.73	16.06	17.35	10.97	11.30	11.97	12.31	13.59
	8H	14.94	15.23	15.95	16.23	17.56	11.17	11.46	12.18	12.47	13.80

END OF REPORT