

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911876

Luminaire Tested: DFN2DIP-SQ3F0-060D060US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911876
REPORT IS A COMBINATION OF REPORTS P899901 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D060US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12476.2 lumens
Efficiency: N/A
Efficacy: 126.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911876

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US850-FLLFLL

Luminous Intensity Polar Plot

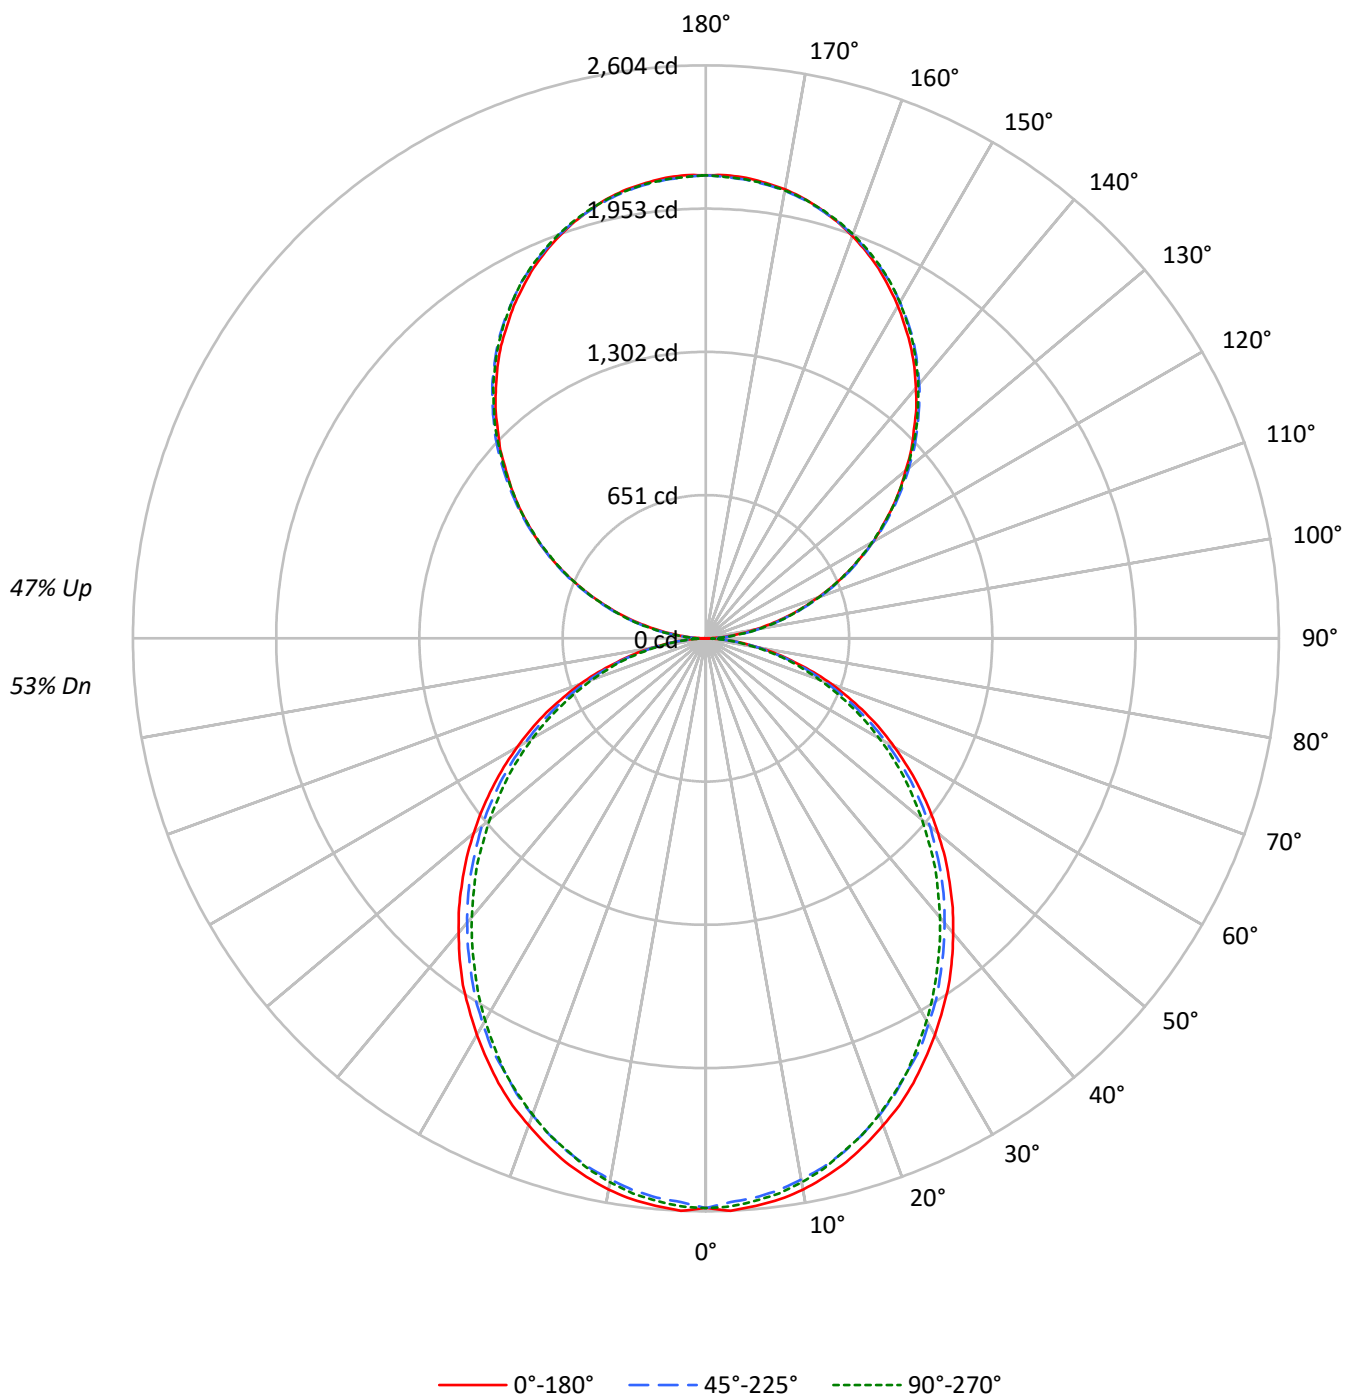

TEST NUMBER: P911876

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2967	2967	2967
5°	2969	2923	2944
10°	2944	2882	2903
15°	2898	2833	2840
20°	2838	2765	2775
25°	2778	2684	2700
30°	2703	2609	2606
35°	2632	2520	2506
40°	2545	2431	2410
45°	2458	2341	2313
50°	2362	2246	2200
55°	2262	2137	2096
60°	2149	2008	1977
65°	2025	1874	1836
70°	1868	1710	1684
75°	1650	1513	1543
80°	1387	1262	1275
85°	976	836	835

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2458 cd/sqm

TEST NUMBER: P911876

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	2.0
10°-20°	685.6	5.5
20°-30°	1007.6	8.1
30°-40°	1170.3	9.4
40°-50°	1168.8	9.4
50°-60°	1019.2	8.2
60°-70°	753.4	6.0
70°-80°	426.3	3.4
80°-90°	118.5	0.9
90°-100°	130.2	1.0
100°-110°	413.7	3.3
110°-120°	708.0	5.7
120°-130°	931.2	7.5
130°-140°	1045.3	8.4
140°-150°	1025.0	8.2
150°-160°	859.8	6.9
160°-170°	570.2	4.6
170°-180°	199.3	1.6
0°-30°	1937.0	15.5
0°-40°	3107.2	24.9
0°-60°	5295.3	42.4
0°-90°	6593.4	52.8
90°-120°	1252.0	10.0
90°-150°	4253.5	34.1
90°-180°	5883.0	47.2
0°-180°	12476.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	2	23	62	58	60	12
95°	93	110	114	114	110	103
105°	382	387	391	394	394	403
115°	710	721	718	716	710	703
125°	1034	1049	1044	1039	1037	924
135°	1337	1356	1360	1358	1353	1033
145°	1623	1636	1646	1648	1641	1014
155°	1856	1861	1866	1875	1870	854
165°	2019	2017	2017	2030	2021	569
175°	2101	2096	2092	2104	2094	200
180°	2104	2104	2104	2104	2104	

TEST NUMBER: P911876

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	1.9	22.8	62.2	58.3	60.2
92.5°	39.4	53.3	55.2	57.1	57.1
95°	92.6	110.3	113.6	113.6	110.3
97.5°	154.2	170.7	177.7	177.7	177.7
100°	225.2	239.8	244.9	244.9	243.0
102.5°	300.1	310.9	317.8	319.7	317.8
105°	381.9	387.0	390.8	394.0	394.0
107.5°	463.1	470.8	470.8	472.0	463.1
110°	541.9	551.9	551.9	551.9	546.8



TEST NUMBER: P911876

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	626.8	637.6	635.7	630.6	626.8
115°	710.5	720.7	717.5	715.6	710.5
117.5°	793.7	807.7	798.7	793.7	788.6
120°	877.4	891.4	877.4	877.4	871.7
122.5°	953.5	971.3	962.4	957.4	953.5
125°	1033.5	1049.3	1044.2	1038.6	1036.7
127.5°	1111.6	1131.2	1124.2	1116.7	1111.6
130°	1184.5	1207.4	1204.2	1200.4	1193.4
132.5°	1266.4	1284.1	1285.3	1276.5	1271.4
135°	1336.8	1356.4	1360.2	1358.3	1353.2
137.5°	1415.4	1431.3	1434.5	1433.2	1425.6
140°	1484.6	1500.5	1509.3	1509.3	1502.4
142.5°	1555.6	1571.5	1576.6	1578.4	1571.5
145°	1622.9	1635.6	1645.8	1647.6	1640.7
147.5°	1683.1	1699.0	1706.6	1709.7	1702.8
150°	1745.3	1756.1	1763.1	1768.7	1763.1
152.5°	1800.5	1811.3	1820.2	1827.2	1820.2
155°	1855.7	1860.8	1866.4	1875.4	1869.7
157.5°	1903.3	1907.1	1910.3	1923.0	1914.1
160°	1945.9	1949.6	1951.5	1962.3	1954.7
162.5°	1985.1	1985.1	1987.0	1999.1	1990.2
165°	2018.7	2016.8	2016.8	2029.6	2020.7
167.5°	2049.2	2043.6	2043.6	2056.2	2047.3
170°	2072.1	2067.0	2065.1	2077.7	2067.0
172.5°	2087.9	2082.8	2080.9	2093.6	2082.8
175°	2100.6	2095.6	2091.7	2104.4	2093.6
177.5°	2107.5	2102.6	2098.7	2109.4	2098.7
180°	2104.4	2104.4	2104.4	2104.4	2104.4

TEST NUMBER: P911876

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.27	12.16	12.21	13.11	14.34	10.83	11.72	11.76	12.67	13.90
	3H	12.93	13.73	13.88	14.69	15.94	12.44	13.24	13.39	14.20	15.45
	4H	13.52	14.27	14.48	15.23	16.50	13.02	13.78	13.98	14.74	16.00
	6H	13.92	14.61	14.88	15.58	16.85	13.42	14.11	14.38	15.08	16.35
	8H	14.02	14.68	15.00	15.67	16.94	13.52	14.18	14.49	15.16	16.44
	12H	14.07	14.70	15.05	15.68	16.97	13.56	14.19	14.54	15.17	16.46
4H	2H	11.73	12.49	12.70	13.45	14.71	11.38	12.13	12.34	13.10	14.36
	3H	13.60	14.23	14.57	15.22	16.50	13.19	13.82	14.16	14.81	16.09
	4H	14.31	14.88	15.29	15.87	17.17	13.89	14.46	14.87	15.45	16.75
	6H	14.82	15.32	15.82	16.33	17.63	14.39	14.88	15.38	15.89	17.19
	8H	14.97	15.43	15.97	16.44	17.75	14.53	14.99	15.53	16.00	17.31
	12H	15.04	15.46	16.06	16.48	17.80	14.59	15.01	15.61	16.03	17.35
8H	4H	14.50	14.97	15.50	15.97	17.28	14.13	14.59	15.12	15.59	16.91
	6H	15.13	15.51	16.15	16.56	17.87	14.75	15.13	15.77	16.17	17.48
	8H	15.35	15.68	16.38	16.72	18.05	14.95	15.29	15.98	16.32	17.65
	12H	15.48	15.77	16.51	16.80	18.17	15.07	15.36	16.10	16.39	17.76
12H	4H	14.49	14.91	15.50	15.93	17.25	14.12	14.54	15.14	15.56	16.88
	6H	15.16	15.50	16.19	16.53	17.86	14.79	15.12	15.81	16.16	17.49
	8H	15.40	15.69	16.43	16.72	18.09	15.02	15.31	16.05	16.34	17.71