

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911884

Luminaire Tested: DFN2DIP-SQ3F0-060D080US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911884
REPORT IS A COMBINATION OF REPORTS P899937 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D080US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14439.1 lumens
Efficiency: N/A
Efficacy: 126.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 113.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911884

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US850-FLLFLL

Luminous Intensity Polar Plot

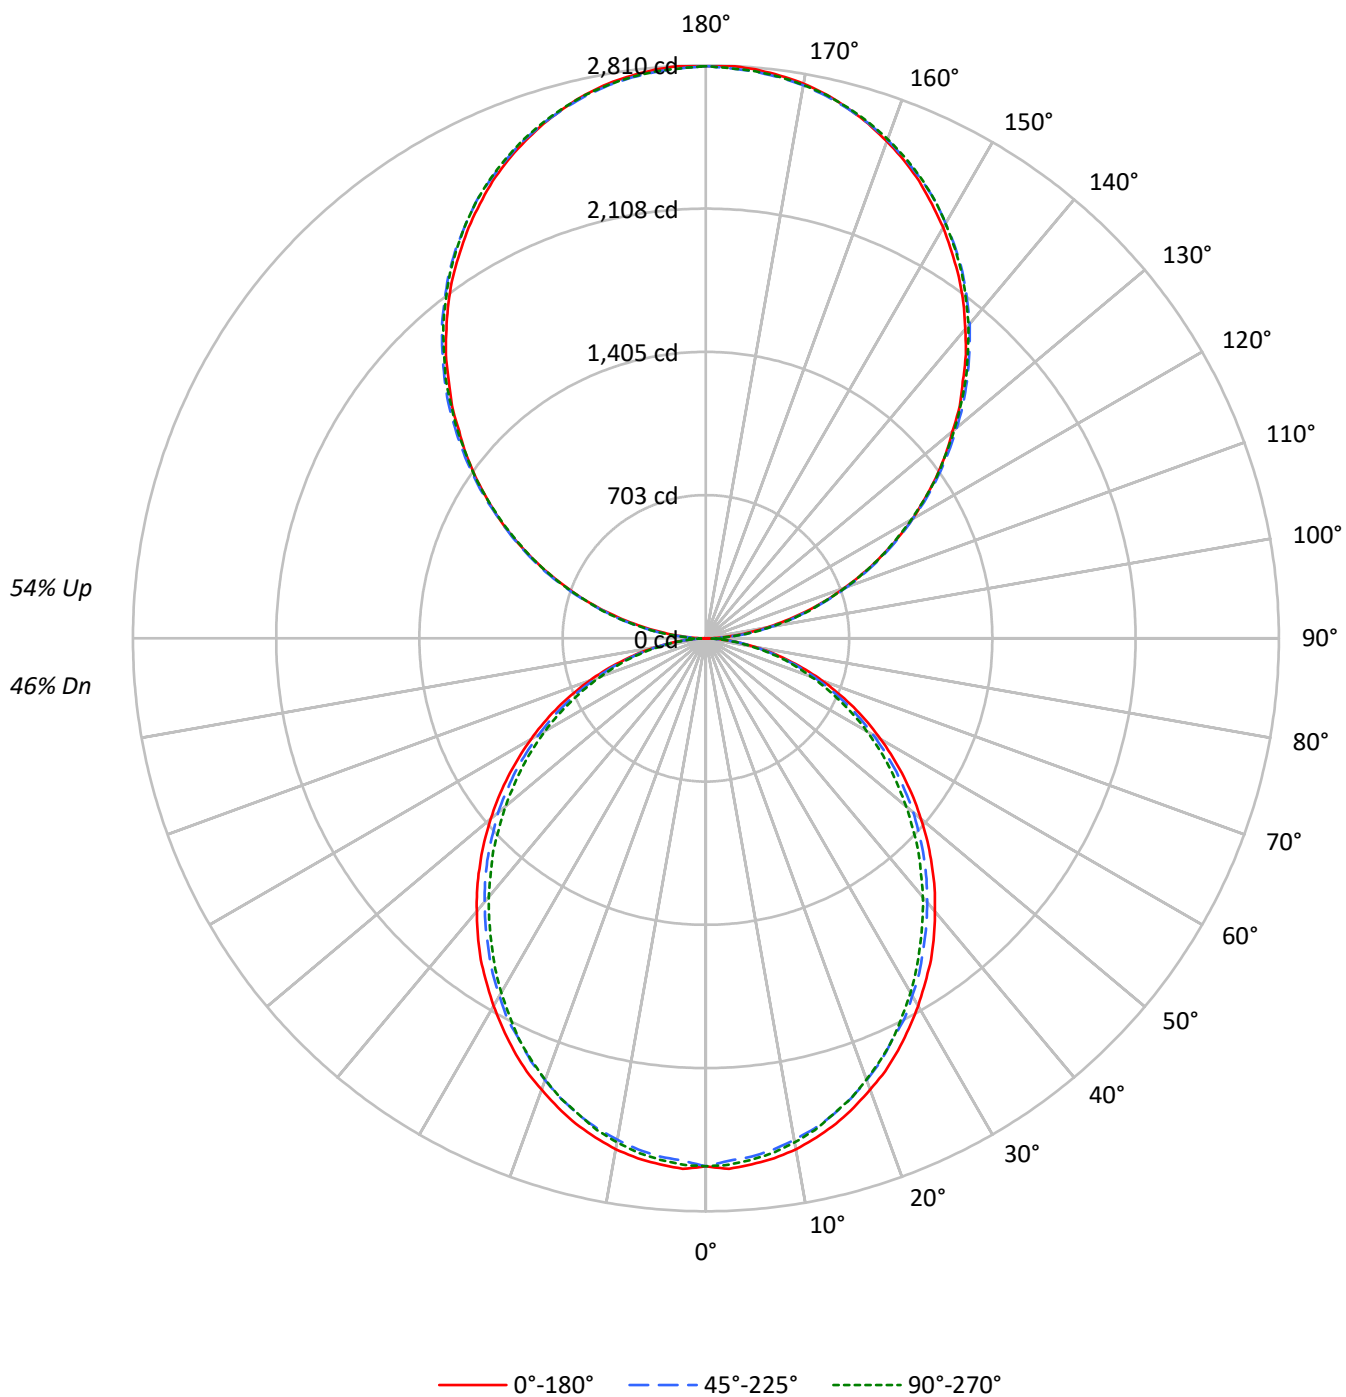

TEST NUMBER: P911884

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2967	2967	2967
5°	2969	2923	2944
10°	2944	2882	2903
15°	2898	2833	2840
20°	2838	2765	2775
25°	2778	2684	2700
30°	2703	2609	2606
35°	2632	2520	2506
40°	2545	2431	2410
45°	2458	2341	2313
50°	2362	2246	2200
55°	2262	2137	2096
60°	2149	2008	1977
65°	2025	1874	1836
70°	1868	1710	1684
75°	1650	1513	1543
80°	1387	1262	1275
85°	976	836	835

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2824 cd/sqm

TEST NUMBER: P911884

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	1.7
10°-20°	685.6	4.7
20°-30°	1007.6	7.0
30°-40°	1170.3	8.1
40°-50°	1168.8	8.1
50°-60°	1019.2	7.1
60°-70°	753.4	5.2
70°-80°	426.3	3.0
80°-90°	120.5	0.8
90°-100°	173.6	1.2
100°-110°	551.7	3.8
110°-120°	944.1	6.5
120°-130°	1241.6	8.6
130°-140°	1393.7	9.7
140°-150°	1366.6	9.5
150°-160°	1146.4	7.9
160°-170°	760.3	5.3
170°-180°	265.7	1.8
0°-30°	1937.0	13.4
0°-40°	3107.2	21.5
0°-60°	5295.3	36.7
0°-90°	6595.4	45.7
90°-120°	1669.4	11.6
90°-150°	5671.3	39.3
90°-180°	7844.0	54.3
0°-180°	14439.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	3	30	83	78	80	14
95°	124	147	151	151	147	137
105°	509	516	521	525	525	537
115°	947	961	957	954	947	937
125°	1378	1399	1392	1385	1382	1231
135°	1782	1809	1814	1811	1804	1378
145°	2164	2181	2194	2197	2188	1352
155°	2474	2481	2489	2500	2493	1139
165°	2692	2689	2689	2706	2694	759
175°	2801	2794	2789	2806	2792	266
180°	2806	2806	2806	2806	2806	

TEST NUMBER: P911884

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	2.6	30.5	83.0	77.9	80.4
92.5°	52.5	71.1	73.6	76.1	76.1
95°	123.5	147.2	151.4	151.4	147.2
97.5°	205.6	227.6	236.9	236.9	236.9
100°	300.3	319.7	326.5	326.5	323.9
102.5°	400.1	414.5	423.7	426.3	423.7
105°	509.3	516.0	521.1	525.3	525.3
107.5°	617.5	627.7	627.7	629.4	617.5
110°	722.4	735.9	735.9	735.9	729.2

TEST NUMBER: P911884

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	835.7	850.2	847.6	840.8	835.7
115°	947.4	960.9	956.7	954.2	947.4
117.5°	1058.2	1076.8	1065.0	1058.2	1051.4
120°	1169.9	1188.5	1169.9	1169.9	1162.2
122.5°	1271.4	1295.1	1283.2	1276.5	1271.4
125°	1377.9	1399.1	1392.3	1384.7	1382.3
127.5°	1482.1	1508.2	1498.9	1488.8	1482.1
130°	1579.3	1609.7	1605.5	1600.5	1591.2
132.5°	1688.5	1712.1	1713.8	1702.0	1695.2
135°	1782.3	1808.6	1813.7	1811.1	1804.3
137.5°	1887.2	1908.4	1912.6	1910.9	1900.7
140°	1979.5	2000.5	2012.4	2012.4	2003.1
142.5°	2074.2	2095.3	2102.1	2104.7	2095.3
145°	2163.9	2180.7	2194.3	2196.8	2187.5
147.5°	2244.2	2265.4	2275.4	2279.8	2270.5
150°	2327.1	2341.4	2350.7	2358.4	2350.7
152.5°	2400.7	2415.1	2426.9	2436.3	2426.9
155°	2474.3	2481.1	2488.7	2500.5	2492.9
157.5°	2537.7	2542.8	2547.0	2563.9	2552.1
160°	2594.4	2599.5	2602.0	2616.4	2606.3
162.5°	2646.9	2646.9	2649.4	2665.5	2653.6
165°	2691.7	2689.1	2689.1	2706.1	2694.2
167.5°	2732.2	2724.7	2724.7	2741.6	2729.7
170°	2762.7	2756.0	2753.4	2770.4	2756.0
172.5°	2783.9	2777.2	2774.6	2791.5	2777.2
175°	2800.8	2794.0	2788.9	2805.9	2791.5
177.5°	2810.1	2803.3	2798.2	2812.6	2798.2
180°	2805.9	2805.9	2805.9	2805.9	2805.9

TEST NUMBER: P911884

CATALOG NUMBER: DFN2DIP-SQ3F0-060D080US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.60	11.42	11.59	12.43	13.76	10.16	10.98	11.15	11.99	13.32
	3H	12.25	12.99	13.26	14.01	15.36	11.76	12.50	12.77	13.52	14.87
	4H	12.84	13.54	13.85	14.55	15.91	12.34	13.04	13.36	14.06	15.42
	6H	13.23	13.88	14.26	14.90	16.27	12.73	13.38	13.76	14.40	15.77
	8H	13.33	13.95	14.37	14.98	16.35	12.83	13.44	13.86	14.48	15.85
	12H	13.38	13.96	14.42	14.99	16.39	12.87	13.45	13.91	14.48	15.88
4H	2H	11.05	11.75	12.08	12.77	14.13	10.70	11.40	11.72	12.42	13.78
	3H	12.91	13.49	13.94	14.54	15.91	12.50	13.09	13.53	14.13	15.51
	4H	13.62	14.15	14.66	15.19	16.59	13.20	13.73	14.23	14.77	16.16
	6H	14.13	14.59	15.18	15.65	17.04	13.70	14.16	14.74	15.22	16.61
	8H	14.27	14.70	15.32	15.76	17.16	13.84	14.27	14.89	15.32	16.73
	12H	14.34	14.73	15.41	15.80	17.21	13.89	14.28	14.96	15.35	16.76
8H	4H	13.81	14.24	14.86	15.29	16.70	13.43	13.86	14.48	14.91	16.32
	6H	14.43	14.79	15.51	15.88	17.29	14.05	14.40	15.12	15.50	16.90
	8H	14.65	14.96	15.73	16.04	17.46	14.26	14.57	15.34	15.65	17.07
	12H	14.78	15.05	15.86	16.12	17.59	14.36	14.64	15.45	15.71	17.18
12H	4H	13.79	14.18	14.86	15.25	16.66	13.42	13.81	14.49	14.88	16.29
	6H	14.46	14.77	15.54	15.85	17.28	14.09	14.40	15.17	15.48	16.90
	8H	14.70	14.97	15.78	16.05	17.51	14.32	14.59	15.40	15.66	17.13

END OF REPORT