

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911988

Luminaire Tested: DFN2DIP-SQ3F0-090D070US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911988
REPORT IS A COMBINATION OF REPORTS P899925 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D070US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16751.5 lumens
Efficiency: N/A
Efficacy: 119.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 140.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911988

CATALOG NUMBER: DFN2DIP-SQ3F0-090D070US850-FLLFLL

Luminous Intensity Polar Plot

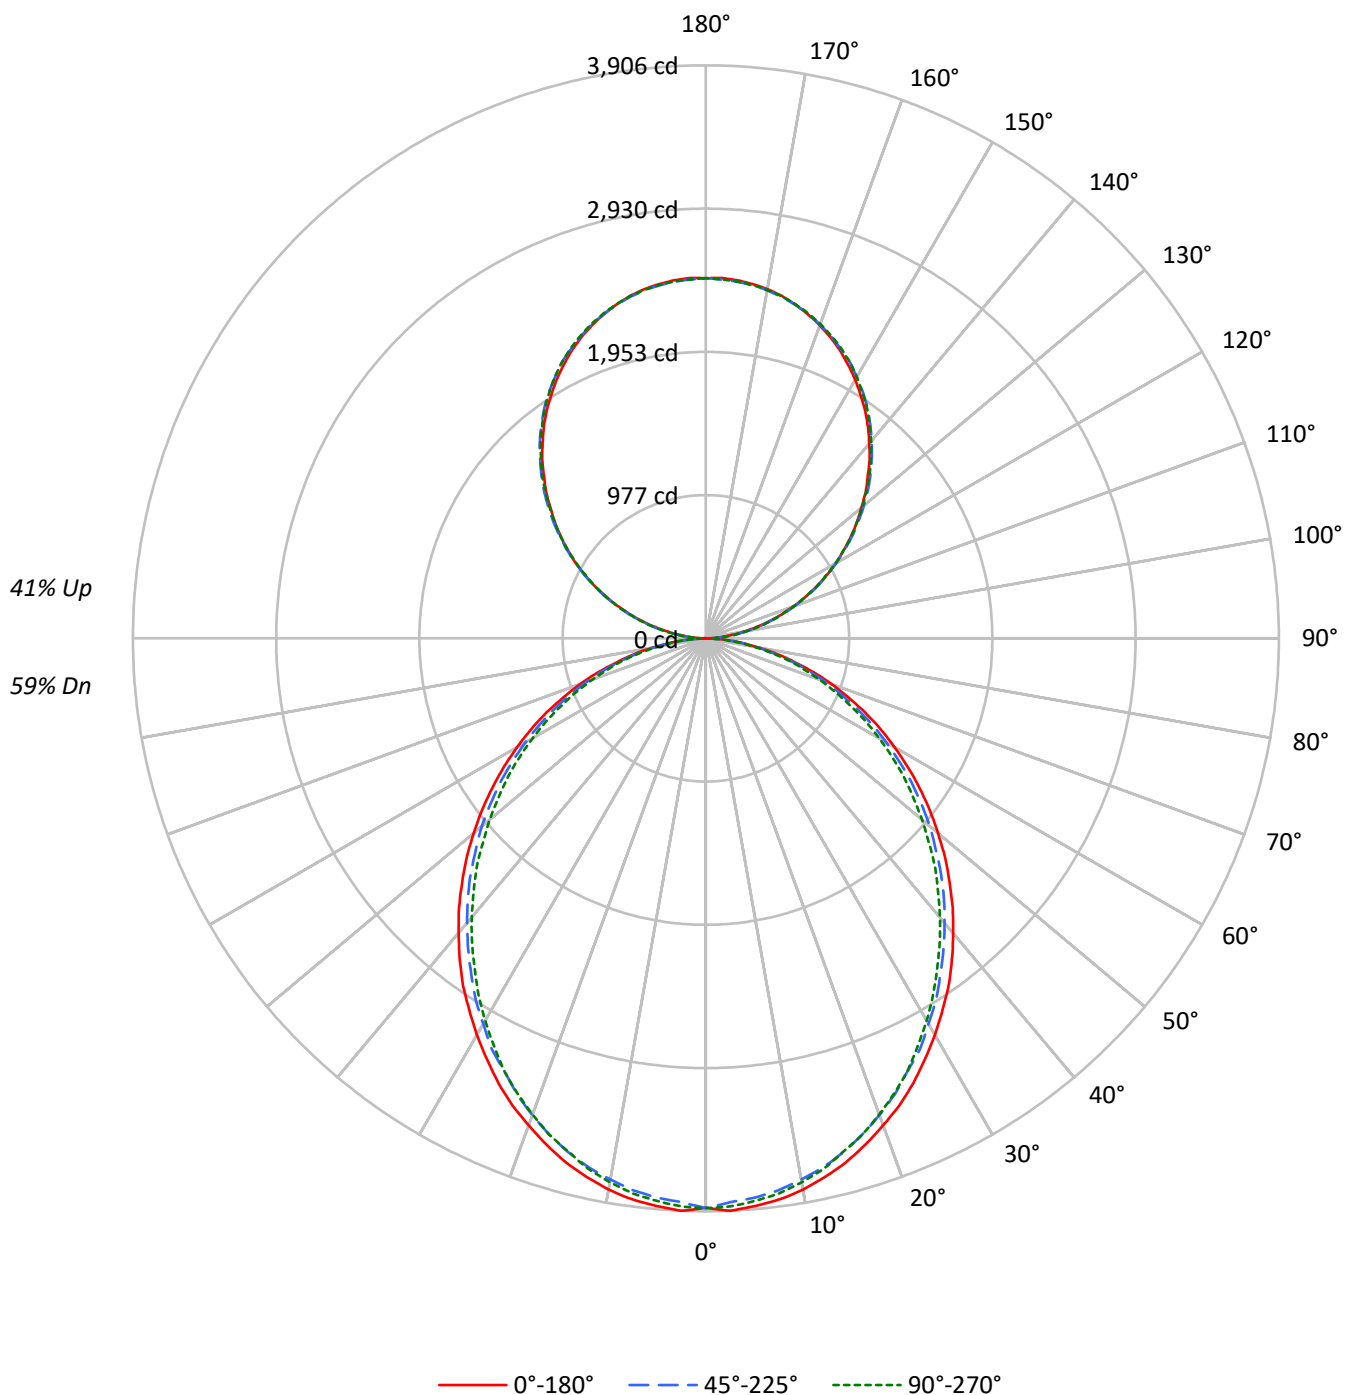

TEST NUMBER: P911988

CATALOG NUMBER: DFN2DIP-SQ3F0-090D070US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	78	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	73	68	68	64	60	59	56	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	42	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	33	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4450	4450	4450
5°	4454	4385	4416
10°	4415	4323	4355
15°	4348	4249	4260
20°	4257	4147	4163
25°	4167	4026	4051
30°	4054	3913	3909
35°	3948	3780	3759
40°	3817	3646	3616
45°	3686	3511	3469
50°	3543	3369	3300
55°	3393	3206	3144
60°	3224	3012	2965
65°	3038	2810	2754
70°	2802	2565	2527
75°	2476	2270	2314
80°	2080	1894	1913
85°	1464	1255	1252

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3686 cd/sqm

TEST NUMBER: P911988

CATALOG NUMBER: DFN2DIP-SQ3F0-090D070US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.5	2.2
10°-20°	1028.5	6.1
20°-30°	1511.4	9.0
30°-40°	1755.4	10.5
40°-50°	1753.3	10.5
50°-60°	1528.8	9.1
60°-70°	1130.1	6.7
70°-80°	639.4	3.8
80°-90°	175.7	1.0
90°-100°	151.9	0.9
100°-110°	482.7	2.9
110°-120°	826.1	4.9
120°-130°	1086.4	6.5
130°-140°	1219.5	7.3
140°-150°	1195.8	7.1
150°-160°	1003.1	6.0
160°-170°	665.3	4.0
170°-180°	232.5	1.4
0°-30°	2905.4	17.3
0°-40°	4660.9	27.8
0°-60°	7942.9	47.4
0°-90°	9888.2	59.0
90°-120°	1460.7	8.7
90°-150°	4962.4	29.6
90°-180°	6863.0	41.0
0°-180°	16751.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3884	3884	3884	3884	3884	
5°	3884	3869	3828	3858	3850	369
15°	3697	3675	3626	3641	3622	1041
25°	3346	3316	3253	3260	3253	1540
35°	2887	2850	2790	2767	2748	1803
45°	2349	2323	2267	2226	2211	1813
55°	1778	1755	1710	1666	1647	1589
65°	1199	1176	1139	1106	1087	1185
75°	627	620	601	579	586	670
85°	153	149	146	134	131	171
90°	2	27	72	68	70	16
95°	108	129	132	132	129	120
105°	446	452	456	460	460	470
115°	829	841	837	835	829	820
125°	1206	1224	1218	1212	1210	1077
135°	1560	1582	1587	1585	1579	1205
145°	1893	1908	1920	1922	1914	1183
155°	2165	2171	2178	2188	2181	997
165°	2355	2353	2353	2368	2357	664
175°	2451	2445	2440	2455	2443	233
180°	2455	2455	2455	2455	2455	



TEST NUMBER: P911988

CATALOG NUMBER: DFN2DIP-SQ3F0-090D070US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3883.6	3883.6	3883.6	3883.6	3883.6
2.5°	3906.2	3887.6	3846.5	3883.6	3876.5
5°	3883.6	3869.0	3827.8	3857.5	3850.3
7.5°	3857.5	3835.4	3794.1	3824.3	3816.7
10°	3816.7	3790.6	3745.8	3775.5	3764.4
12.5°	3760.4	3738.2	3693.5	3712.0	3704.6
15°	3697.1	3674.9	3626.1	3641.2	3622.5
17.5°	3618.6	3596.4	3547.7	3566.3	3547.7
20°	3532.6	3510.4	3458.1	3469.2	3454.5
22.5°	3447.0	3413.4	3364.6	3364.6	3357.1
25°	3346.0	3316.2	3252.9	3260.0	3252.9
27.5°	3233.8	3207.7	3159.4	3148.3	3129.7
30°	3122.2	3092.0	3036.1	3025.0	3010.0
32.5°	3002.5	2980.3	2920.4	2897.9	2882.8
35°	2886.8	2849.6	2789.7	2767.2	2748.5
37.5°	2756.1	2722.4	2662.5	2636.4	2617.8
40°	2621.7	2591.6	2531.7	2498.5	2483.5
42.5°	2490.9	2460.9	2401.4	2363.8	2341.7
45°	2349.1	2323.0	2266.7	2225.9	2210.9
47.5°	2210.9	2184.7	2124.8	2083.7	2061.5
50°	2065.1	2046.4	1994.1	1941.9	1923.2
52.5°	1923.2	1897.1	1848.7	1807.6	1781.4
55°	1777.8	1755.2	1710.4	1665.7	1647.1
57.5°	1632.0	1613.4	1564.7	1519.9	1504.8
60°	1486.2	1471.5	1419.2	1378.0	1367.0
62.5°	1344.3	1318.2	1280.9	1243.7	1228.7
65°	1198.9	1176.3	1139.1	1105.5	1086.8
67.5°	1049.6	1030.6	997.2	971.2	956.1
70°	911.3	896.2	862.6	836.4	821.8
72.5°	769.4	754.3	735.7	709.6	698.6
75°	627.3	620.0	601.1	578.9	586.4
77.5°	500.4	485.4	477.9	466.8	455.7
80°	373.6	369.6	362.1	351.0	343.6
82.5°	254.0	254.0	250.4	235.3	235.3
85°	152.9	149.4	145.8	134.3	130.8
87.5°	67.3	59.8	52.3	41.3	37.3
90°	2.2	26.6	72.5	68.1	70.3
92.5°	45.9	62.2	64.4	66.7	66.7
95°	108.0	128.8	132.5	132.5	128.8
97.5°	179.9	199.1	207.3	207.3	207.3
100°	262.7	279.8	285.7	285.7	283.5
102.5°	350.1	362.6	370.8	373.1	370.8
105°	445.6	451.5	455.9	459.7	459.7
107.5°	540.3	549.2	549.2	550.7	540.3
110°	632.1	644.0	644.0	644.0	638.0

TEST NUMBER: P911988

CATALOG NUMBER: DFN2DIP-SQ3F0-090D070US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	731.3	743.9	741.7	735.7	731.3
115°	829.0	840.8	837.2	835.0	829.0
117.5°	925.9	942.2	931.9	925.9	920.0
120°	1023.6	1039.9	1023.6	1023.6	1017.0
122.5°	1112.4	1133.2	1122.9	1116.9	1112.4
125°	1205.7	1224.2	1218.3	1211.7	1209.5
127.5°	1296.8	1319.7	1311.6	1302.7	1296.8
130°	1381.9	1408.5	1404.9	1400.4	1392.2
132.5°	1477.4	1498.1	1499.6	1489.3	1483.3
135°	1559.6	1582.4	1587.0	1584.7	1578.8
137.5°	1651.3	1669.8	1673.5	1672.0	1663.2
140°	1732.0	1750.6	1760.9	1760.9	1752.8
142.5°	1814.9	1833.4	1839.3	1841.5	1833.4
145°	1893.4	1908.1	1920.0	1922.2	1914.1
147.5°	1963.7	1982.2	1991.1	1994.8	1986.7
150°	2036.2	2048.8	2057.0	2063.6	2057.0
152.5°	2100.6	2113.2	2123.5	2131.7	2123.5
155°	2165.0	2170.9	2177.6	2187.9	2181.3
157.5°	2220.6	2225.0	2228.6	2243.5	2233.1
160°	2270.1	2274.6	2276.8	2289.3	2280.4
162.5°	2316.0	2316.0	2318.3	2332.2	2321.9
165°	2355.2	2353.0	2353.0	2367.8	2357.4
167.5°	2390.8	2384.1	2384.1	2398.9	2388.6
170°	2417.4	2411.5	2409.3	2424.1	2411.5
172.5°	2435.9	2429.9	2427.7	2442.6	2429.9
175°	2450.7	2444.8	2440.4	2455.1	2442.6
177.5°	2458.9	2452.9	2448.5	2461.1	2448.5
180°	2455.1	2455.1	2455.1	2455.1	2455.1

TEST NUMBER: P911988

CATALOG NUMBER: DFN2DIP-SQ3F0-090D070US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.22	14.17	14.09	15.06	16.20	12.77	13.72	13.65	14.62	15.75
	3H	14.88	15.73	15.77	16.64	17.80	14.39	15.24	15.28	16.15	17.31
	4H	15.47	16.27	16.37	17.19	18.36	14.97	15.78	15.88	16.69	17.86
	6H	15.87	16.61	16.78	17.53	18.71	15.37	16.11	16.28	17.03	18.21
	8H	15.97	16.68	16.90	17.62	18.80	15.47	16.18	16.40	17.12	18.30
	12H	16.02	16.70	16.95	17.63	18.84	15.52	16.19	16.44	17.12	18.33
4H	2H	13.69	14.49	14.59	15.40	16.57	13.33	14.14	14.24	15.05	16.22
	3H	15.55	16.23	16.47	17.17	18.36	15.15	15.82	16.07	16.76	17.95
	4H	16.27	16.88	17.20	17.82	19.03	15.84	16.46	16.77	17.40	18.61
	6H	16.78	17.31	17.73	18.27	19.49	16.35	16.88	17.29	17.84	19.05
	8H	16.93	17.43	17.88	18.38	19.61	16.50	16.99	17.44	17.95	19.17
	12H	17.01	17.45	17.97	18.43	19.66	16.56	17.01	17.52	17.98	19.21
8H	4H	16.47	16.96	17.41	17.92	19.14	16.09	16.58	17.04	17.54	18.77
	6H	17.10	17.51	18.07	18.50	19.73	16.71	17.12	17.68	18.12	19.34
	8H	17.31	17.68	18.30	18.66	19.91	16.92	17.28	17.90	18.27	19.51
	12H	17.45	17.77	18.43	18.75	20.04	17.04	17.35	18.02	18.33	19.62
12H	4H	16.46	16.90	17.42	17.88	19.11	16.09	16.53	17.05	17.51	18.74
	6H	17.12	17.49	18.11	18.47	19.72	16.75	17.12	17.73	18.10	19.34
	8H	17.37	17.69	18.35	18.67	19.96	16.99	17.31	17.97	18.29	19.58