

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911992

Luminaire Tested: DFN2DIP-SQ3F0-090D080US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911992
REPORT IS A COMBINATION OF REPORTS P899943 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D080US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17732.9 lumens
Efficiency: N/A
Efficacy: 119.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 148.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911992

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-FLLFLL

Luminous Intensity Polar Plot

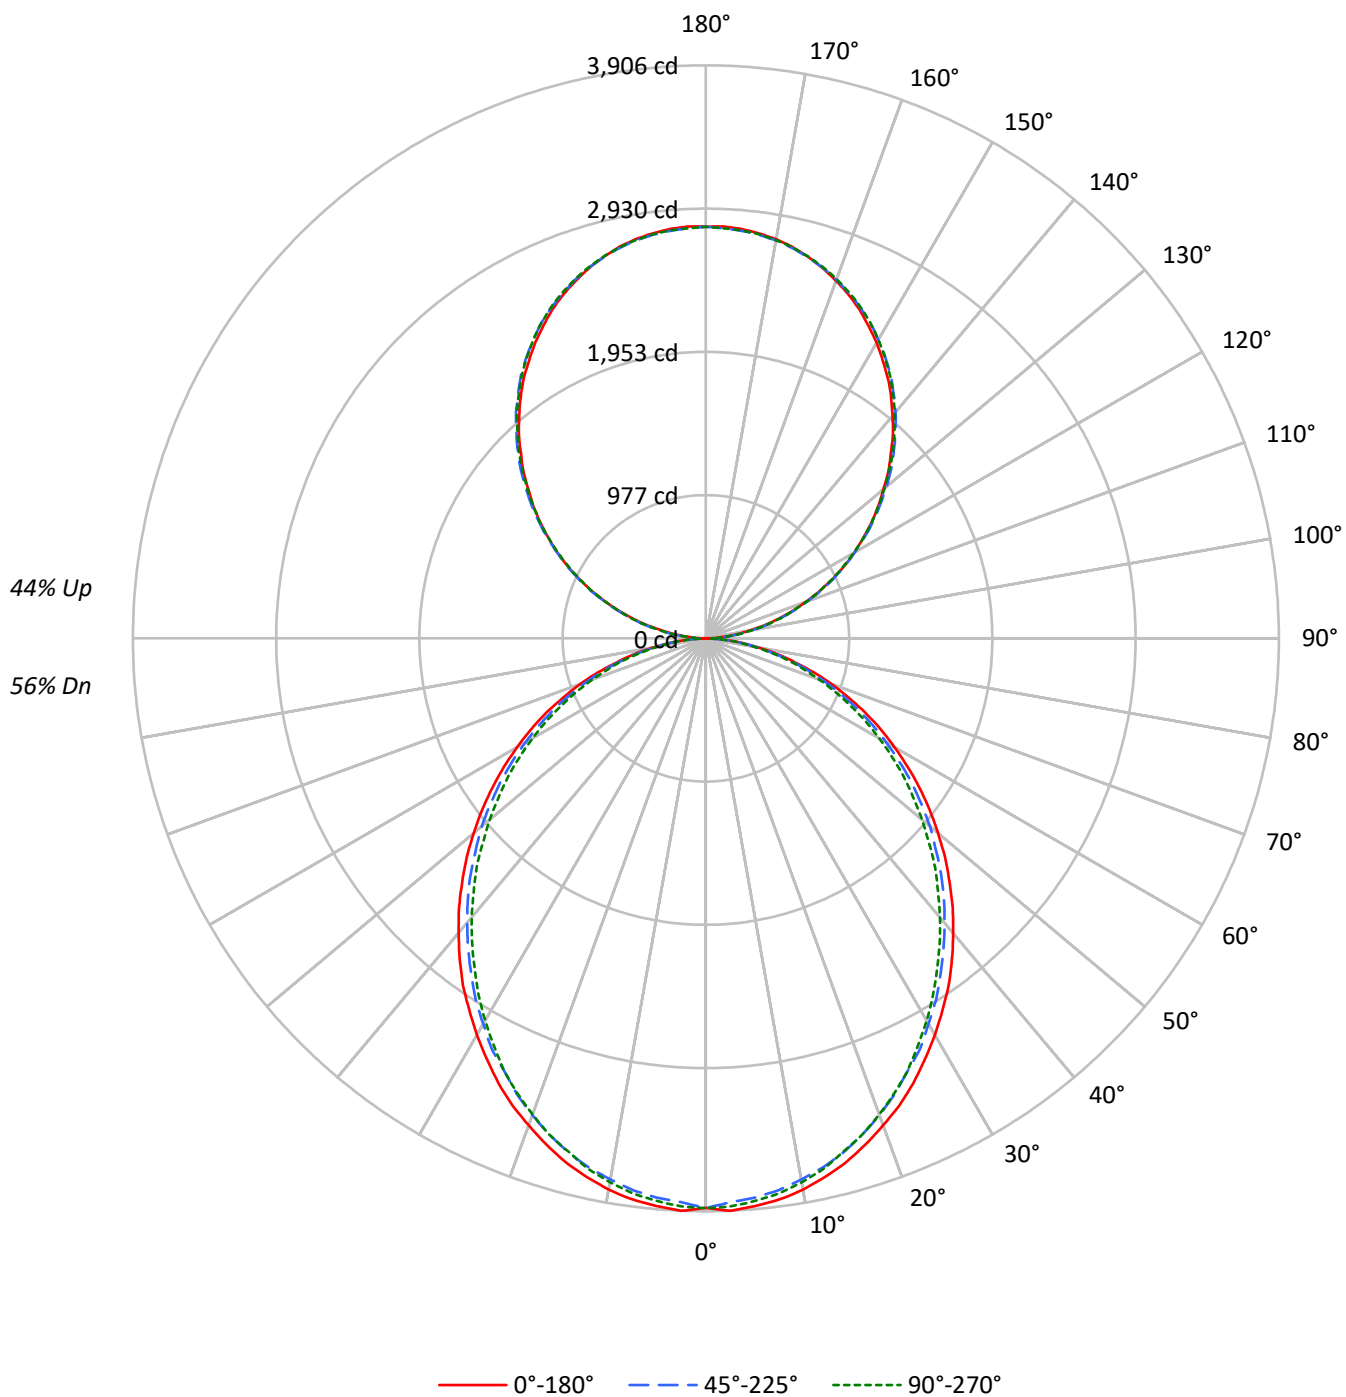

TEST NUMBER: P911992

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	77	71	84	77	72	67	67	62	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	46	43	42	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	52	43	37	59	48	41	36	42	36	32	36	32	28	31	27	25
7	59	47	39	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	30	25	32	26	22	28	23	20	24	20	18
10	48	36	28	23	44	33	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4450	4450	4450
5°	4454	4385	4416
10°	4415	4323	4355
15°	4348	4249	4260
20°	4257	4147	4163
25°	4167	4026	4051
30°	4054	3913	3909
35°	3948	3780	3759
40°	3817	3646	3616
45°	3686	3511	3469
50°	3543	3369	3300
55°	3393	3206	3144
60°	3224	3012	2965
65°	3038	2810	2754
70°	2802	2565	2527
75°	2476	2270	2314
80°	2080	1894	1913
85°	1464	1255	1252

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3686 cd/sqm

TEST NUMBER: P911992

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.5	2.1
10°-20°	1028.5	5.8
20°-30°	1511.4	8.5
30°-40°	1755.4	9.9
40°-50°	1753.3	9.9
50°-60°	1528.8	8.6
60°-70°	1130.1	6.4
70°-80°	639.4	3.6
80°-90°	176.7	1.0
90°-100°	173.6	1.0
100°-110°	551.7	3.1
110°-120°	944.1	5.3
120°-130°	1241.6	7.0
130°-140°	1393.7	7.9
140°-150°	1366.6	7.7
150°-160°	1146.4	6.5
160°-170°	760.3	4.3
170°-180°	265.7	1.5
0°-30°	2905.4	16.4
0°-40°	4660.9	26.3
0°-60°	7942.9	44.8
0°-90°	9889.2	55.8
90°-120°	1669.4	9.4
90°-150°	5671.3	32.0
90°-180°	7844.0	44.2
0°-180°	17732.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3884	3884	3884	3884	3884	
5°	3884	3869	3828	3858	3850	369
15°	3697	3675	3626	3641	3622	1041
25°	3346	3316	3253	3260	3253	1540
35°	2887	2850	2790	2767	2748	1803
45°	2349	2323	2267	2226	2211	1813
55°	1778	1755	1710	1666	1647	1589
65°	1199	1176	1139	1106	1087	1185
75°	627	620	601	579	586	670
85°	153	149	146	134	131	171
90°	3	30	83	78	80	17
95°	124	147	151	151	147	137
105°	509	516	521	525	525	537
115°	947	961	957	954	947	937
125°	1378	1399	1392	1385	1382	1231
135°	1782	1809	1814	1811	1804	1378
145°	2164	2181	2194	2197	2188	1352
155°	2474	2481	2489	2500	2493	1139
165°	2692	2689	2689	2706	2694	759
175°	2801	2794	2789	2806	2792	266
180°	2806	2806	2806	2806	2806	

TEST NUMBER: P911992

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3883.6	3883.6	3883.6	3883.6	3883.6
2.5°	3906.2	3887.6	3846.5	3883.6	3876.5
5°	3883.6	3869.0	3827.8	3857.5	3850.3
7.5°	3857.5	3835.4	3794.1	3824.3	3816.7
10°	3816.7	3790.6	3745.8	3775.5	3764.4
12.5°	3760.4	3738.2	3693.5	3712.0	3704.6
15°	3697.1	3674.9	3626.1	3641.2	3622.5
17.5°	3618.6	3596.4	3547.7	3566.3	3547.7
20°	3532.6	3510.4	3458.1	3469.2	3454.5
22.5°	3447.0	3413.4	3364.6	3364.6	3357.1
25°	3346.0	3316.2	3252.9	3260.0	3252.9
27.5°	3233.8	3207.7	3159.4	3148.3	3129.7
30°	3122.2	3092.0	3036.1	3025.0	3010.0
32.5°	3002.5	2980.3	2920.4	2897.9	2882.8
35°	2886.8	2849.6	2789.7	2767.2	2748.5
37.5°	2756.1	2722.4	2662.5	2636.4	2617.8
40°	2621.7	2591.6	2531.7	2498.5	2483.5
42.5°	2490.9	2460.9	2401.4	2363.8	2341.7
45°	2349.1	2323.0	2266.7	2225.9	2210.9
47.5°	2210.9	2184.7	2124.8	2083.7	2061.5
50°	2065.1	2046.4	1994.1	1941.9	1923.2
52.5°	1923.2	1897.1	1848.7	1807.6	1781.4
55°	1777.8	1755.2	1710.4	1665.7	1647.1
57.5°	1632.0	1613.4	1564.7	1519.9	1504.8
60°	1486.2	1471.5	1419.2	1378.0	1367.0
62.5°	1344.3	1318.2	1280.9	1243.7	1228.7
65°	1198.9	1176.3	1139.1	1105.5	1086.8
67.5°	1049.6	1030.6	997.2	971.2	956.1
70°	911.3	896.2	862.6	836.4	821.8
72.5°	769.4	754.3	735.7	709.6	698.6
75°	627.3	620.0	601.1	578.9	586.4
77.5°	500.4	485.4	477.9	466.8	455.7
80°	373.6	369.6	362.1	351.0	343.6
82.5°	254.0	254.0	250.4	235.3	235.3
85°	152.9	149.4	145.8	134.3	130.8
87.5°	67.3	59.8	52.3	41.3	37.3
90°	2.6	30.5	83.0	77.9	80.4
92.5°	52.5	71.1	73.6	76.1	76.1
95°	123.5	147.2	151.4	151.4	147.2
97.5°	205.6	227.6	236.9	236.9	236.9
100°	300.3	319.7	326.5	326.5	323.9
102.5°	400.1	414.5	423.7	426.3	423.7
105°	509.3	516.0	521.1	525.3	525.3
107.5°	617.5	627.7	627.7	629.4	617.5
110°	722.4	735.9	735.9	735.9	729.2

TEST NUMBER: P911992

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	835.7	850.2	847.6	840.8	835.7
115°	947.4	960.9	956.7	954.2	947.4
117.5°	1058.2	1076.8	1065.0	1058.2	1051.4
120°	1169.9	1188.5	1169.9	1169.9	1162.2
122.5°	1271.4	1295.1	1283.2	1276.5	1271.4
125°	1377.9	1399.1	1392.3	1384.7	1382.3
127.5°	1482.1	1508.2	1498.9	1488.8	1482.1
130°	1579.3	1609.7	1605.5	1600.5	1591.2
132.5°	1688.5	1712.1	1713.8	1702.0	1695.2
135°	1782.3	1808.6	1813.7	1811.1	1804.3
137.5°	1887.2	1908.4	1912.6	1910.9	1900.7
140°	1979.5	2000.5	2012.4	2012.4	2003.1
142.5°	2074.2	2095.3	2102.1	2104.7	2095.3
145°	2163.9	2180.7	2194.3	2196.8	2187.5
147.5°	2244.2	2265.4	2275.4	2279.8	2270.5
150°	2327.1	2341.4	2350.7	2358.4	2350.7
152.5°	2400.7	2415.1	2426.9	2436.3	2426.9
155°	2474.3	2481.1	2488.7	2500.5	2492.9
157.5°	2537.7	2542.8	2547.0	2563.9	2552.1
160°	2594.4	2599.5	2602.0	2616.4	2606.3
162.5°	2646.9	2646.9	2649.4	2665.5	2653.6
165°	2691.7	2689.1	2689.1	2706.1	2694.2
167.5°	2732.2	2724.7	2724.7	2741.6	2729.7
170°	2762.7	2756.0	2753.4	2770.4	2756.0
172.5°	2783.9	2777.2	2774.6	2791.5	2777.2
175°	2800.8	2794.0	2788.9	2805.9	2791.5
177.5°	2810.1	2803.3	2798.2	2812.6	2798.2
180°	2805.9	2805.9	2805.9	2805.9	2805.9

TEST NUMBER: P911992

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.94	13.86	13.85	14.78	15.97	12.50	13.41	13.40	14.34	15.52
	3H	14.60	15.42	15.52	16.36	17.57	14.11	14.93	15.03	15.87	17.08
	4H	15.19	15.96	16.12	16.90	18.12	14.69	15.47	15.63	16.41	17.63
	6H	15.59	16.30	16.53	17.25	18.48	15.09	15.80	16.03	16.75	17.98
	8H	15.69	16.37	16.64	17.34	18.57	15.19	15.87	16.14	16.83	18.07
	12H	15.74	16.39	16.70	17.35	18.60	15.23	15.88	16.19	16.84	18.09
4H	2H	13.40	14.18	14.34	15.12	16.34	13.05	13.83	13.99	14.77	15.99
	3H	15.27	15.92	16.22	16.89	18.12	14.86	15.51	15.81	16.48	17.71
	4H	15.98	16.57	16.94	17.54	18.80	15.56	16.15	16.52	17.11	18.37
	6H	16.50	17.01	17.47	17.99	19.25	16.06	16.57	17.03	17.56	18.82
	8H	16.64	17.12	17.62	18.10	19.38	16.21	16.68	17.18	17.67	18.94
	12H	16.72	17.15	17.71	18.15	19.43	16.27	16.70	17.26	17.70	18.98
8H	4H	16.18	16.66	17.15	17.64	18.91	15.80	16.28	16.77	17.26	18.53
	6H	16.81	17.20	17.80	18.22	19.50	16.42	16.82	17.42	17.84	19.11
	8H	17.02	17.37	18.03	18.38	19.67	16.63	16.98	17.64	17.99	19.28
	12H	17.15	17.46	18.17	18.47	19.80	16.74	17.05	17.75	18.06	19.39
12H	4H	16.17	16.60	17.16	17.60	18.87	15.80	16.23	16.79	17.23	18.50
	6H	16.83	17.18	17.84	18.19	19.48	16.46	16.81	17.47	17.82	19.11
	8H	17.08	17.38	18.09	18.39	19.72	16.69	17.00	17.71	18.01	19.34