

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911994

Luminaire Tested: DFN2DIP-SQ3F0-090D080US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911994
REPORT IS A COMBINATION OF REPORTS P899944 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D080US850-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16335.6 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 148.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911994

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-RLLFLL

Luminous Intensity Polar Plot

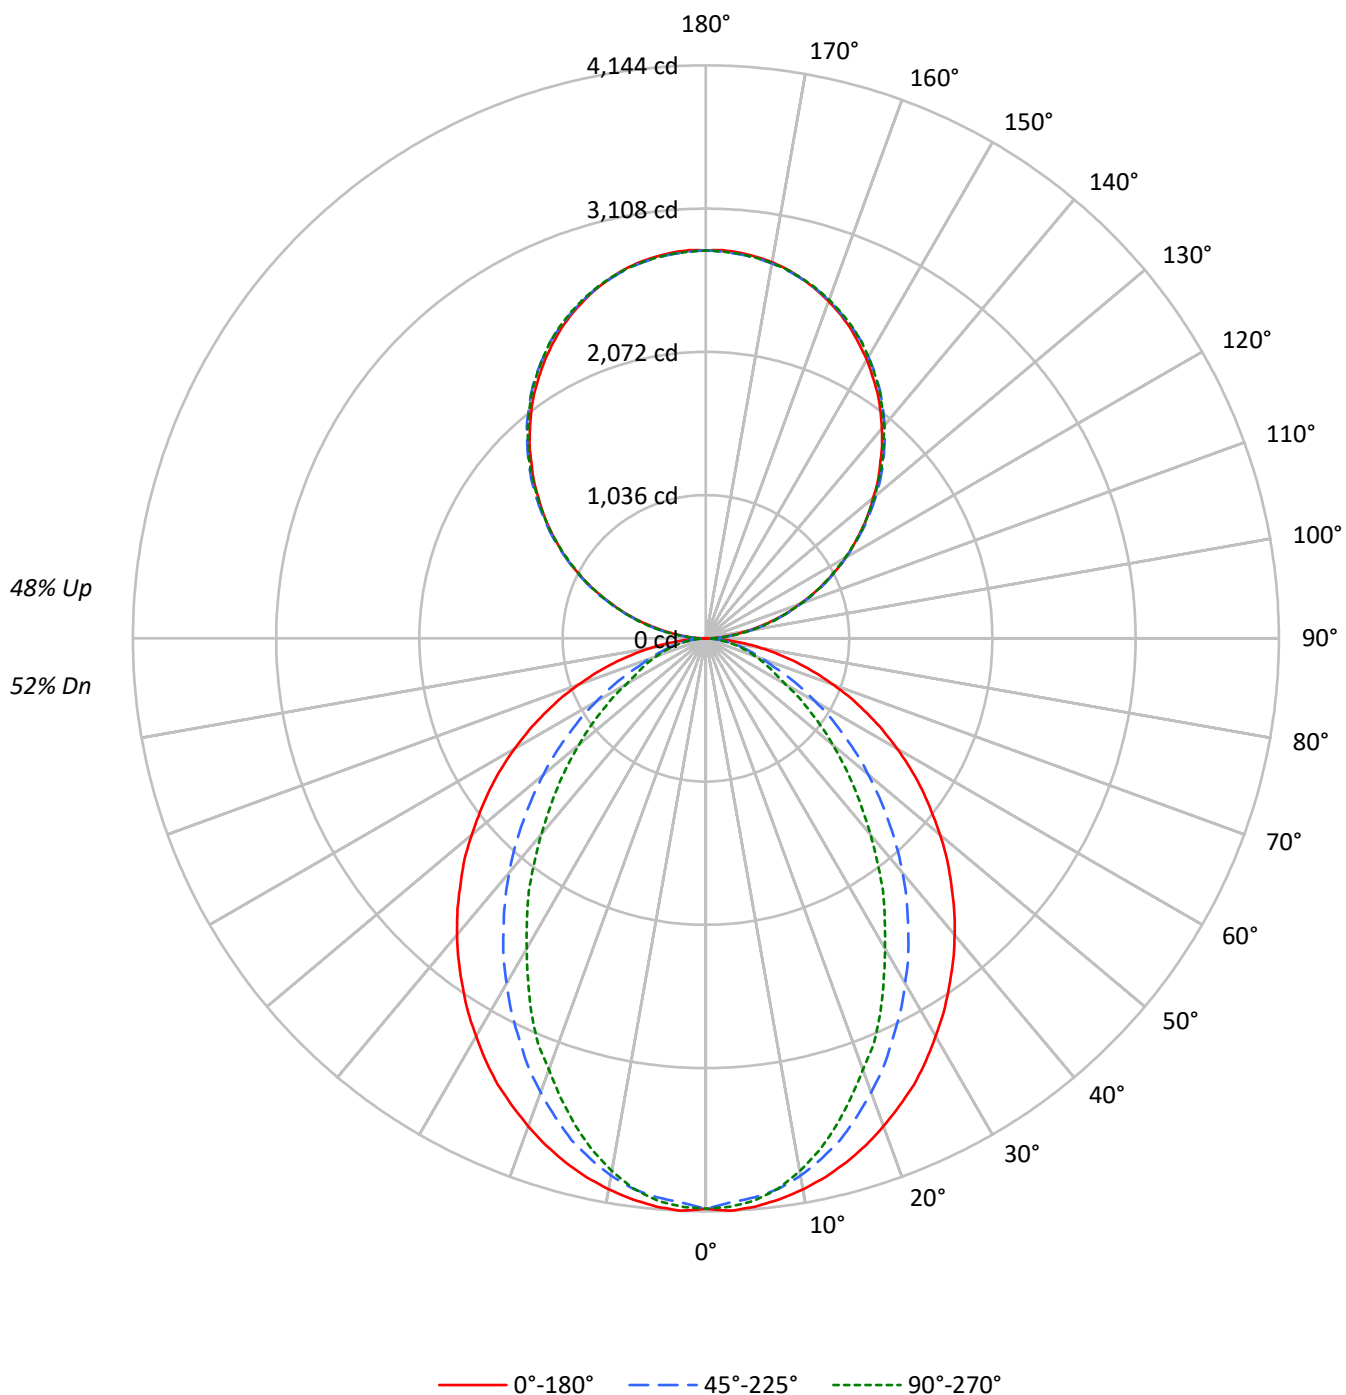

TEST NUMBER: P911994

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	84	84	84	71	71	71	58	58	58
1	99	95	91	88	91	88	84	82	75	72	70	63	61	60	52	51	50
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	46	44	43
3	83	74	66	61	76	68	62	57	59	54	50	50	46	44	42	39	37
4	76	65	58	52	70	61	54	49	53	47	43	45	41	38	37	35	32
5	70	59	51	45	65	55	48	42	47	42	38	40	36	33	34	31	28
6	65	53	45	39	60	49	42	37	43	37	33	37	32	29	31	28	25
7	60	48	40	35	55	45	38	33	39	33	29	34	29	26	28	25	23
8	56	44	36	31	51	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	37	31	26	33	27	24	28	24	21	24	21	19
10	49	37	30	25	45	34	28	24	30	25	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4727	4727	4727
5°	4731	4648	4680
10°	4681	4554	4526
15°	4614	4401	4289
20°	4526	4190	3999
25°	4435	3955	3719
30°	4315	3714	3364
35°	4197	3455	3053
40°	4076	3188	2696
45°	3937	2891	2372
50°	3792	2593	2056
55°	3641	2274	1753
60°	3465	1941	1442
65°	3264	1602	1296
70°	3019	1287	1170
75°	2710	1128	1061
80°	2265	936	915
85°	1536	610	679

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3937 cd/sqm

TEST NUMBER: P911994

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	386.6	2.4
10°-20°	1061.3	6.5
20°-30°	1490.1	9.1
30°-40°	1624.3	9.9
40°-50°	1492.9	9.1
50°-60°	1172.4	7.2
60°-70°	763.1	4.7
70°-80°	392.8	2.4
80°-90°	108.3	0.7
90°-100°	173.6	1.1
100°-110°	551.7	3.4
110°-120°	944.1	5.8
120°-130°	1241.6	7.6
130°-140°	1393.7	8.5
140°-150°	1366.6	8.4
150°-160°	1146.4	7.0
160°-170°	760.3	4.7
170°-180°	265.7	1.6
0°-30°	2938.0	18.0
0°-40°	4562.3	27.9
0°-60°	7227.6	44.2
0°-90°	8491.9	52.0
90°-120°	1669.4	10.2
90°-150°	5671.3	34.7
90°-180°	7844.0	48.0
0°-180°	16335.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4125	4125	4125	4125	4125	
5°	4125	4106	4058	4091	4080	391
15°	3924	3882	3756	3685	3648	1106
25°	3562	3442	3196	3043	2986	1638
35°	3069	2878	2550	2315	2232	1921
45°	2509	2258	1867	1601	1512	1937
55°	1908	1616	1213	989	918	1705
65°	1288	986	650	523	511	1277
75°	687	425	299	272	269	726
85°	160	82	71	71	71	184
90°	3	30	83	78	80	16
95°	124	147	151	151	147	137
105°	509	516	521	525	525	537
115°	947	961	957	954	947	937
125°	1378	1399	1392	1385	1382	1231
135°	1782	1809	1814	1811	1804	1378
145°	2164	2181	2194	2197	2188	1352
155°	2474	2481	2489	2500	2493	1139
165°	2692	2689	2689	2706	2694	759
175°	2801	2794	2789	2806	2792	266
180°	2806	2806	2806	2806	2806	

TEST NUMBER: P911994

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4125.1	4125.1	4125.1	4125.1	4125.1
2.5°	4143.8	4125.1	4083.9	4121.6	4114.1
5°	4125.1	4106.5	4057.8	4091.4	4080.3
7.5°	4091.4	4069.3	4017.0	4031.7	4013.0
10°	4046.7	4020.6	3946.2	3934.6	3912.4
12.5°	3990.8	3957.2	3856.2	3834.0	3792.8
15°	3923.5	3882.4	3755.6	3684.7	3647.5
17.5°	3845.1	3785.3	3628.4	3546.5	3486.7
20°	3755.6	3680.8	3494.1	3401.1	3318.7
22.5°	3658.6	3572.6	3355.9	3229.2	3173.4
25°	3561.6	3441.9	3195.6	3042.7	2986.4
27.5°	3445.9	3318.7	3046.2	2870.8	2784.8
30°	3322.7	3180.5	2881.8	2691.8	2590.7
32.5°	3203.0	3031.1	2725.4	2501.2	2407.7
35°	3068.8	2878.3	2549.9	2314.7	2232.3
37.5°	2938.1	2732.6	2385.6	2127.7	2034.7
40°	2799.9	2576.1	2213.7	1948.7	1851.7
42.5°	2658.1	2419.3	2042.1	1765.7	1672.6
45°	2508.8	2258.5	1866.7	1601.3	1511.8
47.5°	2366.9	2102.0	1698.8	1433.4	1351.4
50°	2210.1	1945.1	1534.4	1276.6	1198.5
52.5°	2056.9	1776.8	1377.6	1131.2	1060.3
55°	1907.5	1616.4	1213.1	989.4	918.5
57.5°	1754.7	1456.0	1067.9	858.7	798.9
60°	1597.7	1299.1	914.6	724.4	664.6
62.5°	1444.9	1146.3	783.8	604.8	575.1
65°	1288.0	985.5	649.5	522.8	511.4
67.5°	1138.7	836.1	522.8	459.0	447.9
70°	981.9	690.8	433.0	395.7	380.6
72.5°	832.5	556.1	362.0	332.3	324.8
75°	686.8	425.4	298.7	272.5	268.9
77.5°	541.4	302.2	235.2	220.2	212.7
80°	406.8	216.7	179.0	164.4	164.4
82.5°	283.6	145.7	123.2	115.7	115.7
85°	160.4	82.0	70.9	70.9	70.9
87.5°	59.8	29.7	29.7	26.2	26.2
90°	2.6	30.5	83.0	77.9	80.4
92.5°	52.5	71.1	73.6	76.1	76.1
95°	123.5	147.2	151.4	151.4	147.2
97.5°	205.6	227.6	236.9	236.9	236.9
100°	300.3	319.7	326.5	326.5	323.9
102.5°	400.1	414.5	423.7	426.3	423.7
105°	509.3	516.0	521.1	525.3	525.3
107.5°	617.5	627.7	627.7	629.4	617.5
110°	722.4	735.9	735.9	735.9	729.2



TEST NUMBER: P911994

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	835.7	850.2	847.6	840.8	835.7
115°	947.4	960.9	956.7	954.2	947.4
117.5°	1058.2	1076.8	1065.0	1058.2	1051.4
120°	1169.9	1188.5	1169.9	1169.9	1162.2
122.5°	1271.4	1295.1	1283.2	1276.5	1271.4
125°	1377.9	1399.1	1392.3	1384.7	1382.3
127.5°	1482.1	1508.2	1498.9	1488.8	1482.1
130°	1579.3	1609.7	1605.5	1600.5	1591.2
132.5°	1688.5	1712.1	1713.8	1702.0	1695.2
135°	1782.3	1808.6	1813.7	1811.1	1804.3
137.5°	1887.2	1908.4	1912.6	1910.9	1900.7
140°	1979.5	2000.5	2012.4	2012.4	2003.1
142.5°	2074.2	2095.3	2102.1	2104.7	2095.3
145°	2163.9	2180.7	2194.3	2196.8	2187.5
147.5°	2244.2	2265.4	2275.4	2279.8	2270.5
150°	2327.1	2341.4	2350.7	2358.4	2350.7
152.5°	2400.7	2415.1	2426.9	2436.3	2426.9
155°	2474.3	2481.1	2488.7	2500.5	2492.9
157.5°	2537.7	2542.8	2547.0	2563.9	2552.1
160°	2594.4	2599.5	2602.0	2616.4	2606.3
162.5°	2646.9	2646.9	2649.4	2665.5	2653.6
165°	2691.7	2689.1	2689.1	2706.1	2694.2
167.5°	2732.2	2724.7	2724.7	2741.6	2729.7
170°	2762.7	2756.0	2753.4	2770.4	2756.0
172.5°	2783.9	2777.2	2774.6	2791.5	2777.2
175°	2800.8	2794.0	2788.9	2805.9	2791.5
177.5°	2810.1	2803.3	2798.2	2812.6	2798.2
180°	2805.9	2805.9	2805.9	2805.9	2805.9

TEST NUMBER: P911994

CATALOG NUMBER: DFN2DIP-SQ3F0-090D080US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.69	13.54	13.64	14.50	15.74	8.65	9.50	9.60	10.46	11.70
	3H	14.37	15.12	15.32	16.09	17.36	9.84	10.59	10.79	11.56	12.83
	4H	14.97	15.69	15.94	16.66	17.94	10.28	11.00	11.25	11.97	13.25
	6H	15.39	16.05	16.37	17.03	18.32	10.60	11.26	11.58	12.23	13.52
	8H	15.52	16.14	16.51	17.14	18.42	10.69	11.31	11.68	12.31	13.59
	12H	15.58	16.17	16.57	17.16	18.47	10.73	11.32	11.72	12.31	13.62
4H	2H	12.71	13.43	13.69	14.40	15.67	9.25	9.96	10.23	10.93	12.21
	3H	14.54	15.13	15.52	16.13	17.42	10.59	11.19	11.58	12.19	13.48
	4H	15.22	15.77	16.22	16.76	18.08	11.13	11.68	12.13	12.67	13.99
	6H	15.74	16.20	16.74	17.22	18.53	11.55	12.01	12.56	13.03	14.35
	8H	15.91	16.34	16.92	17.36	18.68	11.67	12.11	12.68	13.12	14.45
	12H	16.00	16.40	17.03	17.42	18.75	11.74	12.13	12.76	13.16	14.49
8H	4H	15.19	15.63	16.20	16.64	17.97	11.41	11.85	12.42	12.86	14.19
	6H	15.75	16.11	16.79	17.17	18.49	11.92	12.28	12.96	13.34	14.66
	8H	15.97	16.28	17.01	17.32	18.67	12.11	12.43	13.15	13.47	14.81
	12H	16.10	16.38	17.15	17.41	18.80	12.22	12.50	13.27	13.54	14.92
12H	4H	15.14	15.54	16.17	16.56	17.90	11.42	11.81	12.44	12.84	14.17
	6H	15.73	16.05	16.77	17.08	18.43	11.97	12.29	13.01	13.33	14.67
	8H	15.95	16.22	16.99	17.26	18.65	12.18	12.46	13.22	13.49	14.88

END OF REPORT