

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912007

Luminaire Tested: DFN2DIP-SQ3F0-090D110US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912007
REPORT IS A COMBINATION OF REPORTS P901518 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D110US850-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20560.9 lumens
Efficiency: N/A
Efficacy: 118.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 173.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912007

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US850-RLLONL

Luminous Intensity Polar Plot

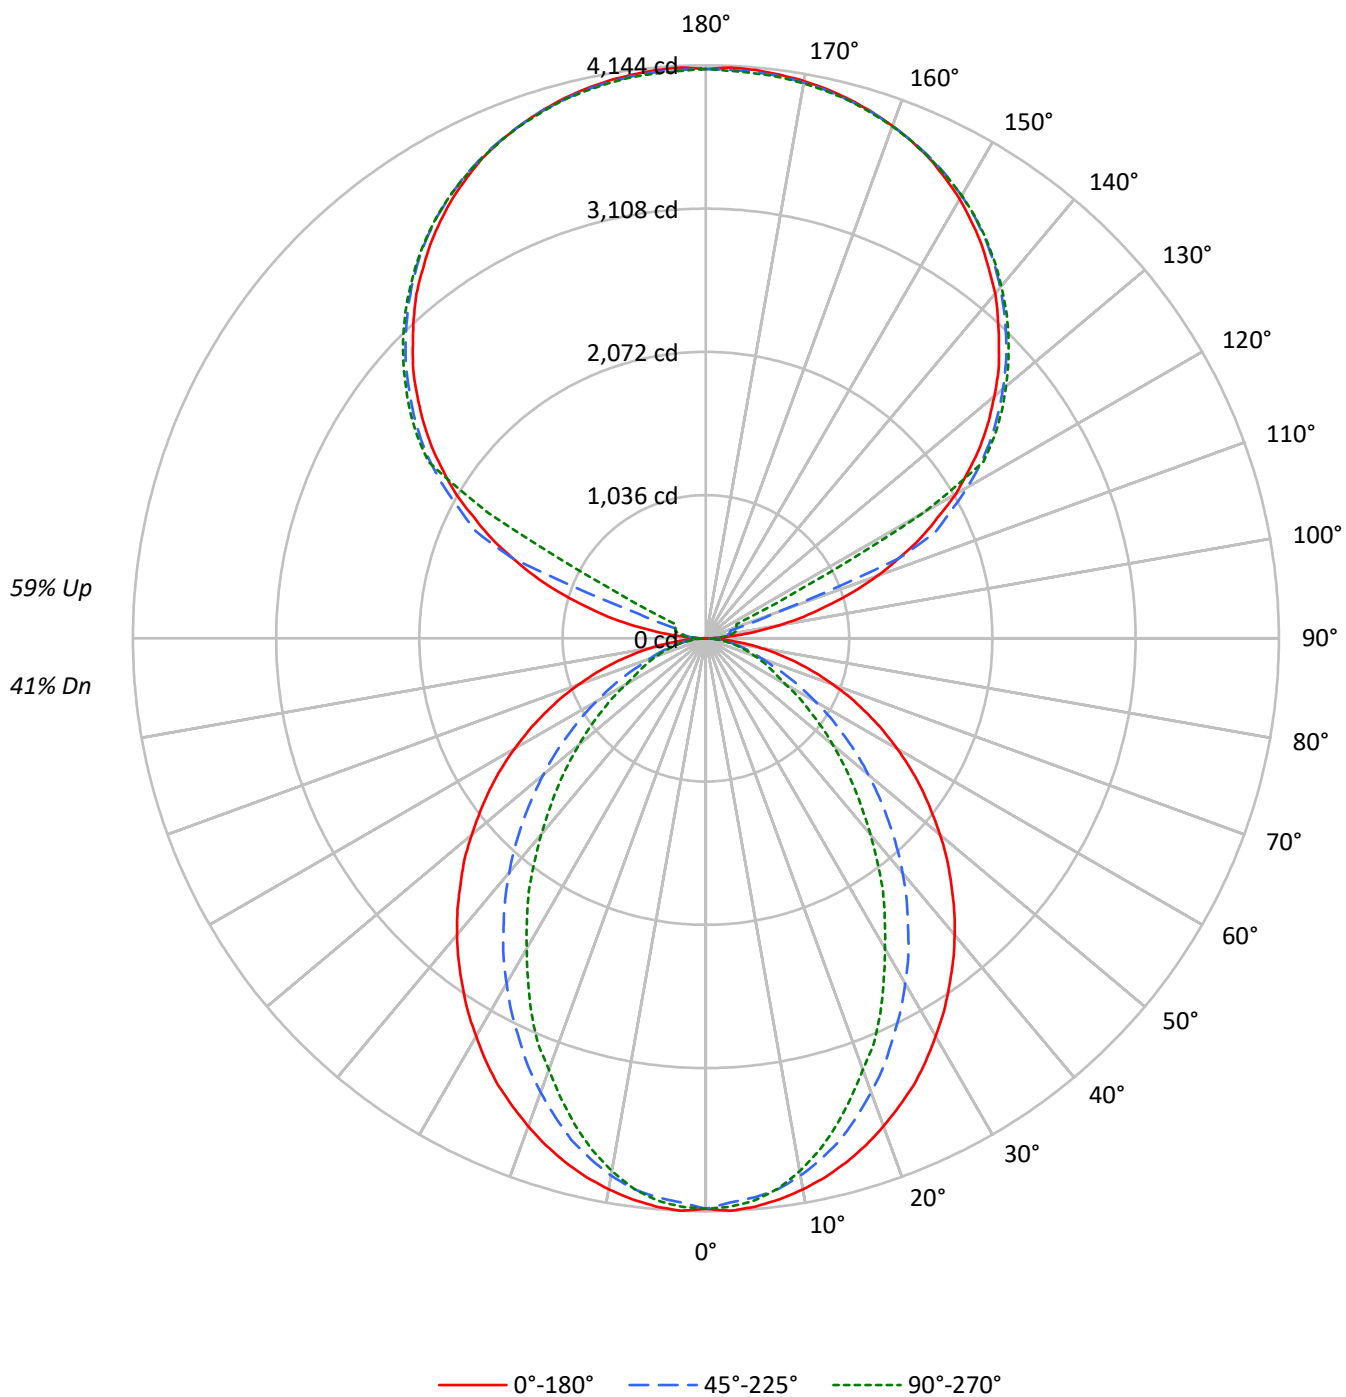

TEST NUMBER: P912007

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	58	55	49	47	45	38	37	35
3	80	71	64	59	73	65	59	55	54	50	46	44	41	38	34	32	31
4	74	63	56	50	67	58	52	47	48	44	40	39	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	38	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	28	26	26	23	21
7	58	46	38	33	53	42	36	31	36	31	27	29	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4727	4727	4727
5°	4731	4648	4680
10°	4681	4554	4526
15°	4614	4401	4289
20°	4526	4190	3999
25°	4435	3955	3719
30°	4315	3714	3364
35°	4197	3455	3053
40°	4076	3188	2696
45°	3937	2891	2372
50°	3792	2593	2056
55°	3641	2274	1753
60°	3465	1941	1442
65°	3264	1602	1296
70°	3019	1287	1170
75°	2710	1128	1061
80°	2265	936	915
85°	1536	610	679

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3937 cd/sqm

TEST NUMBER: P912007

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	386.6	1.9
10°-20°	1061.3	5.2
20°-30°	1490.1	7.2
30°-40°	1624.3	7.9
40°-50°	1492.9	7.3
50°-60°	1172.4	5.7
60°-70°	763.1	3.7
70°-80°	392.8	1.9
80°-90°	107.5	0.5
90°-100°	135.7	0.7
100°-110°	506.1	2.5
110°-120°	1342.2	6.5
120°-130°	2226.1	10.8
130°-140°	2364.7	11.5
140°-150°	2197.7	10.7
150°-160°	1766.9	8.6
160°-170°	1138.5	5.5
170°-180°	391.9	1.9
0°-30°	2938.0	14.3
0°-40°	4562.3	22.2
0°-60°	7227.6	35.2
0°-90°	8491.1	41.3
90°-120°	1984.0	9.6
90°-150°	8772.5	42.7
90°-180°	12070.0	58.7
0°-180°	20560.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4125	4125	4125	4125	4125	
5°	4125	4106	4058	4091	4080	391
15°	3924	3882	3756	3685	3648	1106
25°	3562	3442	3196	3043	2986	1638
35°	3069	2878	2550	2315	2232	1921
45°	2509	2258	1867	1601	1512	1937
55°	1908	1616	1213	989	918	1705
65°	1288	986	650	523	511	1277
75°	687	425	299	272	269	726
85°	160	82	71	71	71	184
90°	3	36	59	75	80	19
95°	194	95	116	131	128	229
105°	906	995	182	214	226	968
115°	1713	1763	1838	459	244	1686
125°	2422	2461	2517	2538	2547	2160
135°	2997	3045	3071	3101	3095	2315
145°	3477	3474	3524	3545	3530	2174
155°	3828	3801	3837	3855	3831	1764
165°	4034	4016	4025	4046	4025	1140
175°	4126	4105	4111	4132	4102	393
180°	4117	4117	4117	4117	4117	

TEST NUMBER: P912007

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4125.1	4125.1	4125.1	4125.1	4125.1
2.5°	4143.8	4125.1	4083.9	4121.6	4114.1
5°	4125.1	4106.5	4057.8	4091.4	4080.3
7.5°	4091.4	4069.3	4017.0	4031.7	4013.0
10°	4046.7	4020.6	3946.2	3934.6	3912.4
12.5°	3990.8	3957.2	3856.2	3834.0	3792.8
15°	3923.5	3882.4	3755.6	3684.7	3647.5
17.5°	3845.1	3785.3	3628.4	3546.5	3486.7
20°	3755.6	3680.8	3494.1	3401.1	3318.7
22.5°	3658.6	3572.6	3355.9	3229.2	3173.4
25°	3561.6	3441.9	3195.6	3042.7	2986.4
27.5°	3445.9	3318.7	3046.2	2870.8	2784.8
30°	3322.7	3180.5	2881.8	2691.8	2590.7
32.5°	3203.0	3031.1	2725.4	2501.2	2407.7
35°	3068.8	2878.3	2549.9	2314.7	2232.3
37.5°	2938.1	2732.6	2385.6	2127.7	2034.7
40°	2799.9	2576.1	2213.7	1948.7	1851.7
42.5°	2658.1	2419.3	2042.1	1765.7	1672.6
45°	2508.8	2258.5	1866.7	1601.3	1511.8
47.5°	2366.9	2102.0	1698.8	1433.4	1351.4
50°	2210.1	1945.1	1534.4	1276.6	1198.5
52.5°	2056.9	1776.8	1377.6	1131.2	1060.3
55°	1907.5	1616.4	1213.1	989.4	918.5
57.5°	1754.7	1456.0	1067.9	858.7	798.9
60°	1597.7	1299.1	914.6	724.4	664.6
62.5°	1444.9	1146.3	783.8	604.8	575.1
65°	1288.0	985.5	649.5	522.8	511.4
67.5°	1138.7	836.1	522.8	459.0	447.9
70°	981.9	690.8	433.0	395.7	380.6
72.5°	832.5	556.1	362.0	332.3	324.8
75°	686.8	425.4	298.7	272.5	268.9
77.5°	541.4	302.2	235.2	220.2	212.7
80°	406.8	216.7	179.0	164.4	164.4
82.5°	283.6	145.7	123.2	115.7	115.7
85°	160.4	82.0	70.9	70.9	70.9
87.5°	59.8	29.7	29.7	26.2	26.2
90°	2.9	35.7	59.4	74.6	80.3
92.5°	74.6	62.7	71.4	77.5	80.3
95°	193.5	95.2	116.0	131.2	128.1
97.5°	348.4	104.4	151.7	160.9	163.8
100°	527.4	119.2	169.8	193.5	199.5
102.5°	723.7	718.1	175.8	208.4	217.6
105°	905.6	995.1	181.9	214.4	226.5
107.5°	1117.2	1191.4	187.9	220.4	232.4
110°	1319.8	1382.1	521.5	223.6	235.2

TEST NUMBER: P912007

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1510.6	1563.9	1513.3	229.2	238.4
115°	1712.9	1763.4	1838.2	458.8	244.4
117.5°	1888.7	1948.2	1999.1	1572.8	792.4
120°	2085.4	2129.9	2183.7	2219.4	1817.2
122.5°	2252.0	2299.7	2359.5	2377.3	2380.5
125°	2421.8	2460.8	2517.3	2538.2	2547.0
127.5°	2576.8	2618.5	2663.4	2693.1	2696.0
130°	2722.8	2770.6	2803.1	2836.0	2833.3
132.5°	2871.8	2910.7	2943.3	2970.1	2967.4
135°	2997.1	3044.8	3071.3	3101.4	3095.3
137.5°	3127.9	3163.6	3193.7	3223.4	3214.5
140°	3256.0	3280.0	3312.6	3339.4	3324.6
142.5°	3363.5	3384.3	3422.9	3446.7	3431.8
145°	3476.7	3473.5	3524.1	3545.0	3530.2
147.5°	3574.8	3565.9	3616.4	3631.3	3619.7
150°	3670.2	3649.4	3697.1	3714.8	3700.0
152.5°	3750.5	3726.8	3771.4	3789.5	3768.6
155°	3828.0	3801.4	3837.1	3854.9	3831.2
157.5°	3890.6	3866.9	3893.8	3914.7	3890.6
160°	3944.4	3926.3	3944.4	3962.0	3941.2
162.5°	3991.7	3974.1	3989.0	4009.8	3983.0
165°	4033.5	4015.8	4024.7	4045.5	4024.7
167.5°	4066.4	4048.4	4057.6	4078.5	4051.6
170°	4093.3	4075.2	4081.2	4102.2	4075.2
172.5°	4111.0	4093.3	4099.3	4120.2	4093.3
175°	4125.8	4105.0	4111.0	4131.9	4102.2
177.5°	4131.9	4111.0	4114.2	4135.0	4108.2
180°	4117.1	4117.1	4117.1	4117.1	4117.1

TEST NUMBER: P912007

CATALOG NUMBER: DFN2DIP-SQ3F0-090D110US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.64	12.40	12.67	13.44	14.83	7.60	8.36	8.63	9.40	10.79
	3H	13.31	13.99	14.35	15.04	16.45	8.78	9.46	9.82	10.51	11.92
	4H	13.91	14.56	14.97	15.60	17.02	9.22	9.87	10.28	10.91	12.33
	6H	14.32	14.92	15.39	15.97	17.40	9.53	10.13	10.60	11.18	12.61
	8H	14.45	15.01	15.52	16.08	17.51	9.62	10.18	10.69	11.25	12.68
	12H	14.50	15.04	15.58	16.10	17.55	9.66	10.19	10.73	11.25	12.70
4H	2H	11.65	12.29	12.71	13.34	14.76	8.18	8.83	9.25	9.88	11.30
	3H	13.47	14.00	14.54	15.08	16.51	9.52	10.06	10.59	11.14	12.57
	4H	14.15	14.64	15.23	15.71	17.16	10.06	10.55	11.14	11.62	13.07
	6H	14.66	15.08	15.74	16.17	17.62	10.47	10.89	11.55	11.98	13.43
	8H	14.83	15.22	15.91	16.31	17.77	10.59	10.99	11.68	12.07	13.53
	12H	14.92	15.27	16.02	16.37	17.84	10.65	11.01	11.75	12.10	13.57
8H	4H	14.11	14.51	15.20	15.59	17.05	10.33	10.73	11.42	11.81	13.27
	6H	14.67	15.00	15.78	16.12	17.58	10.84	11.17	11.95	12.29	13.75
	8H	14.88	15.17	16.00	16.28	17.76	11.03	11.31	12.14	12.42	13.90
	12H	15.02	15.27	16.13	16.37	17.89	11.14	11.39	12.25	12.49	14.01
12H	4H	14.06	14.42	15.16	15.51	16.98	10.33	10.69	11.44	11.79	13.26
	6H	14.65	14.93	15.76	16.04	17.52	10.89	11.17	12.00	12.28	13.76
	8H	14.86	15.11	15.98	16.21	17.73	11.09	11.34	12.21	12.44	13.96

END OF REPORT