

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912024

Luminaire Tested: DFN2DIP-SQ3F0-100D070US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912024
REPORT IS A COMBINATION OF REPORTS P899927 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D070US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17849.4 lumens
Efficiency: N/A
Efficacy: 118.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 151
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912024

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US850-FLLFLL

Luminous Intensity Polar Plot

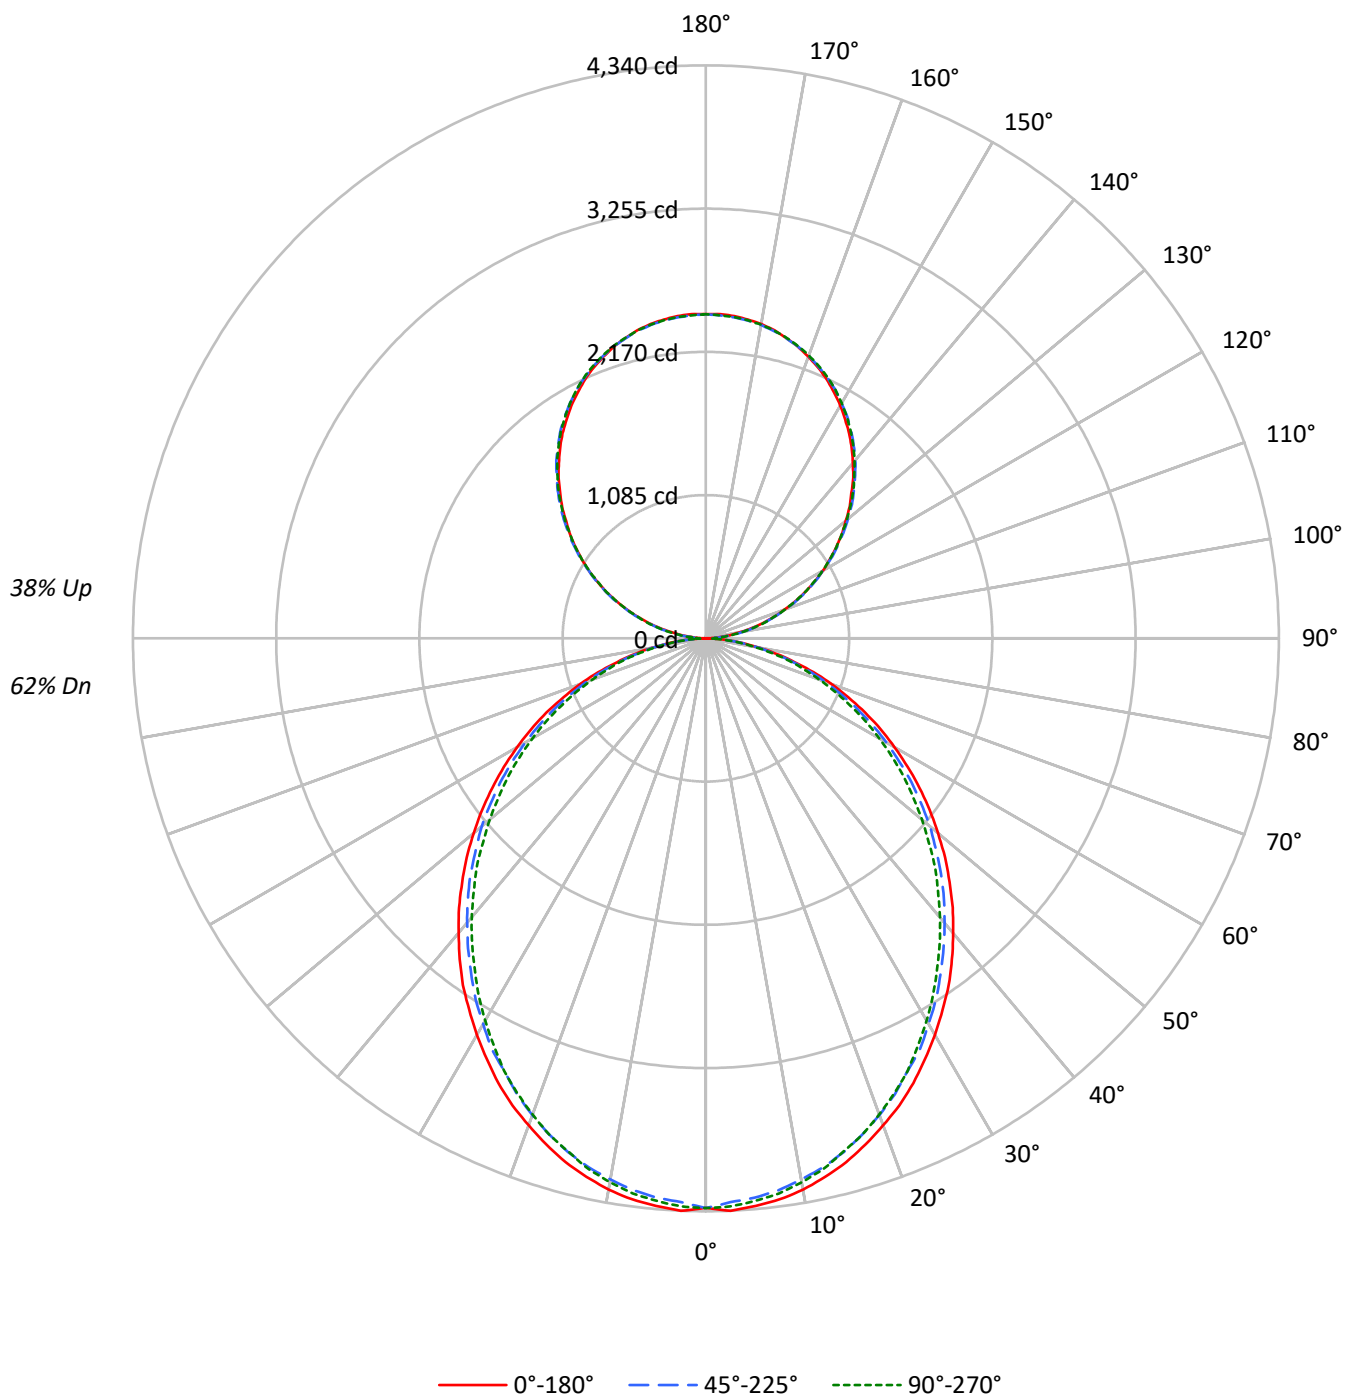

TEST NUMBER: P912024

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	100	96	92	88	94	90	87	83	79	76	74	68	67	65	59	58	56
2	91	84	78	72	85	79	73	68	69	65	61	60	57	54	52	50	48
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	49	43	38	43	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	39	34	30	34	30	27
7	60	47	39	34	56	45	37	32	40	34	29	35	30	27	31	27	24
8	56	43	35	30	52	41	34	29	36	30	26	32	27	24	28	24	21
9	52	39	32	27	49	37	30	26	33	28	23	30	25	21	26	22	19
10	49	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4944	4944	4944
5°	4949	4872	4907
10°	4906	4803	4839
15°	4831	4721	4733
20°	4730	4608	4625
25°	4630	4473	4501
30°	4505	4348	4343
35°	4386	4200	4176
40°	4241	4051	4017
45°	4096	3901	3855
50°	3937	3744	3667
55°	3770	3562	3493
60°	3582	3346	3294
65°	3375	3123	3060
70°	3113	2850	2807
75°	2750	2522	2571
80°	2311	2104	2125
85°	1627	1394	1391

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4096 cd/sqm

TEST NUMBER: P912024

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.1	2.3
10°-20°	1142.7	6.4
20°-30°	1679.4	9.4
30°-40°	1950.5	10.9
40°-50°	1948.1	10.9
50°-60°	1698.7	9.5
60°-70°	1255.7	7.0
70°-80°	710.4	4.0
80°-90°	194.5	1.1
90°-100°	151.9	0.9
100°-110°	482.7	2.7
110°-120°	826.1	4.6
120°-130°	1086.4	6.1
130°-140°	1219.5	6.8
140°-150°	1195.8	6.7
150°-160°	1003.1	5.6
160°-170°	665.3	3.7
170°-180°	232.5	1.3
0°-30°	3228.3	18.1
0°-40°	5178.7	29.0
0°-60°	8825.5	49.4
0°-90°	10986.1	61.5
90°-120°	1460.7	8.2
90°-150°	4962.4	27.8
90°-180°	6863.0	38.4
0°-180°	17849.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2518	2473	2456	2014
55°	1975	1950	1900	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	2	27	72	68	70	17
95°	108	129	132	132	129	120
105°	446	452	456	460	460	470
115°	829	841	837	835	829	820
125°	1206	1224	1218	1212	1210	1077
135°	1560	1582	1587	1585	1579	1205
145°	1893	1908	1920	1922	1914	1183
155°	2165	2171	2178	2188	2181	997
165°	2355	2353	2353	2368	2357	664
175°	2451	2445	2440	2455	2443	233
180°	2455	2455	2455	2455	2455	

TEST NUMBER: P912024

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.2	4315.2	4315.2	4315.2	4315.2
2.5°	4340.3	4319.6	4273.8	4315.2	4307.2
5°	4315.2	4298.9	4253.1	4286.2	4278.2
7.5°	4286.2	4261.4	4215.6	4249.1	4240.8
10°	4240.8	4211.8	4162.0	4195.0	4182.7
12.5°	4178.3	4153.6	4103.9	4124.6	4116.2
15°	4107.8	4083.2	4029.0	4045.7	4025.1
17.5°	4020.7	3996.1	3941.8	3962.6	3941.8
20°	3925.1	3900.5	3842.4	3854.7	3838.4
22.5°	3830.0	3792.7	3738.4	3738.4	3730.1
25°	3717.8	3684.8	3614.3	3622.2	3614.3
27.5°	3593.2	3564.1	3510.4	3498.1	3477.4
30°	3469.1	3435.6	3373.5	3361.2	3344.4
32.5°	3336.1	3311.5	3244.9	3219.9	3203.1
35°	3207.6	3166.2	3099.7	3074.6	3053.9
37.5°	3062.3	3024.8	2958.4	2929.3	2908.6
40°	2913.0	2879.5	2813.1	2776.2	2759.4
42.5°	2767.7	2734.2	2668.3	2626.4	2601.8
45°	2610.1	2581.1	2518.5	2473.2	2456.5
47.5°	2456.5	2427.5	2361.0	2315.1	2290.5
50°	2294.5	2273.8	2215.7	2157.6	2136.9
52.5°	2136.9	2107.9	2054.1	2008.4	1979.3
55°	1975.4	1950.3	1900.5	1850.7	1830.1
57.5°	1813.3	1792.6	1738.5	1688.8	1672.0
60°	1651.3	1635.0	1576.9	1531.1	1518.8
62.5°	1493.7	1464.7	1423.3	1381.9	1365.2
65°	1332.1	1307.1	1265.7	1228.2	1207.6
67.5°	1166.2	1145.0	1108.1	1079.1	1062.3
70°	1012.5	995.8	958.4	929.3	913.0
72.5°	854.9	838.2	817.6	788.5	776.1
75°	696.9	689.0	667.8	643.2	651.5
77.5°	556.1	539.3	530.9	518.6	506.3
80°	415.1	410.8	402.3	390.0	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.3	145.3
87.5°	74.9	66.4	58.1	45.8	41.4
90°	2.2	26.6	72.5	68.1	70.3
92.5°	45.9	62.2	64.4	66.7	66.7
95°	108.0	128.8	132.5	132.5	128.8
97.5°	179.9	199.1	207.3	207.3	207.3
100°	262.7	279.8	285.7	285.7	283.5
102.5°	350.1	362.6	370.8	373.1	370.8
105°	445.6	451.5	455.9	459.7	459.7
107.5°	540.3	549.2	549.2	550.7	540.3
110°	632.1	644.0	644.0	644.0	638.0

TEST NUMBER: P912024

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	731.3	743.9	741.7	735.7	731.3
115°	829.0	840.8	837.2	835.0	829.0
117.5°	925.9	942.2	931.9	925.9	920.0
120°	1023.6	1039.9	1023.6	1023.6	1017.0
122.5°	1112.4	1133.2	1122.9	1116.9	1112.4
125°	1205.7	1224.2	1218.3	1211.7	1209.5
127.5°	1296.8	1319.7	1311.6	1302.7	1296.8
130°	1381.9	1408.5	1404.9	1400.4	1392.2
132.5°	1477.4	1498.1	1499.6	1489.3	1483.3
135°	1559.6	1582.4	1587.0	1584.7	1578.8
137.5°	1651.3	1669.8	1673.5	1672.0	1663.2
140°	1732.0	1750.6	1760.9	1760.9	1752.8
142.5°	1814.9	1833.4	1839.3	1841.5	1833.4
145°	1893.4	1908.1	1920.0	1922.2	1914.1
147.5°	1963.7	1982.2	1991.1	1994.8	1986.7
150°	2036.2	2048.8	2057.0	2063.6	2057.0
152.5°	2100.6	2113.2	2123.5	2131.7	2123.5
155°	2165.0	2170.9	2177.6	2187.9	2181.3
157.5°	2220.6	2225.0	2228.6	2243.5	2233.1
160°	2270.1	2274.6	2276.8	2289.3	2280.4
162.5°	2316.0	2316.0	2318.3	2332.2	2321.9
165°	2355.2	2353.0	2353.0	2367.8	2357.4
167.5°	2390.8	2384.1	2384.1	2398.9	2388.6
170°	2417.4	2411.5	2409.3	2424.1	2411.5
172.5°	2435.9	2429.9	2427.7	2442.6	2429.9
175°	2450.7	2444.8	2440.4	2455.1	2442.6
177.5°	2458.9	2452.9	2448.5	2461.1	2448.5
180°	2455.1	2455.1	2455.1	2455.1	2455.1

TEST NUMBER: P912024

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.79	14.77	14.64	15.64	16.74	13.35	14.32	14.20	15.20	16.29
	3H	15.46	16.33	16.32	17.21	18.34	14.97	15.84	15.83	16.72	17.85
	4H	16.05	16.87	16.93	17.76	18.90	15.55	16.38	16.43	17.27	18.40
	6H	16.45	17.21	17.34	18.11	19.25	15.95	16.71	16.84	17.61	18.75
	8H	16.55	17.28	17.45	18.20	19.34	16.05	16.78	16.95	17.69	18.84
	12H	16.61	17.30	17.51	18.21	19.38	16.10	16.79	17.00	17.70	18.87
4H	2H	14.26	15.09	15.15	15.98	17.11	13.91	14.74	14.79	15.62	16.76
	3H	16.13	16.82	17.03	17.75	18.89	15.73	16.42	16.62	17.34	18.49
	4H	16.85	17.48	17.76	18.40	19.57	16.42	17.06	17.33	17.97	19.15
	6H	17.37	17.91	18.29	18.85	20.03	16.93	17.48	17.86	18.42	19.59
	8H	17.52	18.02	18.44	18.96	20.15	17.08	17.59	18.00	18.52	19.71
	12H	17.59	18.05	18.54	19.00	20.20	17.14	17.60	18.09	18.56	19.75
8H	4H	17.05	17.56	17.97	18.49	19.68	16.67	17.18	17.60	18.12	19.31
	6H	17.68	18.10	18.63	19.08	20.27	17.30	17.72	18.25	18.69	19.88
	8H	17.90	18.27	18.86	19.24	20.44	17.51	17.88	18.47	18.85	20.05
	12H	18.03	18.36	19.00	19.32	20.58	17.62	17.95	18.59	18.91	20.16
12H	4H	17.04	17.50	17.98	18.45	19.65	16.67	17.13	17.62	18.08	19.28
	6H	17.71	18.08	18.67	19.05	20.26	17.34	17.71	18.30	18.68	19.88
	8H	17.95	18.28	18.92	19.24	20.50	17.57	17.90	18.54	18.86	20.12