

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912061

Luminaire Tested: DFN2DIP-SQ3F0-110D070US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912061
REPORT IS A COMBINATION OF REPORTS P901449 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D070US850-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19762.4 lumens
Efficiency: N/A
Efficacy: 120.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 164.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912061

CATALOG NUMBER: DFN2DIP-SQ3F0-110D070US850-FLLONL

Luminous Intensity Polar Plot

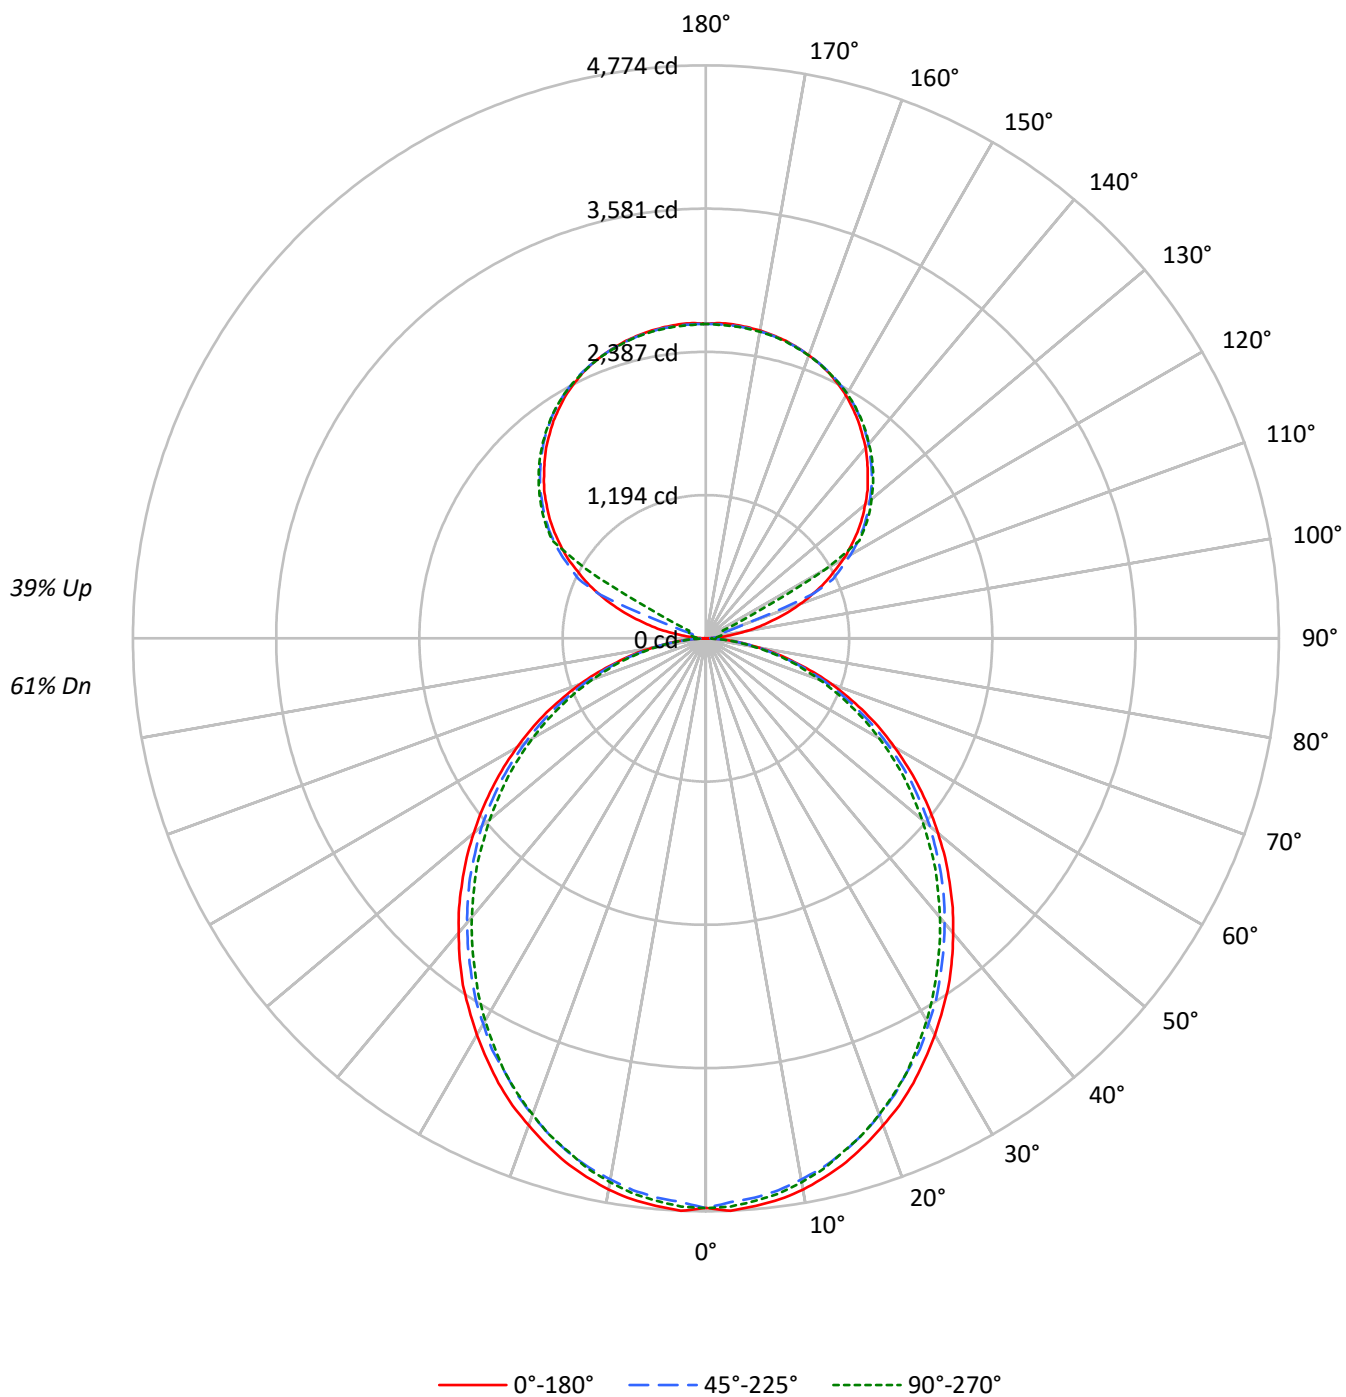

TEST NUMBER: P912061

CATALOG NUMBER: DFN2DIP-SQ3F0-110D070US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	77	77	77	66	66	66
1	100	96	92	88	94	90	86	83	79	76	74	68	66	65	59	57	56
2	91	84	77	72	85	79	73	68	69	65	61	60	57	54	52	49	47
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	48	42	38	42	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	38	34	30	34	30	27
7	60	47	39	33	56	45	37	32	40	34	29	35	30	26	31	27	24
8	56	43	35	30	52	41	33	28	36	30	26	32	27	24	28	24	21
9	52	39	32	27	48	37	30	25	33	27	23	30	25	21	26	22	19
10	48	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5439	5439	5439
5°	5444	5359	5397
10°	5396	5284	5322
15°	5314	5193	5207
20°	5203	5069	5088
25°	5093	4921	4951
30°	4955	4782	4777
35°	4825	4620	4594
40°	4665	4456	4419
45°	4506	4291	4240
50°	4331	4118	4033
55°	4147	3918	3842
60°	3940	3681	3624
65°	3713	3435	3366
70°	3424	3134	3088
75°	3025	2774	2828
80°	2543	2315	2338
85°	1791	1534	1530

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4506 cd/sqm

TEST NUMBER: P912061

CATALOG NUMBER: DFN2DIP-SQ3F0-110D070US850-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	446.8	2.3
10°-20°	1257.0	6.4
20°-30°	1847.3	9.3
30°-40°	2145.5	10.9
40°-50°	2142.9	10.8
50°-60°	1868.5	9.5
60°-70°	1381.3	7.0
70°-80°	781.5	4.0
80°-90°	210.9	1.1
90°-100°	86.4	0.4
100°-110°	322.1	1.6
110°-120°	854.1	4.3
120°-130°	1416.6	7.2
130°-140°	1504.8	7.6
140°-150°	1398.5	7.1
150°-160°	1124.4	5.7
160°-170°	724.5	3.7
170°-180°	249.4	1.3
0°-30°	3551.1	18.0
0°-40°	5696.6	28.8
0°-60°	9708.0	49.1
0°-90°	12081.6	61.1
90°-120°	1262.6	6.4
90°-150°	5582.5	28.2
90°-180°	7681.0	38.9
0°-180°	19762.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4747	4747	4747	4747	4747	
5°	4747	4729	4678	4715	4706	451
15°	4519	4491	4432	4450	4428	1273
25°	4090	4053	3976	3984	3976	1882
35°	3528	3483	3410	3382	3359	2203
45°	2871	2839	2770	2721	2702	2216
55°	2173	2145	2091	2036	2013	1943
65°	1465	1438	1392	1351	1328	1449
75°	766	758	735	708	717	818
85°	187	182	178	164	160	209
90°	2	23	38	48	51	18
95°	123	61	74	84	82	146
105°	576	633	116	136	144	616
115°	1090	1122	1170	292	156	1073
125°	1541	1566	1602	1615	1621	1375
135°	1907	1938	1954	1974	1970	1473
145°	2212	2210	2243	2256	2246	1384
155°	2436	2419	2442	2453	2438	1123
165°	2567	2556	2561	2574	2561	725
175°	2626	2612	2616	2629	2610	250
180°	2620	2620	2620	2620	2620	

TEST NUMBER: P912061

CATALOG NUMBER: DFN2DIP-SQ3F0-110D070US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4746.7	4746.7	4746.7	4746.7	4746.7
2.5°	4774.2	4751.5	4701.2	4746.7	4738.0
5°	4746.7	4728.8	4678.4	4714.7	4706.0
7.5°	4714.7	4687.6	4637.3	4674.1	4664.9
10°	4664.9	4632.8	4578.2	4614.4	4600.9
12.5°	4596.1	4569.0	4514.3	4537.0	4527.8
15°	4518.6	4491.4	4431.9	4450.3	4427.6
17.5°	4422.7	4395.6	4336.1	4358.8	4336.1
20°	4317.7	4290.5	4226.6	4240.2	4222.3
22.5°	4213.1	4171.8	4112.3	4112.3	4103.1
25°	4089.5	4053.3	3975.8	3984.5	3975.8
27.5°	3952.5	3920.5	3861.4	3847.9	3825.2
30°	3816.0	3779.1	3710.8	3697.3	3678.9
32.5°	3669.7	3642.6	3569.4	3541.8	3523.4
35°	3528.3	3482.8	3409.6	3382.0	3359.3
37.5°	3368.5	3327.3	3254.2	3222.2	3199.5
40°	3204.3	3167.5	3094.4	3053.7	3035.3
42.5°	3044.5	3007.7	2935.1	2889.1	2862.0
45°	2871.2	2839.2	2770.4	2720.6	2702.2
47.5°	2702.2	2670.3	2597.1	2546.7	2519.5
50°	2524.0	2501.2	2437.2	2373.4	2350.6
52.5°	2350.6	2318.6	2259.6	2209.1	2177.2
55°	2172.9	2145.2	2090.6	2035.8	2013.1
57.5°	1994.6	1971.9	1912.4	1857.6	1839.2
60°	1816.4	1798.6	1734.6	1684.2	1670.7
62.5°	1643.1	1611.2	1565.6	1520.1	1501.7
65°	1465.3	1437.7	1392.2	1351.1	1328.4
67.5°	1282.8	1259.6	1218.9	1187.0	1168.6
70°	1113.8	1095.4	1054.2	1022.3	1004.3
72.5°	940.4	922.0	899.3	867.3	853.7
75°	766.5	757.9	734.6	707.5	716.7
77.5°	611.6	593.2	584.0	570.5	556.9
80°	456.7	451.8	442.6	429.1	419.9
82.5°	310.4	310.4	306.1	287.7	287.7
85°	187.0	182.5	178.2	164.1	159.8
87.5°	82.3	73.1	63.9	50.3	45.5
90°	1.8	22.7	37.8	47.5	51.1
92.5°	47.5	39.8	45.5	49.4	51.1
95°	123.1	60.6	73.9	83.5	81.5
97.5°	221.7	66.4	96.6	102.5	104.2
100°	335.7	75.9	108.0	123.1	127.0
102.5°	460.6	457.0	111.9	132.6	138.4
105°	576.3	633.2	115.7	136.4	144.1
107.5°	710.9	758.2	119.6	140.3	147.9
110°	840.0	879.5	331.8	142.3	149.7

TEST NUMBER: P912061

CATALOG NUMBER: DFN2DIP-SQ3F0-110D070US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	961.3	995.2	963.1	145.8	151.7
115°	1090.0	1122.2	1169.7	292.0	155.6
117.5°	1201.9	1239.8	1272.1	1000.9	504.3
120°	1327.0	1355.4	1389.7	1412.4	1156.5
122.5°	1433.0	1463.4	1501.6	1512.8	1514.8
125°	1541.2	1565.9	1602.0	1615.3	1620.8
127.5°	1639.8	1666.3	1694.9	1713.8	1715.6
130°	1732.7	1763.1	1783.8	1804.8	1803.0
132.5°	1827.5	1852.3	1873.0	1890.1	1888.3
135°	1907.1	1937.5	1954.5	1973.6	1969.8
137.5°	1990.4	2013.3	2032.4	2051.3	2045.7
140°	2071.9	2087.2	2108.0	2125.1	2115.6
142.5°	2140.4	2153.7	2178.2	2193.3	2183.8
145°	2212.5	2210.5	2242.6	2255.9	2246.5
147.5°	2274.8	2269.2	2301.4	2310.8	2303.4
150°	2335.6	2322.4	2352.7	2363.9	2354.5
152.5°	2386.7	2371.6	2400.0	2411.4	2398.2
155°	2436.0	2419.1	2441.8	2453.1	2438.0
157.5°	2475.8	2460.8	2477.8	2491.1	2475.8
160°	2510.1	2498.6	2510.1	2521.3	2508.0
162.5°	2540.3	2529.0	2538.4	2551.7	2534.6
165°	2566.8	2555.6	2561.1	2574.4	2561.1
167.5°	2587.7	2576.2	2582.1	2595.4	2578.3
170°	2604.8	2593.4	2597.2	2610.5	2593.4
172.5°	2616.1	2604.8	2608.7	2621.9	2604.8
175°	2625.6	2612.2	2616.1	2629.3	2610.5
177.5°	2629.3	2616.1	2618.1	2631.4	2614.2
180°	2619.9	2619.9	2619.9	2619.9	2619.9

TEST NUMBER: P912061

CATALOG NUMBER: DFN2DIP-SQ3F0-110D070US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.09	15.06	14.95	15.94	17.04	13.65	14.62	14.50	15.49	16.60
	3H	15.75	16.63	16.62	17.51	18.64	15.26	16.14	16.13	17.02	18.15
	4H	16.34	17.17	17.23	18.06	19.20	15.85	16.67	16.73	17.57	18.71
	6H	16.75	17.51	17.64	18.41	19.56	16.25	17.01	17.14	17.91	19.06
	8H	16.85	17.58	17.76	18.49	19.64	16.35	17.07	17.25	17.99	19.14
	12H	16.90	17.59	17.81	18.50	19.68	16.39	17.08	17.30	17.99	19.17
4H	2H	14.56	15.38	15.45	16.28	17.42	14.21	15.03	15.09	15.92	17.06
	3H	16.43	17.12	17.33	18.04	19.20	16.02	16.71	16.92	17.64	18.79
	4H	17.15	17.77	18.06	18.69	19.87	16.72	17.35	17.63	18.27	19.45
	6H	17.66	18.20	18.59	19.15	20.33	17.23	17.77	18.16	18.72	19.90
	8H	17.81	18.32	18.74	19.26	20.45	17.38	17.88	18.30	18.82	20.02
	12H	17.89	18.35	18.84	19.30	20.50	17.44	17.90	18.39	18.85	20.05
8H	4H	17.35	17.85	18.28	18.79	19.99	16.97	17.48	17.90	18.41	19.61
	6H	17.98	18.40	18.93	19.38	20.57	17.59	18.01	18.55	18.99	20.19
	8H	18.20	18.57	19.16	19.54	20.75	17.80	18.17	18.77	19.14	20.36
	12H	18.33	18.66	19.30	19.62	20.88	17.92	18.24	18.89	19.21	20.47
12H	4H	17.34	17.79	18.28	18.75	19.95	16.97	17.43	17.92	18.38	19.58
	6H	18.01	18.38	18.97	19.35	20.56	17.63	18.01	18.60	18.98	20.19
	8H	18.25	18.58	19.22	19.54	20.80	17.87	18.20	18.84	19.16	20.42

END OF REPORT