

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912084

Luminaire Tested: DFN2DIP-SQ3F0-120D040US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912084
REPORT IS A COMBINATION OF REPORTS P899877 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D040US850-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17100.7 lumens
Efficiency: N/A
Efficacy: 109.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 156.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912084

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US850-FLLFLL

Luminous Intensity Polar Plot

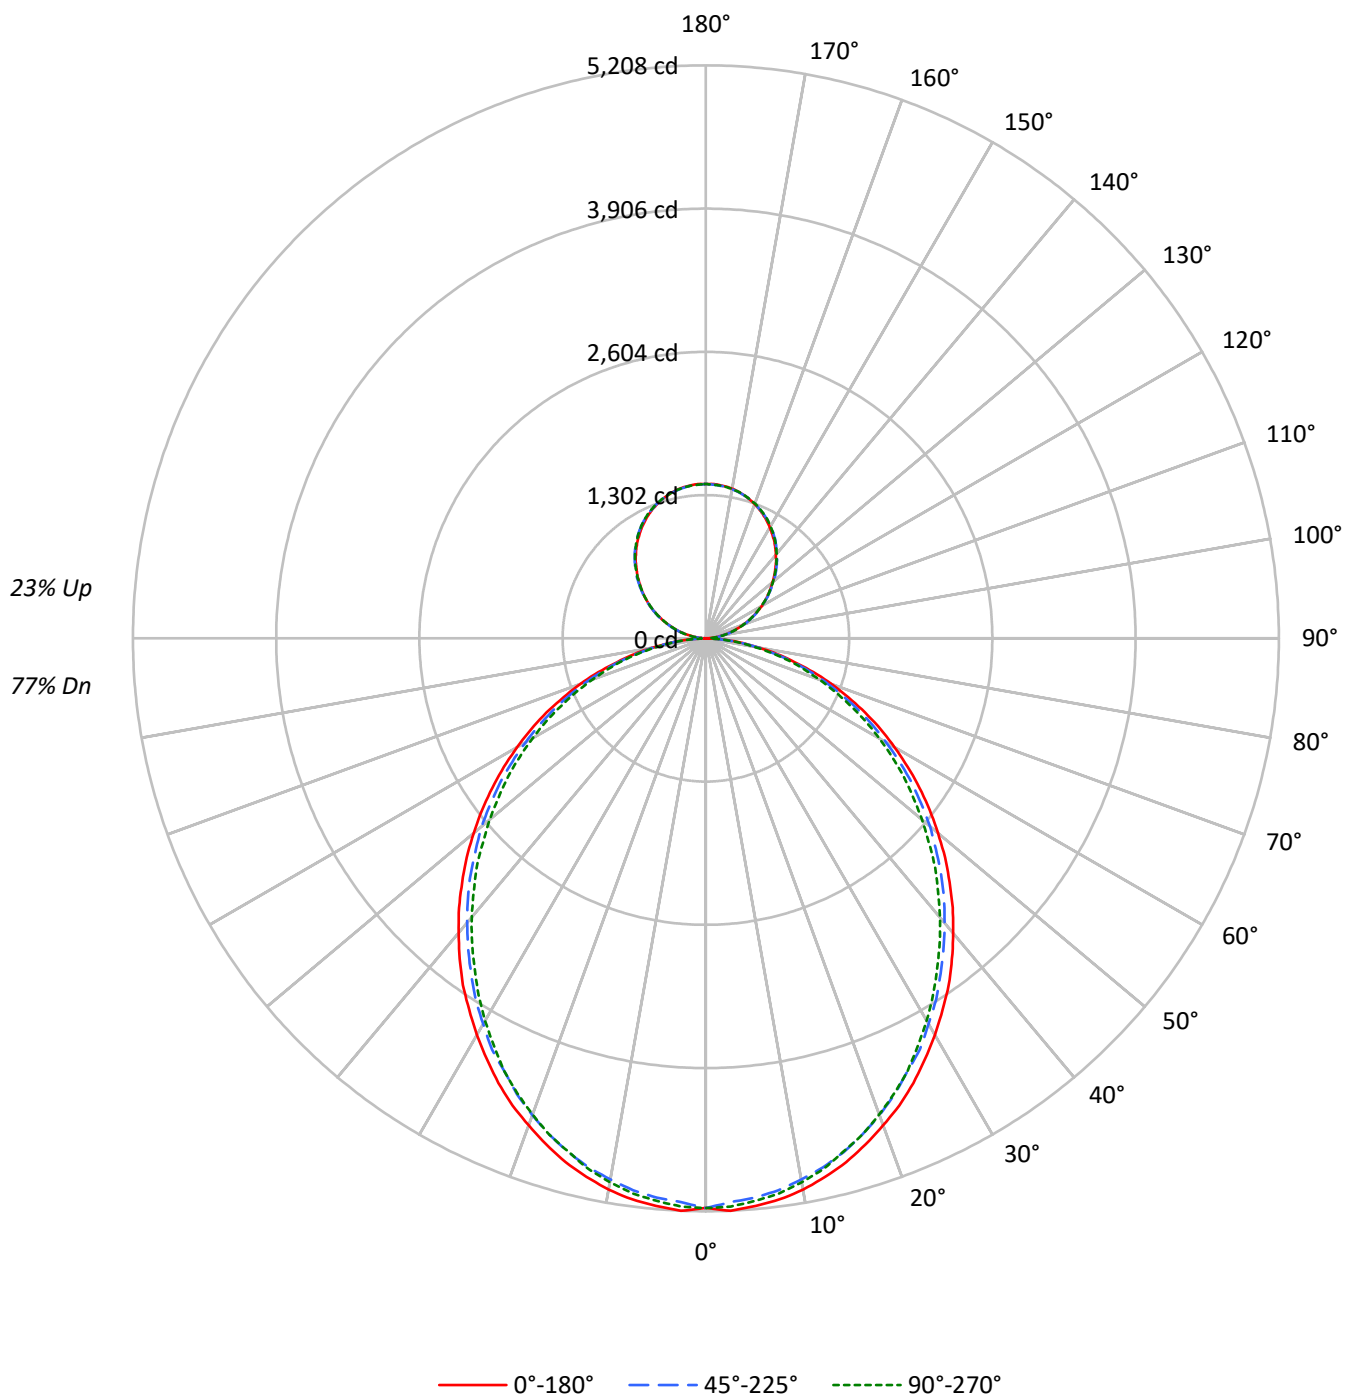

TEST NUMBER: P912084

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	114	114	114	114	108	108	108	108	98	98	98	89	89	89	81	81	81
1	104	99	95	92	99	95	91	88	86	84	81	79	77	75	72	70	68
2	95	87	80	75	90	83	77	72	76	71	67	69	66	62	63	60	58
3	86	76	69	63	82	73	66	61	67	61	57	61	57	53	56	52	49
4	79	68	59	53	75	65	57	52	60	53	48	55	50	45	50	46	42
5	73	61	52	46	69	58	50	44	53	47	42	49	44	39	45	41	37
6	67	55	46	40	64	52	45	39	48	42	37	45	39	35	41	36	33
7	62	49	41	35	59	48	40	34	44	37	33	41	35	31	37	33	29
8	58	45	37	31	55	43	36	31	40	34	29	37	32	28	34	30	26
9	54	41	33	28	52	40	32	27	37	31	26	34	29	25	32	27	24
10	51	38	30	25	48	37	30	25	34	28	24	32	26	23	30	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5933	5933	5933
5°	5939	5847	5888
10°	5887	5764	5806
15°	5797	5665	5680
20°	5676	5529	5550
25°	5556	5368	5401
30°	5406	5217	5212
35°	5264	5040	5012
40°	5089	4861	4821
45°	4915	4681	4626
50°	4724	4492	4400
55°	4524	4274	4192
60°	4298	4015	3953
65°	4051	3747	3672
70°	3736	3419	3369
75°	3300	3027	3085
80°	2774	2526	2550
85°	1952	1673	1669

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4915 cd/sqm

TEST NUMBER: P912084

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	487.4	2.9
10°-20°	1371.3	8.0
20°-30°	2015.2	11.8
30°-40°	2340.6	13.7
40°-50°	2337.7	13.7
50°-60°	2038.4	11.9
60°-70°	1506.8	8.8
70°-80°	852.5	5.0
80°-90°	229.0	1.3
90°-100°	86.8	0.5
100°-110°	275.8	1.6
110°-120°	472.0	2.8
120°-130°	620.8	3.6
130°-140°	696.8	4.1
140°-150°	683.3	4.0
150°-160°	573.2	3.4
160°-170°	380.1	2.2
170°-180°	132.9	0.8
0°-30°	3873.9	22.7
0°-40°	6214.5	36.3
0°-60°	10590.5	61.9
0°-90°	13178.9	77.1
90°-120°	834.7	4.9
90°-150°	2835.6	16.6
90°-180°	3922.0	22.9
0°-180°	17100.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5178	5178	5178	5178	5178	
5°	5178	5159	5104	5143	5134	492
15°	4929	4900	4835	4855	4830	1388
25°	4461	4422	4337	4347	4337	2053
35°	3849	3799	3720	3690	3665	2404
45°	3132	3097	3022	2968	2948	2417
55°	2370	2340	2280	2221	2196	2119
65°	1599	1568	1519	1474	1449	1581
75°	836	827	801	772	782	893
85°	204	199	194	179	174	227
90°	1	15	42	39	40	16
95°	62	74	76	76	74	69
105°	255	258	260	263	263	269
115°	474	480	478	477	474	469
125°	689	700	696	692	691	616
135°	891	904	907	906	902	689
145°	1082	1090	1097	1098	1094	676
155°	1237	1240	1244	1250	1246	569
165°	1346	1345	1345	1353	1347	380
175°	1400	1397	1394	1403	1396	133
180°	1403	1403	1403	1403	1403	

TEST NUMBER: P912084

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5178.3	5178.3	5178.3	5178.3	5178.3
2.5°	5208.3	5183.5	5128.6	5178.3	5168.7
5°	5178.3	5158.6	5103.7	5143.3	5133.8
7.5°	5143.3	5113.7	5058.8	5099.0	5089.0
10°	5089.0	5054.0	4994.4	5034.0	5019.2
12.5°	5013.9	4984.3	4924.6	4949.5	4939.4
15°	4929.4	4899.8	4834.8	4854.9	4830.0
17.5°	4824.8	4795.2	4730.2	4755.1	4730.2
20°	4710.1	4680.5	4610.9	4625.6	4606.1
22.5°	4596.0	4551.1	4486.1	4486.1	4476.1
25°	4461.3	4421.7	4337.2	4346.7	4337.2
27.5°	4311.8	4277.0	4212.5	4197.7	4172.9
30°	4162.9	4122.7	4048.2	4033.4	4013.4
32.5°	4003.3	3973.8	3893.9	3863.9	3843.8
35°	3849.0	3799.4	3719.6	3689.5	3664.7
37.5°	3674.7	3629.9	3550.0	3515.2	3490.4
40°	3495.7	3455.5	3375.7	3331.3	3311.3
42.5°	3321.3	3281.2	3201.9	3151.8	3122.2
45°	3132.1	3097.3	3022.2	2967.9	2947.8
47.5°	2947.8	2912.9	2833.2	2778.3	2748.7
50°	2753.4	2728.6	2658.8	2589.1	2564.2
52.5°	2564.2	2529.4	2465.0	2410.0	2375.1
55°	2370.4	2340.3	2280.5	2220.9	2196.0
57.5°	2176.0	2151.1	2086.1	2026.5	2006.4
60°	1981.6	1962.0	1892.3	1837.4	1822.5
62.5°	1792.5	1757.5	1708.0	1658.3	1638.2
65°	1598.6	1568.5	1518.8	1473.9	1449.1
67.5°	1399.4	1374.1	1329.7	1294.9	1274.8
70°	1215.0	1194.9	1150.0	1115.2	1095.7
72.5°	1025.9	1005.9	981.0	946.2	931.3
75°	836.3	826.8	801.4	771.9	781.8
77.5°	667.2	647.1	637.1	622.3	607.5
80°	498.2	492.8	482.9	468.1	458.0
82.5°	338.6	338.6	333.9	313.8	313.8
85°	203.9	199.2	194.4	179.1	174.3
87.5°	89.8	79.7	69.8	54.9	49.7
90°	1.2	15.2	41.5	38.9	40.1
92.5°	26.2	35.5	36.8	38.0	38.0
95°	61.8	73.6	75.7	75.7	73.6
97.5°	102.8	113.8	118.4	118.4	118.4
100°	150.2	159.9	163.2	163.2	162.0
102.5°	200.1	207.3	211.9	213.1	211.9
105°	254.6	258.0	260.5	262.6	262.6
107.5°	308.7	313.8	313.8	314.6	308.7
110°	361.2	368.0	368.0	368.0	364.6

TEST NUMBER: P912084

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	417.9	425.1	423.7	420.4	417.9
115°	473.7	480.5	478.3	477.1	473.7
117.5°	529.1	538.4	532.5	529.1	525.8
120°	585.0	594.2	585.0	585.0	581.1
122.5°	635.7	647.5	641.7	638.2	635.7
125°	689.0	699.6	696.2	692.3	691.1
127.5°	741.0	754.1	749.5	744.4	741.0
130°	789.6	804.9	802.8	800.3	795.6
132.5°	844.2	856.0	856.9	850.9	847.6
135°	891.2	904.3	906.8	905.5	902.2
137.5°	943.6	954.2	956.3	955.4	950.4
140°	989.7	1000.3	1006.2	1006.2	1001.5
142.5°	1037.1	1047.7	1051.0	1052.3	1047.7
145°	1081.9	1090.4	1097.1	1098.5	1093.8
147.5°	1122.1	1132.6	1137.7	1139.8	1135.2
150°	1163.6	1170.8	1175.4	1179.2	1175.4
152.5°	1200.4	1207.5	1213.5	1218.1	1213.5
155°	1237.1	1240.5	1244.3	1250.3	1246.4
157.5°	1268.9	1271.4	1273.5	1282.0	1276.0
160°	1297.2	1299.7	1301.0	1308.2	1303.1
162.5°	1323.4	1323.4	1324.7	1332.7	1326.8
165°	1345.9	1344.6	1344.6	1353.0	1347.1
167.5°	1366.2	1362.3	1362.3	1370.8	1364.8
170°	1381.4	1377.9	1376.7	1385.1	1377.9
172.5°	1391.9	1388.6	1387.2	1395.8	1388.6
175°	1400.4	1397.0	1394.5	1402.9	1395.8
177.5°	1405.1	1401.7	1399.1	1406.3	1399.1
180°	1402.9	1402.9	1402.9	1402.9	1402.9

TEST NUMBER: P912084

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.62	16.79	16.31	17.50	18.32	15.18	16.35	15.86	17.05	17.88
	3H	17.30	18.35	18.00	19.07	19.92	16.81	17.86	17.51	18.58	19.43
	4H	17.90	18.89	18.62	19.62	20.49	17.41	18.40	18.12	19.12	19.99
	6H	18.31	19.23	19.04	19.96	20.85	17.81	18.73	18.54	19.46	20.35
	8H	18.42	19.30	19.16	20.05	20.94	17.92	18.80	18.66	19.55	20.44
	12H	18.48	19.31	19.23	20.06	20.97	17.97	18.81	18.72	19.55	20.47
4H	2H	16.12	17.11	16.84	17.83	18.70	15.76	16.75	16.48	17.48	18.35
	3H	18.00	18.83	18.74	19.59	20.48	17.60	18.43	18.33	19.19	20.07
	4H	18.73	19.48	19.48	20.24	21.16	18.30	19.06	19.05	19.82	20.74
	6H	19.25	19.91	20.02	20.69	21.62	18.82	19.48	19.59	20.26	21.19
	8H	19.41	20.02	20.18	20.80	21.74	18.97	19.58	19.74	20.37	21.30
	12H	19.50	20.05	20.29	20.85	21.79	19.05	19.60	19.84	20.40	21.34
8H	4H	18.94	19.56	19.71	20.34	21.27	18.57	19.18	19.34	19.96	20.90
	6H	19.58	20.09	20.38	20.91	21.85	19.20	19.71	20.00	20.53	21.47
	8H	19.80	20.25	20.61	21.08	22.03	19.41	19.86	20.22	20.68	21.64
	12H	19.94	20.34	20.76	21.16	22.17	19.53	19.93	20.35	20.75	21.76
12H	4H	18.94	19.49	19.73	20.30	21.24	18.57	19.13	19.37	19.93	20.87
	6H	19.61	20.06	20.42	20.89	21.84	19.24	19.69	20.05	20.52	21.47
	8H	19.87	20.26	20.68	21.08	22.09	19.48	19.88	20.30	20.70	21.71

END OF REPORT