

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912095

Luminaire Tested: DFN2DIP-SQ3F0-120D060US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912095
REPORT IS A COMBINATION OF REPORTS P901434 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D060US850-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17899.2 lumens
Efficiency: N/A
Efficacy: 104.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912095

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US850-RLLONL

Luminous Intensity Polar Plot

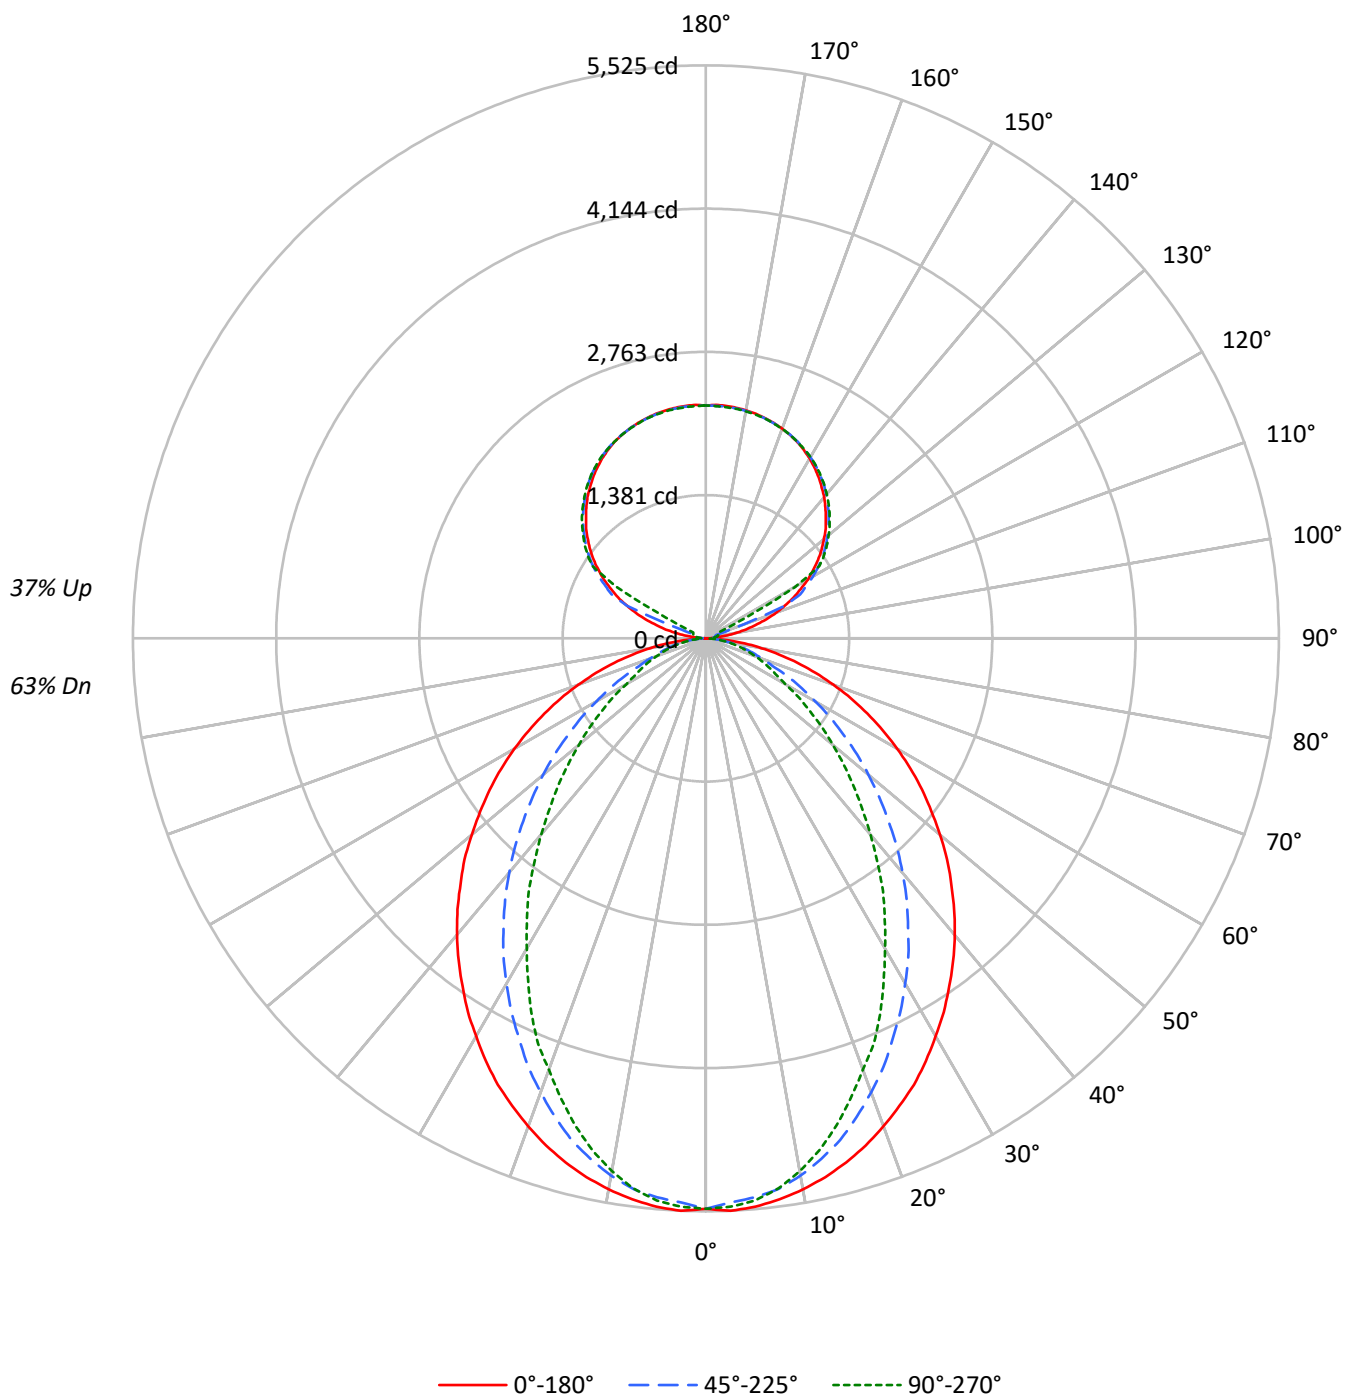

TEST NUMBER: P912095

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6302	6302	6302
5°	6308	6198	6240
10°	6242	6072	6035
15°	6152	5867	5719
20°	6034	5587	5332
25°	5914	5273	4959
30°	5753	4952	4486
35°	5596	4607	4070
40°	5435	4250	3594
45°	5249	3855	3163
50°	5056	3457	2742
55°	4855	3032	2338
60°	4621	2587	1922
65°	4352	2137	1728
70°	4025	1716	1560
75°	3614	1504	1415
80°	3020	1248	1220
85°	2048	813	905

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5249 cd/sqm

TEST NUMBER: P912095

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	515.5	2.9
10°-20°	1415.1	7.9
20°-30°	1986.8	11.1
30°-40°	2165.7	12.1
40°-50°	1990.5	11.1
50°-60°	1563.2	8.7
60°-70°	1017.5	5.7
70°-80°	523.8	2.9
80°-90°	137.7	0.8
90°-100°	74.1	0.4
100°-110°	276.0	1.5
110°-120°	732.1	4.1
120°-130°	1214.2	6.8
130°-140°	1289.8	7.2
140°-150°	1198.7	6.7
150°-160°	963.8	5.4
160°-170°	621.0	3.5
170°-180°	213.7	1.2
0°-30°	3917.3	21.9
0°-40°	6083.0	34.0
0°-60°	9636.8	53.8
0°-90°	11315.7	63.2
90°-120°	1082.2	6.0
90°-150°	4785.0	26.7
90°-180°	6583.0	36.8
0°-180°	17899.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5500	5500	5500	5500	5500	
5°	5500	5475	5410	5455	5440	522
15°	5231	5176	5008	4913	4863	1474
25°	4749	4589	4261	4057	3982	2184
35°	4092	3838	3400	3086	2976	2561
45°	3345	3011	2489	2135	2016	2583
55°	2543	2155	1618	1319	1225	2273
65°	1717	1314	866	697	682	1703
75°	916	567	398	363	358	969
85°	214	109	94	94	94	246
90°	2	20	32	41	44	17
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P912095

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5500.2	5500.2	5500.2	5500.2	5500.2
2.5°	5525.0	5500.2	5445.3	5495.4	5485.3
5°	5500.2	5475.4	5410.4	5455.3	5440.5
7.5°	5455.3	5425.7	5356.0	5375.5	5350.7
10°	5395.6	5360.8	5261.4	5246.1	5216.6
12.5°	5321.1	5276.3	5141.5	5112.0	5057.2
15°	5231.4	5176.5	5007.5	4912.9	4863.3
17.5°	5126.8	5047.1	4837.9	4728.7	4648.9
20°	5007.5	4907.7	4658.9	4534.8	4424.9
22.5°	4878.0	4763.5	4474.6	4305.6	4231.2
25°	4748.7	4589.2	4260.7	4056.8	3981.9
27.5°	4594.5	4424.9	4061.6	3827.7	3713.0
30°	4430.2	4240.7	3842.5	3588.9	3454.3
32.5°	4270.8	4041.5	3633.9	3335.0	3210.3
35°	4091.8	3837.7	3399.9	3086.2	2976.3
37.5°	3917.4	3643.4	3180.7	2836.9	2712.8
40°	3733.1	3434.8	2951.6	2598.3	2468.9
42.5°	3544.0	3225.6	2722.9	2354.3	2230.2
45°	3345.0	3011.3	2488.9	2135.2	2015.7
47.5°	3155.9	2802.7	2265.0	1911.3	1801.9
50°	2946.8	2593.5	2045.9	1702.1	1598.1
52.5°	2742.4	2369.0	1836.7	1508.2	1413.8
55°	2543.4	2155.2	1617.6	1319.2	1224.7
57.5°	2339.4	1941.3	1423.7	1144.9	1065.2
60°	2130.4	1732.1	1219.3	965.9	886.2
62.5°	1926.6	1528.3	1045.1	806.5	766.8
65°	1717.4	1313.9	866.1	697.1	681.8
67.5°	1518.3	1114.8	697.1	612.1	597.3
70°	1309.2	921.0	577.2	527.6	507.5
72.5°	1110.1	741.5	482.6	443.0	433.1
75°	915.7	567.1	398.2	363.3	358.5
77.5°	722.0	402.9	313.7	293.7	283.6
80°	542.4	288.9	238.7	219.1	219.1
82.5°	378.2	194.3	164.2	154.2	154.2
85°	213.9	109.3	94.5	94.5	94.5
87.5°	79.7	39.6	39.6	34.8	34.8
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3



TEST NUMBER: P912095

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P912095

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.66	15.61	15.50	16.47	17.54	10.62	11.57	11.46	12.43	13.50
	3H	16.34	17.19	17.20	18.06	19.16	11.81	12.66	12.67	13.53	14.63
	4H	16.95	17.76	17.83	18.63	19.74	12.26	13.07	13.14	13.94	15.05
	6H	17.38	18.12	18.26	19.00	20.12	12.59	13.33	13.47	14.21	15.33
	8H	17.51	18.21	18.40	19.11	20.23	12.68	13.38	13.57	14.28	15.40
	12H	17.57	18.24	18.47	19.13	20.28	12.72	13.39	13.62	14.28	15.43
4H	2H	14.69	15.49	15.57	16.37	17.48	11.23	12.03	12.11	12.91	14.02
	3H	16.53	17.19	17.41	18.10	19.23	12.58	13.25	13.47	14.16	15.28
	4H	17.22	17.83	18.12	18.73	19.88	13.13	13.74	14.03	14.64	15.79
	6H	17.74	18.26	18.65	19.19	20.34	13.55	14.07	14.46	15.00	16.15
	8H	17.91	18.40	18.83	19.32	20.49	13.68	14.16	14.59	15.09	16.25
	12H	18.01	18.45	18.94	19.39	20.56	13.74	14.18	14.68	15.12	16.29
8H	4H	17.20	17.68	18.11	18.61	19.77	13.42	13.90	14.33	14.83	15.99
	6H	17.76	18.16	18.70	19.13	20.29	13.93	14.33	14.87	15.30	16.46
	8H	17.97	18.33	18.93	19.29	20.47	14.12	14.47	15.07	15.43	16.61
	12H	18.11	18.43	19.07	19.38	20.61	14.24	14.55	15.19	15.50	16.73
12H	4H	17.15	17.59	18.09	18.53	19.70	13.43	13.87	14.36	14.81	15.98
	6H	17.74	18.09	18.69	19.05	20.23	13.98	14.34	14.93	15.29	16.47
	8H	17.96	18.27	18.91	19.22	20.45	14.19	14.50	15.14	15.45	16.68

END OF REPORT