

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914556

Luminaire Tested: DFN2DIP-SQ3F0-040D120US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914556
REPORT IS A COMBINATION OF REPORTS P900005 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D120US927-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11549.9 lumens
Efficiency: N/A
Efficacy: 91.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 126.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914556

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US927-FLLFLL

Luminous Intensity Polar Plot

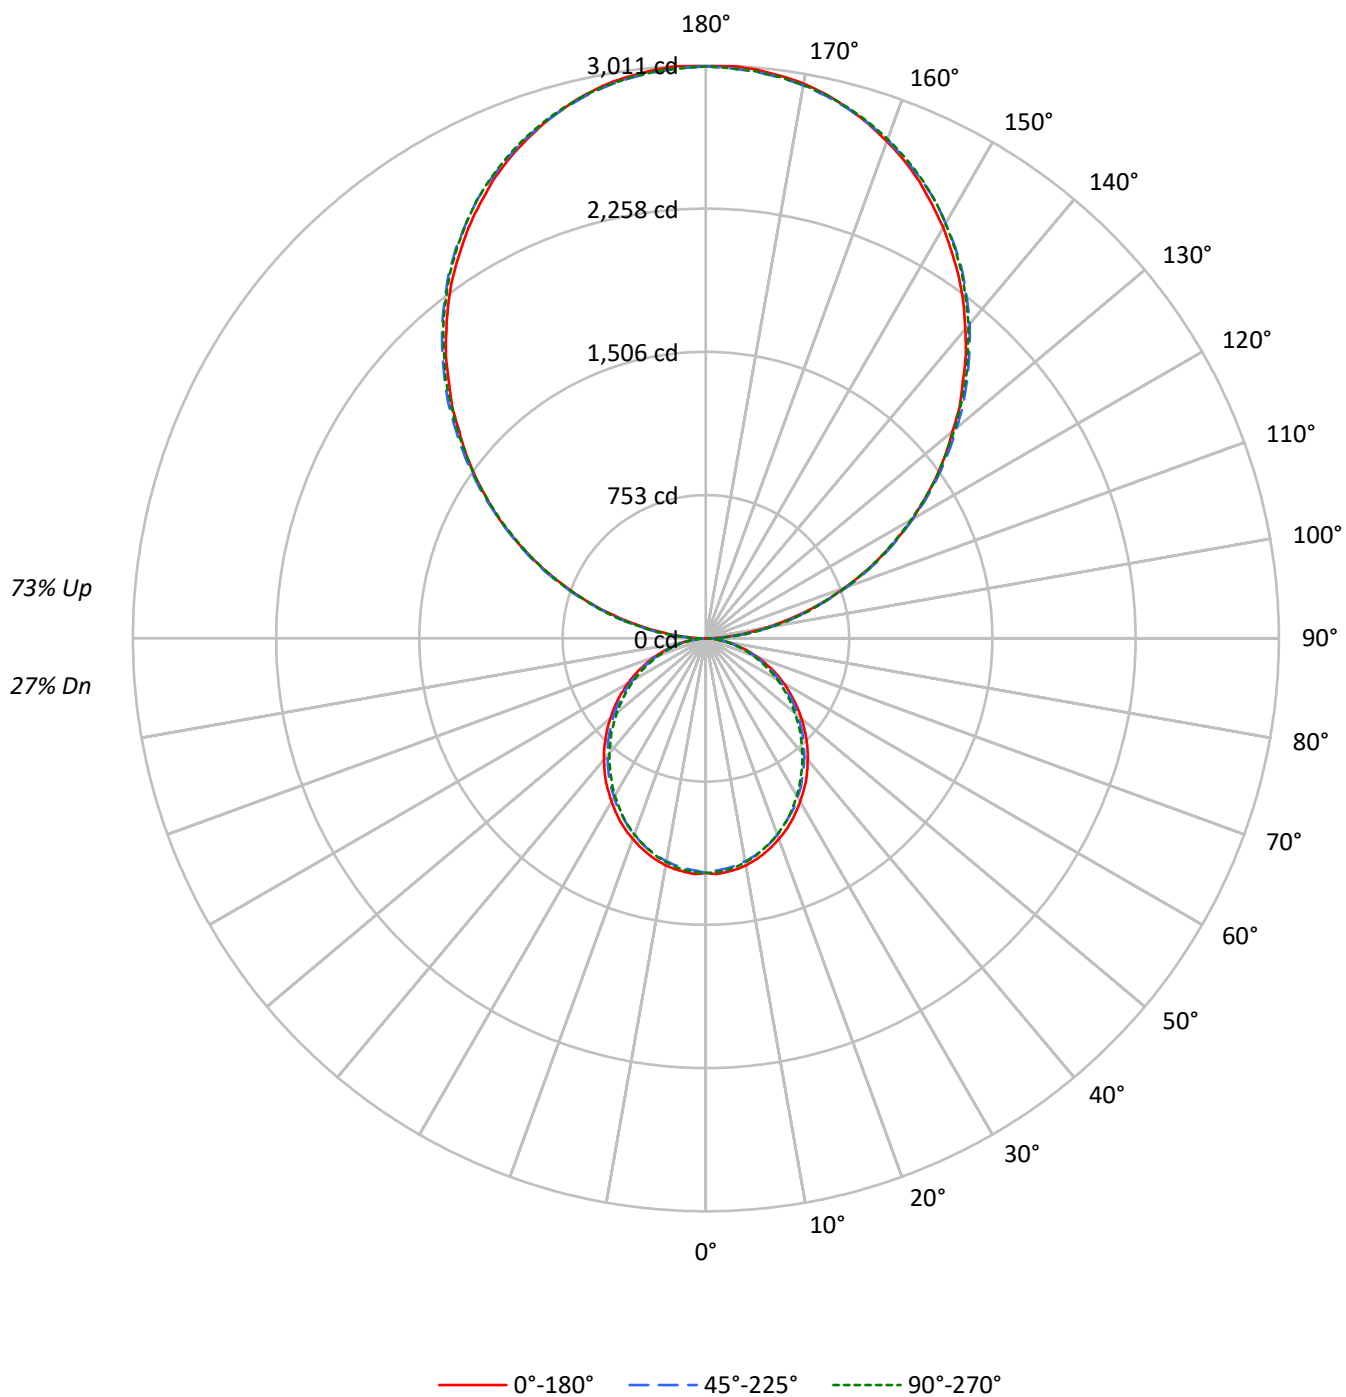

TEST NUMBER: P914556

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US927-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	52	52	52	35	35	35
1	93	88	85	81	83	79	76	73	62	60	58	46	44	43	31	30	30
2	84	77	71	66	75	69	64	60	54	51	48	40	38	36	27	26	25
3	77	68	61	55	68	61	55	50	48	44	40	35	33	30	24	23	21
4	70	60	52	47	62	54	47	42	42	38	34	32	29	26	22	20	18
5	64	53	45	40	57	48	41	36	38	33	29	28	25	22	19	17	16
6	59	48	40	34	53	43	36	31	34	29	25	25	22	20	18	16	14
7	55	43	35	30	49	39	32	27	31	26	22	23	20	17	16	14	12
8	51	39	31	26	45	35	28	24	28	23	20	21	18	15	15	13	11
9	47	35	28	23	42	32	26	21	25	21	17	19	16	14	14	11	10
10	44	32	25	21	39	29	23	19	23	19	16	18	15	12	13	10	9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1413	1413	1413
5°	1414	1392	1402
10°	1402	1372	1383
15°	1380	1349	1352
20°	1351	1317	1322
25°	1323	1278	1286
30°	1287	1242	1241
35°	1253	1200	1193
40°	1212	1157	1148
45°	1170	1115	1101
50°	1125	1070	1048
55°	1077	1018	998
60°	1023	956	941
65°	964	892	874
70°	889	814	802
75°	786	721	735
80°	660	601	607
85°	465	399	397

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3024 cd/sqm

TEST NUMBER: P914556

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	1.0
10°-20°	326.5	2.8
20°-30°	479.8	4.2
30°-40°	557.3	4.8
40°-50°	556.6	4.8
50°-60°	485.3	4.2
60°-70°	358.8	3.1
70°-80°	203.0	1.8
80°-90°	62.1	0.5
90°-100°	186.0	1.6
100°-110°	591.1	5.1
110°-120°	1011.6	8.8
120°-130°	1330.4	11.5
130°-140°	1493.3	12.9
140°-150°	1464.3	12.7
150°-160°	1228.4	10.6
160°-170°	814.6	7.1
170°-180°	284.7	2.5
0°-30°	922.4	8.0
0°-40°	1479.7	12.8
0°-60°	2521.7	21.8
0°-90°	3145.6	27.2
90°-120°	1788.7	15.5
90°-150°	6076.6	52.6
90°-180°	8404.0	72.8
0°-180°	11549.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	3	33	89	83	86	11
95°	132	158	162	162	158	147
105°	546	553	558	563	563	576
115°	1015	1030	1025	1022	1015	1004
125°	1476	1499	1492	1484	1481	1319
135°	1910	1938	1943	1940	1933	1476
145°	2318	2337	2351	2354	2344	1449
155°	2651	2658	2667	2679	2671	1220
165°	2884	2881	2881	2900	2887	814
175°	3001	2994	2988	3006	2991	285
180°	3006	3006	3006	3006	3006	

TEST NUMBER: P914556

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	2.7	32.6	88.8	83.4	86.1
92.5°	56.2	76.1	78.8	81.6	81.6
95°	132.3	157.7	162.2	162.2	157.7
97.5°	220.2	243.8	253.8	253.8	253.8
100°	321.8	342.6	349.8	349.8	347.1
102.5°	428.7	444.1	454.1	456.9	454.1
105°	545.7	552.9	558.3	562.8	562.8
107.5°	661.6	672.6	672.6	674.3	661.6
110°	774.0	788.5	788.5	788.5	781.3

TEST NUMBER: P914556

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	895.5	910.9	908.2	900.9	895.5
115°	1015.1	1029.7	1025.1	1022.4	1015.1
117.5°	1133.8	1153.8	1141.1	1133.8	1126.6
120°	1253.5	1273.4	1253.5	1253.5	1245.4
122.5°	1362.3	1387.7	1375.0	1367.7	1362.3
125°	1476.5	1499.1	1491.9	1483.8	1481.0
127.5°	1588.0	1616.0	1606.1	1595.2	1588.0
130°	1692.2	1724.8	1720.3	1714.8	1704.9
132.5°	1809.1	1834.5	1836.3	1823.6	1816.4
135°	1909.7	1937.8	1943.3	1940.5	1933.3
137.5°	2022.1	2044.8	2049.3	2047.5	2036.6
140°	2120.9	2143.6	2156.2	2156.2	2146.3
142.5°	2222.5	2245.1	2252.3	2255.0	2245.1
145°	2318.5	2336.6	2351.1	2353.9	2343.9
147.5°	2404.6	2427.2	2438.2	2442.7	2432.7
150°	2493.5	2508.8	2518.8	2527.0	2518.8
152.5°	2572.3	2587.7	2600.4	2610.4	2600.4
155°	2651.1	2658.4	2666.6	2679.2	2671.1
157.5°	2719.2	2724.5	2729.1	2747.2	2734.5
160°	2779.8	2785.3	2788.0	2803.4	2792.5
162.5°	2836.0	2836.0	2838.8	2856.0	2843.3
165°	2884.1	2881.4	2881.4	2899.5	2886.8
167.5°	2927.6	2919.4	2919.4	2937.6	2924.9
170°	2960.2	2952.9	2950.2	2968.4	2952.9
172.5°	2982.9	2975.6	2972.9	2991.0	2975.6
175°	3001.0	2993.7	2988.3	3006.4	2991.0
177.5°	3011.0	3003.7	2998.2	3013.7	2998.2
180°	3006.4	3006.4	3006.4	3006.4	3006.4

TEST NUMBER: P914556

CATALOG NUMBER: DFN2DIP-SQ3F0-040D120US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.83	6.52	6.96	7.64	9.20	5.38	6.07	6.51	7.19	8.76
	3H	7.47	8.09	8.61	9.22	10.80	6.98	7.60	8.12	8.73	10.31
	4H	8.05	8.63	9.20	9.76	11.35	7.55	8.14	8.70	9.27	10.85
	6H	8.43	8.97	9.59	10.11	11.70	7.93	8.47	9.09	9.61	11.20
	8H	8.53	9.04	9.69	10.19	11.78	8.03	8.54	9.19	9.69	11.28
	12H	8.57	9.06	9.74	10.20	11.81	8.06	8.55	9.23	9.69	11.30
4H	2H	6.26	6.85	7.42	7.98	9.56	5.91	6.49	7.06	7.63	9.21
	3H	8.11	8.60	9.27	9.75	11.35	7.70	8.19	8.86	9.35	10.94
	4H	8.81	9.26	9.97	10.41	12.02	8.39	8.84	9.55	9.98	11.60
	6H	9.31	9.70	10.48	10.87	12.47	8.88	9.27	10.05	10.43	12.04
	8H	9.46	9.81	10.62	10.97	12.60	9.02	9.38	10.19	10.54	12.16
	12H	9.52	9.84	10.70	11.01	12.64	9.07	9.40	10.25	10.57	12.19
8H	4H	8.99	9.35	10.16	10.51	12.13	8.61	8.97	9.78	10.13	11.75
	6H	9.61	9.90	10.79	11.11	12.72	9.22	9.52	10.41	10.72	12.34
	8H	9.82	10.08	11.02	11.26	12.90	9.43	9.69	10.62	10.87	12.51
	12H	9.94	10.17	11.14	11.35	13.02	9.53	9.76	10.73	10.94	12.61
12H	4H	8.97	9.29	10.15	10.46	12.09	8.60	8.92	9.78	10.09	11.72
	6H	9.63	9.89	10.83	11.07	12.71	9.26	9.52	10.45	10.70	12.34
	8H	9.86	10.09	11.06	11.27	12.94	9.48	9.71	10.68	10.89	12.56

END OF REPORT