

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914579

Luminaire Tested: DFN2DIP-SQ3F0-050D080US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914579
REPORT IS A COMBINATION OF REPORTS P901456 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D080US927-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9640.8 lumens
Efficiency: N/A
Efficacy: 94.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 102.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914579

CATALOG NUMBER: DFN2DIP-SQ3F0-050D080US927-RLLONL

Luminous Intensity Polar Plot

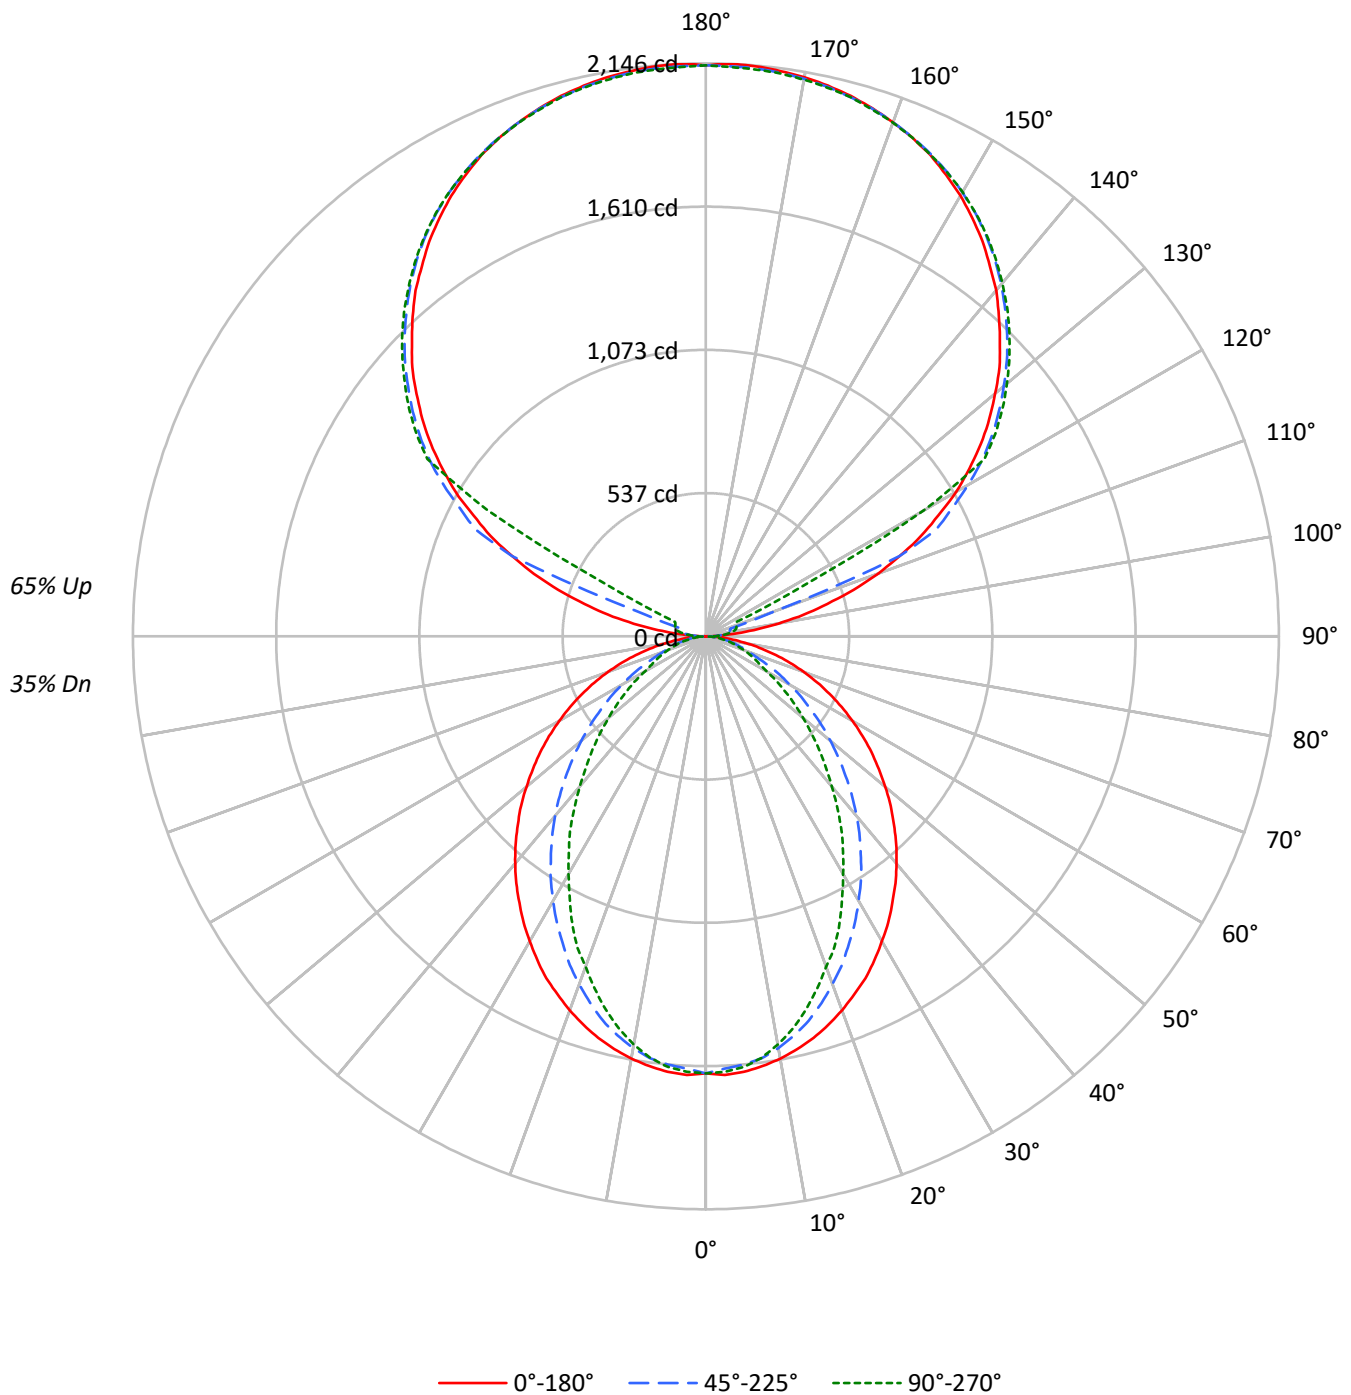

TEST NUMBER: P914579

CATALOG NUMBER: DFN2DIP-SQ3F0-050D080US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	42	42	42
1	95	91	87	84	86	82	79	76	66	64	62	51	50	49	38	37	36
2	87	80	74	69	78	72	67	63	58	55	52	46	43	41	34	32	31
3	79	70	63	58	71	64	58	53	52	47	44	41	38	35	30	28	27
4	72	62	55	49	65	57	50	45	46	41	38	36	33	30	27	25	23
5	67	56	48	42	60	51	44	39	41	36	33	33	29	27	25	22	21
6	61	50	42	37	55	45	39	34	37	32	29	30	26	23	22	20	18
7	57	45	37	32	51	41	34	30	34	29	25	27	23	21	21	18	16
8	53	41	33	28	48	37	31	26	31	26	22	25	21	19	19	17	15
9	49	37	30	25	44	34	28	23	28	23	20	23	19	17	18	15	13
10	46	34	27	23	41	31	25	21	26	21	18	21	18	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1876	1876	1876
5°	1877	1845	1857
10°	1858	1807	1796
15°	1831	1746	1702
20°	1796	1663	1587
25°	1760	1569	1476
30°	1712	1474	1335
35°	1665	1371	1211
40°	1618	1265	1070
45°	1562	1147	941
50°	1505	1029	816
55°	1445	902	696
60°	1375	770	572
65°	1295	636	514
70°	1198	511	465
75°	1076	448	421
80°	899	372	363
85°	610	242	269

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1562 cd/sqm

TEST NUMBER: P914579

CATALOG NUMBER: DFN2DIP-SQ3F0-050D080US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	153.4	1.6
10°-20°	421.2	4.4
20°-30°	591.3	6.1
30°-40°	644.6	6.7
40°-50°	592.4	6.1
50°-60°	465.3	4.8
60°-70°	302.9	3.1
70°-80°	155.9	1.6
80°-90°	43.6	0.5
90°-100°	70.5	0.7
100°-110°	262.9	2.7
110°-120°	697.3	7.2
120°-130°	1156.5	12.0
130°-140°	1228.4	12.7
140°-150°	1141.7	11.8
150°-160°	917.9	9.5
160°-170°	591.5	6.1
170°-180°	203.6	2.1
0°-30°	1165.9	12.1
0°-40°	1810.5	18.8
0°-60°	2868.2	29.8
0°-90°	3370.5	35.0
90°-120°	1030.7	10.7
90°-150°	4557.3	47.3
90°-180°	6270.0	65.0
0°-180°	9640.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1637	1637	1637	1637	1637	
5°	1637	1630	1610	1624	1619	155
15°	1557	1541	1490	1462	1448	439
25°	1413	1366	1268	1207	1185	650
35°	1218	1142	1012	918	886	762
45°	996	896	741	636	600	769
55°	757	641	481	393	364	676
65°	511	391	258	208	203	507
75°	273	169	118	108	107	288
85°	64	33	28	28	28	73
90°	2	18	31	39	42	9
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1308	1319	1323	1122
135°	1557	1582	1596	1611	1608	1203
145°	1806	1804	1831	1842	1834	1130
155°	1989	1975	1993	2003	1990	916
165°	2096	2086	2091	2102	2091	592
175°	2143	2133	2136	2146	2131	204
180°	2139	2139	2139	2139	2139	

TEST NUMBER: P914579

CATALOG NUMBER: DFN2DIP-SQ3F0-050D080US927-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1637.0	1637.0	1637.0	1637.0	1637.0
2.5°	1644.4	1637.0	1620.7	1635.6	1632.6
5°	1637.0	1629.7	1610.3	1623.7	1619.3
7.5°	1623.7	1614.9	1594.1	1600.0	1592.5
10°	1605.9	1595.5	1566.0	1561.5	1552.6
12.5°	1583.7	1570.4	1530.3	1521.5	1505.1
15°	1557.0	1540.7	1490.4	1462.3	1447.5
17.5°	1525.9	1502.2	1439.9	1407.4	1383.6
20°	1490.4	1460.7	1386.6	1349.7	1317.0
22.5°	1451.9	1417.8	1331.8	1281.5	1259.3
25°	1413.3	1365.9	1268.1	1207.4	1185.1
27.5°	1367.5	1317.0	1208.9	1139.2	1105.2
30°	1318.6	1262.2	1143.7	1068.2	1028.1
32.5°	1271.1	1202.9	1081.6	992.6	955.5
35°	1217.8	1142.2	1011.9	918.5	885.9
37.5°	1165.9	1084.4	946.7	844.4	807.5
40°	1111.1	1022.3	878.4	773.3	734.8
42.5°	1054.9	960.0	810.4	700.7	663.8
45°	995.6	896.3	740.8	635.5	599.9
47.5°	939.3	834.2	674.1	568.9	536.3
50°	877.1	771.9	608.9	506.6	475.6
52.5°	816.3	705.1	546.7	448.9	420.8
55°	757.0	641.4	481.4	392.6	364.5
57.5°	696.3	577.8	423.7	340.8	317.0
60°	634.1	515.6	362.9	287.5	263.7
62.5°	573.4	454.9	311.1	240.0	228.2
65°	511.1	391.1	257.8	207.5	203.0
67.5°	451.9	331.8	207.5	182.2	177.8
70°	389.7	274.1	171.8	157.0	151.1
72.5°	330.4	220.7	143.7	131.9	128.9
75°	272.6	168.8	118.5	108.1	106.7
77.5°	214.8	119.9	93.4	87.4	84.4
80°	161.4	86.0	71.1	65.2	65.2
82.5°	112.6	57.8	48.9	45.9	45.9
85°	63.7	32.6	28.1	28.1	28.1
87.5°	23.8	11.8	11.8	10.4	10.4
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.2	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.7	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.5	517.0	94.4	111.4	117.6
107.5°	580.4	618.9	97.6	114.5	120.7
110°	685.7	718.0	270.9	116.1	122.2

TEST NUMBER: P914579

CATALOG NUMBER: DFN2DIP-SQ3F0-050D080US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	784.7	812.5	786.2	119.1	123.9
115°	889.9	916.2	954.9	238.4	127.0
117.5°	981.2	1012.1	1038.5	817.1	411.7
120°	1083.4	1106.5	1134.5	1153.0	944.0
122.5°	1169.9	1194.8	1225.8	1235.0	1236.7
125°	1258.1	1278.3	1307.7	1318.6	1323.2
127.5°	1338.6	1360.3	1383.7	1399.1	1400.6
130°	1414.5	1439.3	1456.3	1473.4	1471.9
132.5°	1491.9	1512.1	1529.1	1543.0	1541.5
135°	1557.0	1581.7	1595.5	1611.2	1608.0
137.5°	1625.0	1643.5	1659.1	1674.6	1670.0
140°	1691.5	1704.0	1720.9	1734.9	1727.1
142.5°	1747.4	1758.2	1778.2	1790.6	1782.8
145°	1806.2	1804.5	1830.8	1841.7	1833.9
147.5°	1857.1	1852.5	1878.7	1886.5	1880.4
150°	1906.7	1895.8	1920.6	1929.8	1922.1
152.5°	1948.4	1936.1	1959.2	1968.6	1957.8
155°	1988.7	1974.9	1993.4	2002.6	1990.4
157.5°	2021.2	2008.9	2022.8	2033.7	2021.2
160°	2049.1	2039.8	2049.1	2058.3	2047.5
162.5°	2073.8	2064.6	2072.3	2083.1	2069.2
165°	2095.5	2086.3	2090.9	2101.7	2090.9
167.5°	2112.5	2103.2	2107.9	2118.8	2104.8
170°	2126.5	2117.1	2120.3	2131.1	2117.1
172.5°	2135.7	2126.5	2129.6	2140.5	2126.5
175°	2143.4	2132.6	2135.7	2146.5	2131.1
177.5°	2146.5	2135.7	2137.3	2148.2	2134.2
180°	2138.8	2138.8	2138.8	2138.8	2138.8

TEST NUMBER: P914579

CATALOG NUMBER: DFN2DIP-SQ3F0-050D080US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.71	8.43	8.79	9.51	10.98	3.67	4.39	4.75	5.47	6.94
	3H	9.37	10.02	10.46	11.10	12.59	4.84	5.49	5.93	6.57	8.06
	4H	9.97	10.58	11.07	11.67	13.17	5.28	5.89	6.38	6.98	8.48
	6H	10.38	10.95	11.49	12.04	13.55	5.59	6.15	6.70	7.24	8.75
	8H	10.51	11.04	11.62	12.15	13.65	5.68	6.21	6.79	7.32	8.82
	12H	10.56	11.07	11.68	12.17	13.69	5.71	6.22	6.83	7.32	8.85
4H	2H	7.71	8.32	8.82	9.41	10.91	4.25	4.86	5.36	5.95	7.44
	3H	9.52	10.03	10.64	11.15	12.66	5.58	6.09	6.69	7.20	8.71
	4H	10.21	10.67	11.33	11.78	13.31	6.12	6.58	7.24	7.69	9.22
	6H	10.71	11.11	11.84	12.24	13.76	6.52	6.92	7.65	8.05	9.57
	8H	10.88	11.26	12.01	12.37	13.91	6.65	7.02	7.77	8.14	9.68
	12H	10.97	11.31	12.11	12.44	13.98	6.70	7.04	7.84	8.17	9.72
8H	4H	10.17	10.54	11.29	11.66	13.20	6.39	6.76	7.51	7.88	9.42
	6H	10.72	11.03	11.87	12.19	13.73	6.89	7.20	8.04	8.36	9.90
	8H	10.94	11.20	12.09	12.35	13.90	7.08	7.35	8.23	8.49	10.04
	12H	11.07	11.30	12.22	12.44	14.03	7.19	7.42	8.34	8.56	10.15
12H	4H	10.11	10.45	11.25	11.58	13.12	6.39	6.72	7.53	7.86	9.40
	6H	10.70	10.97	11.85	12.11	13.66	6.94	7.21	8.09	8.35	9.91
	8H	10.91	11.14	12.06	12.28	13.87	7.14	7.38	8.30	8.51	10.11

END OF REPORT