

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914584

Luminaire Tested: DFN2DIP-SQ3F0-050D100US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914584
REPORT IS A COMBINATION OF REPORTS P899971 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D100US927-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10932.1 lumens
Efficiency: N/A
Efficacy: 91.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914584

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US927-FLLFLL

Luminous Intensity Polar Plot

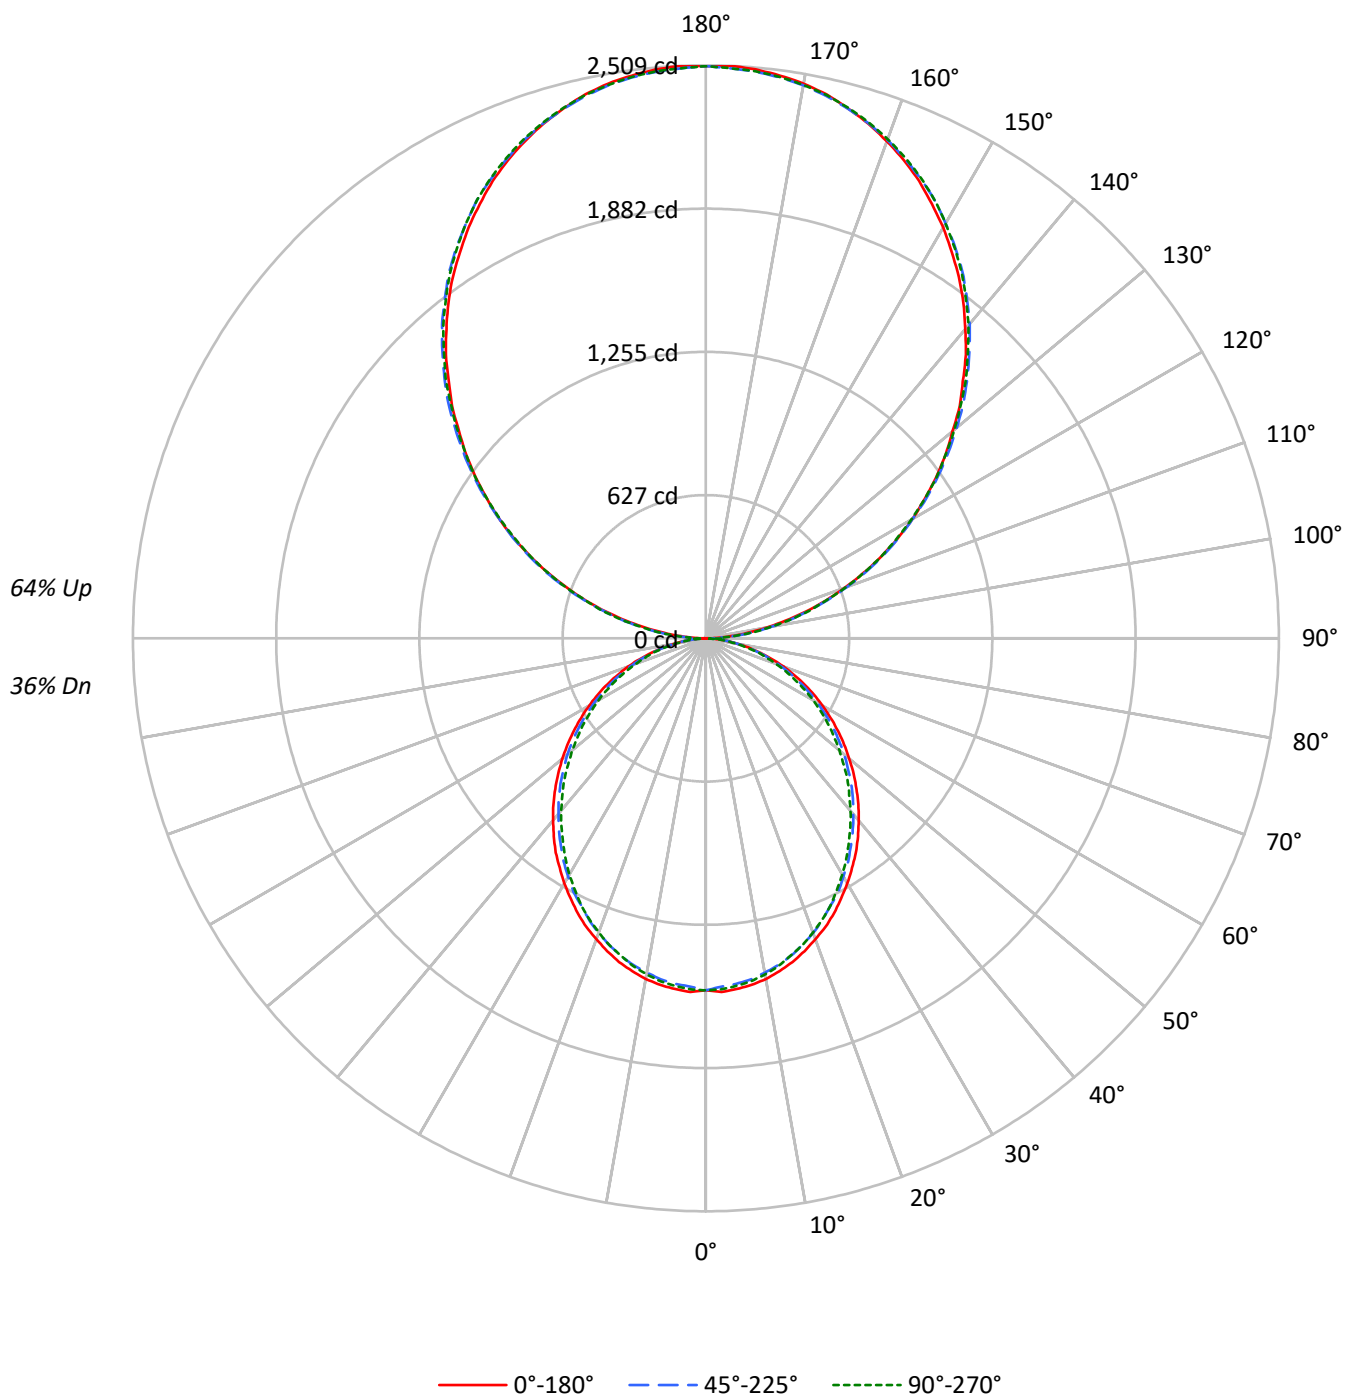

TEST NUMBER: P914584

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US927-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1766	1766	1766
5°	1768	1740	1752
10°	1752	1716	1728
15°	1725	1686	1691
20°	1689	1646	1652
25°	1654	1598	1608
30°	1609	1553	1551
35°	1567	1500	1492
40°	1515	1447	1435
45°	1463	1393	1377
50°	1406	1337	1310
55°	1347	1272	1248
60°	1279	1195	1177
65°	1206	1115	1093
70°	1112	1018	1003
75°	982	901	918
80°	826	752	759
85°	581	497	497

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2522 cd/sqm

TEST NUMBER: P914584

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	145.1	1.3
10°-20°	408.1	3.7
20°-30°	599.8	5.5
30°-40°	696.6	6.4
40°-50°	695.8	6.4
50°-60°	606.7	5.5
60°-70°	448.5	4.1
70°-80°	253.7	2.3
80°-90°	74.1	0.7
90°-100°	155.0	1.4
100°-110°	492.6	4.5
110°-120°	843.0	7.7
120°-130°	1108.6	10.1
130°-140°	1244.4	11.4
140°-150°	1220.3	11.2
150°-160°	1023.6	9.4
160°-170°	678.9	6.2
170°-180°	237.3	2.2
0°-30°	1153.0	10.5
0°-40°	1849.6	16.9
0°-60°	3152.1	28.8
0°-90°	3928.4	35.9
90°-120°	1490.6	13.6
90°-150°	5063.9	46.3
90°-180°	7004.0	64.1
0°-180°	10932.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1541	1541	1541	1541	1541	
5°	1541	1535	1519	1531	1528	146
15°	1467	1458	1439	1445	1438	413
25°	1328	1316	1291	1294	1291	611
35°	1146	1131	1107	1098	1091	715
45°	932	922	900	883	877	719
55°	706	697	679	661	654	631
65°	476	467	452	439	431	470
75°	249	246	238	230	233	266
85°	61	59	58	53	52	68
90°	2	27	74	70	72	11
95°	110	131	135	135	131	123
105°	455	461	465	469	469	480
115°	846	858	854	852	846	837
125°	1230	1249	1243	1236	1234	1100
135°	1591	1615	1619	1617	1611	1230
145°	1932	1947	1959	1962	1953	1207
155°	2209	2215	2222	2233	2226	1017
165°	2403	2401	2401	2416	2406	678
175°	2501	2495	2490	2505	2492	238
180°	2505	2505	2505	2505	2505	

TEST NUMBER: P914584

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1541.2	1541.2	1541.2	1541.2	1541.2
2.5°	1550.1	1542.8	1526.5	1541.2	1538.4
5°	1541.2	1535.4	1519.0	1530.8	1528.0
7.5°	1530.8	1522.0	1505.7	1517.7	1514.7
10°	1514.7	1504.3	1486.5	1498.3	1493.9
12.5°	1492.3	1483.5	1465.8	1473.1	1470.1
15°	1467.1	1458.3	1439.0	1445.0	1437.6
17.5°	1436.0	1427.2	1407.9	1415.2	1407.9
20°	1401.9	1393.1	1372.4	1376.7	1370.9
22.5°	1367.9	1354.6	1335.2	1335.2	1332.2
25°	1327.9	1316.1	1290.9	1293.7	1290.9
27.5°	1283.3	1273.0	1253.8	1249.3	1242.0
30°	1239.0	1227.1	1204.9	1200.5	1194.5
32.5°	1191.5	1182.7	1159.0	1150.0	1144.1
35°	1145.6	1130.8	1107.1	1098.1	1090.8
37.5°	1093.7	1080.4	1056.6	1046.2	1038.9
40°	1040.5	1028.5	1004.7	991.5	985.6
42.5°	988.6	976.6	953.0	938.0	929.2
45°	932.2	921.9	899.5	883.4	877.3
47.5°	877.3	867.0	843.3	826.9	818.1
50°	819.5	812.1	791.4	770.6	763.2
52.5°	763.2	752.8	733.6	717.3	706.9
55°	705.5	696.6	678.7	661.0	653.6
57.5°	647.6	640.2	620.9	603.2	597.1
60°	589.8	584.0	563.2	546.8	542.5
62.5°	533.5	523.2	508.3	493.5	487.6
65°	475.8	466.8	452.0	438.7	431.3
67.5°	416.5	409.0	395.8	385.4	379.4
70°	361.6	355.7	342.3	331.9	326.1
72.5°	305.4	299.4	292.0	281.6	277.2
75°	248.9	246.1	238.5	229.7	232.7
77.5°	198.6	192.6	189.6	185.2	180.9
80°	148.3	146.7	143.7	139.3	136.3
82.5°	100.8	100.8	99.3	93.4	93.4
85°	60.7	59.3	57.8	53.3	51.9
87.5°	26.7	23.8	20.8	16.3	14.8
90°	2.3	27.2	74.0	69.5	71.8
92.5°	46.8	63.5	65.8	68.0	68.0
95°	110.3	131.4	135.2	135.2	131.4
97.5°	183.5	203.2	211.5	211.5	211.5
100°	268.2	285.5	291.5	291.5	289.3
102.5°	357.3	370.1	378.4	380.6	378.4
105°	454.7	460.7	465.2	469.1	469.1
107.5°	551.4	560.5	560.5	562.0	551.4
110°	645.1	657.1	657.1	657.1	651.1

TEST NUMBER: P914584

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.2	759.1	756.8	750.8	746.2
115°	846.0	858.0	854.3	852.0	846.0
117.5°	944.9	961.5	950.9	944.9	938.8
120°	1044.6	1061.2	1044.6	1044.6	1037.8
122.5°	1135.2	1156.3	1145.8	1139.8	1135.2
125°	1230.4	1249.3	1243.2	1236.4	1234.2
127.5°	1323.3	1346.7	1338.4	1329.4	1323.3
130°	1410.2	1437.3	1433.6	1429.0	1420.8
132.5°	1507.6	1528.8	1530.3	1519.7	1513.6
135°	1591.4	1614.9	1619.4	1617.2	1611.1
137.5°	1685.1	1704.0	1707.8	1706.3	1697.2
140°	1767.4	1786.3	1796.9	1796.9	1788.6
142.5°	1852.0	1870.9	1876.9	1879.2	1870.9
145°	1932.1	1947.2	1959.3	1961.5	1953.2
147.5°	2003.8	2022.8	2031.8	2035.6	2027.3
150°	2077.9	2090.7	2099.0	2105.8	2099.0
152.5°	2143.6	2156.4	2167.0	2175.3	2167.0
155°	2209.3	2215.3	2222.1	2232.7	2225.9
157.5°	2266.0	2270.5	2274.3	2289.3	2278.8
160°	2316.6	2321.1	2323.3	2336.1	2327.1
162.5°	2363.4	2363.4	2365.6	2379.9	2369.4
165°	2403.4	2401.1	2401.1	2416.2	2405.7
167.5°	2439.7	2432.9	2432.9	2448.0	2437.4
170°	2466.9	2460.8	2458.5	2473.7	2460.8
172.5°	2485.7	2479.7	2477.4	2492.5	2479.7
175°	2500.8	2494.8	2490.3	2505.4	2492.5
177.5°	2509.2	2503.1	2498.5	2511.4	2498.5
180°	2505.4	2505.4	2505.4	2505.4	2505.4

TEST NUMBER: P914584

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.75	8.50	8.82	9.57	11.03	7.31	8.05	8.37	9.12	10.58
	3H	9.40	10.07	10.47	11.15	12.62	8.91	9.58	9.98	10.66	12.13
	4H	9.98	10.61	11.07	11.69	13.18	9.48	10.12	10.57	11.20	12.68
	6H	10.37	10.95	11.46	12.04	13.53	9.87	10.45	10.96	11.54	13.03
	8H	10.47	11.02	11.57	12.12	13.61	9.96	10.52	11.07	11.62	13.11
	12H	10.51	11.04	11.62	12.13	13.64	10.00	10.53	11.11	11.62	13.14
4H	2H	8.19	8.83	9.29	9.91	11.39	7.84	8.47	8.93	9.55	11.04
	3H	10.04	10.57	11.15	11.68	13.18	9.63	10.17	10.74	11.27	12.77
	4H	10.75	11.24	11.86	12.33	13.85	10.32	10.81	11.43	11.91	13.43
	6H	11.25	11.67	12.37	12.79	14.30	10.82	11.24	11.94	12.36	13.87
	8H	11.40	11.79	12.51	12.90	14.43	10.96	11.35	12.08	12.46	13.99
	12H	11.46	11.82	12.60	12.94	14.47	11.01	11.37	12.15	12.49	14.02
8H	4H	10.93	11.32	12.05	12.43	13.96	10.55	10.94	11.67	12.06	13.58
	6H	11.55	11.87	12.69	13.03	14.55	11.17	11.49	12.30	12.65	14.17
	8H	11.77	12.05	12.91	13.19	14.73	11.38	11.66	12.52	12.79	14.34
	12H	11.89	12.14	13.04	13.27	14.85	11.48	11.73	12.63	12.86	14.44
12H	4H	10.91	11.26	12.04	12.39	13.92	10.54	10.90	11.67	12.02	13.55
	6H	11.58	11.86	12.72	13.00	14.54	11.21	11.49	12.35	12.62	14.17
	8H	11.81	12.06	12.96	13.19	14.77	11.43	11.68	12.58	12.81	14.39