

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914599

Luminaire Tested: DFN2DIP-SQ3F0-060D040US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914599
REPORT IS A COMBINATION OF REPORTS P901386 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D040US927-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7177.1 lumens
Efficiency: N/A
Efficacy: 85.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 83.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914599

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US927-RLLONL

Luminous Intensity Polar Plot

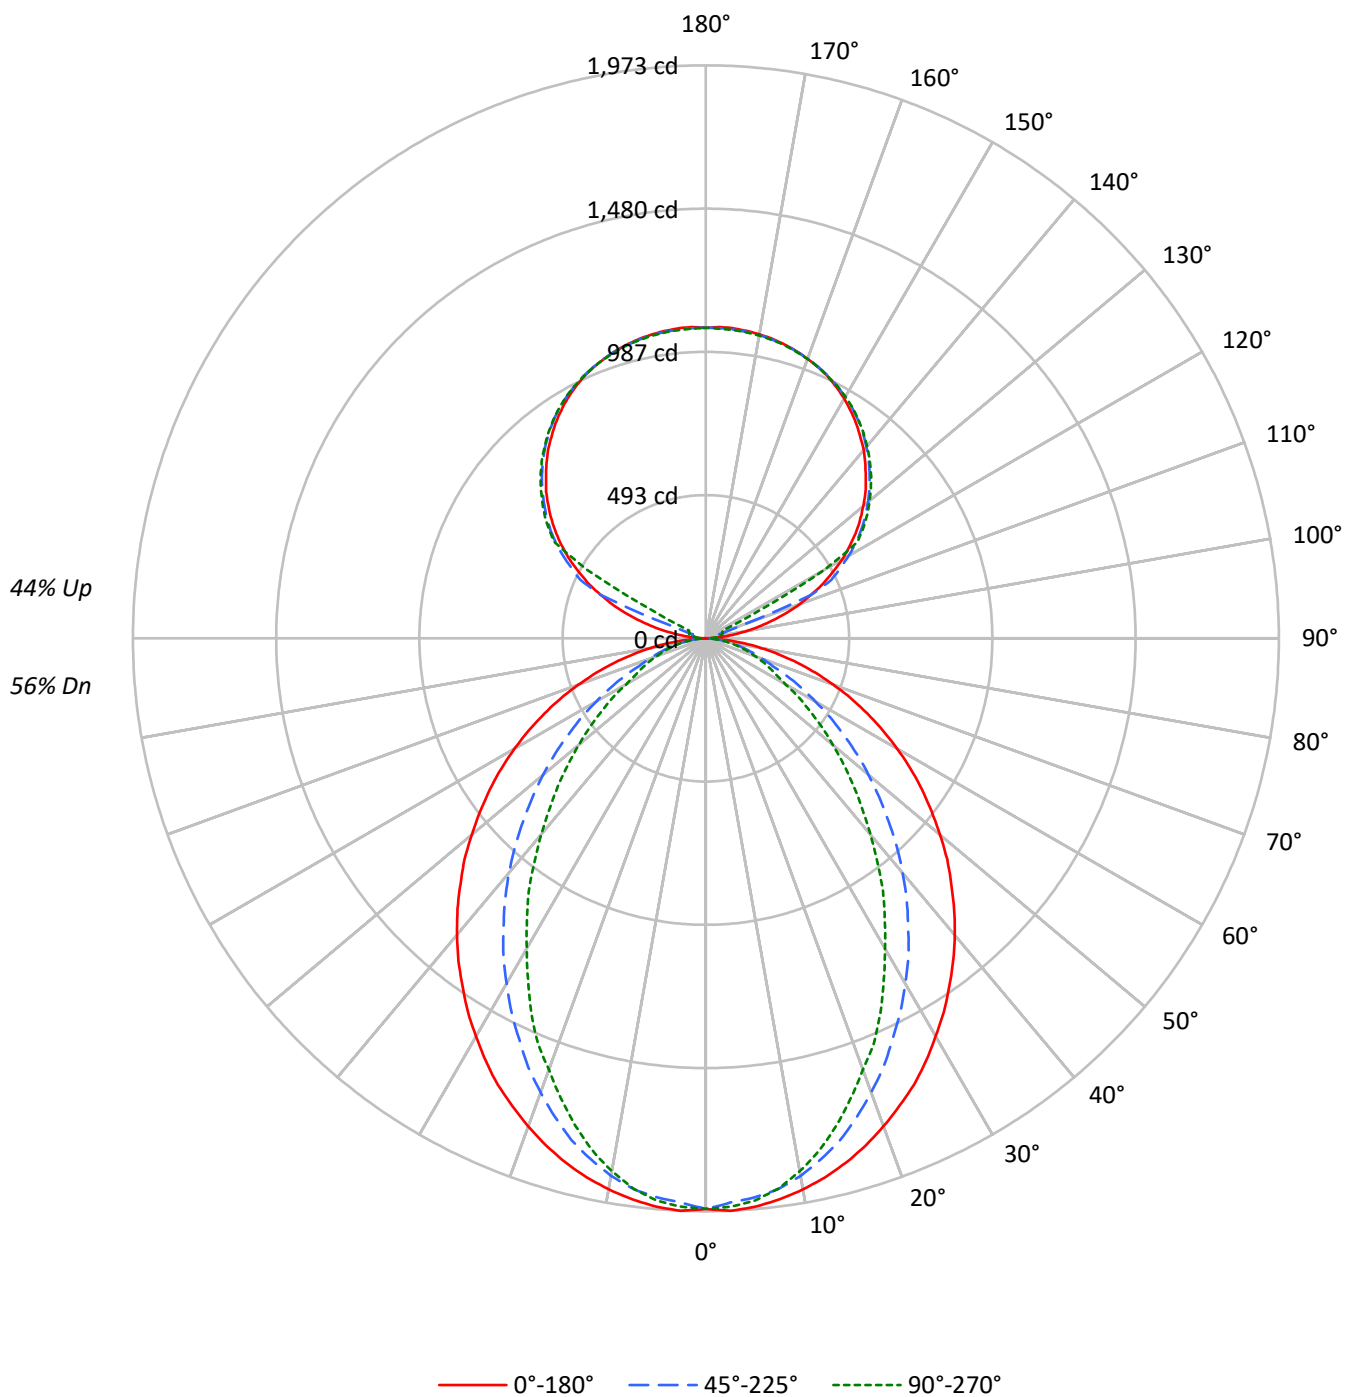

TEST NUMBER: P914599

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	56	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	50	48	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	31
6	65	54	46	40	61	50	43	38	44	39	34	39	34	31	33	30	27
7	61	49	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2251	2251	2251
5°	2253	2214	2229
10°	2229	2169	2155
15°	2197	2096	2042
20°	2155	1995	1904
25°	2112	1883	1771
30°	2055	1769	1602
35°	1998	1645	1454
40°	1941	1518	1284
45°	1875	1377	1130
50°	1806	1235	979
55°	1734	1083	835
60°	1650	924	686
65°	1554	763	617
70°	1437	613	557
75°	1291	537	506
80°	1079	446	436
85°	732	290	323

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1875 cd/sqm

TEST NUMBER: P914599

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	2.6
10°-20°	505.4	7.0
20°-30°	709.6	9.9
30°-40°	773.5	10.8
40°-50°	710.9	9.9
50°-60°	558.3	7.8
60°-70°	363.4	5.1
70°-80°	187.1	2.6
80°-90°	49.6	0.7
90°-100°	35.2	0.5
100°-110°	131.5	1.8
110°-120°	348.6	4.9
120°-130°	578.2	8.1
130°-140°	614.2	8.6
140°-150°	570.9	8.0
150°-160°	458.9	6.4
160°-170°	295.7	4.1
170°-180°	101.8	1.4
0°-30°	1399.1	19.5
0°-40°	2172.6	30.3
0°-60°	3441.9	48.0
0°-90°	4042.0	56.3
90°-120°	515.3	7.2
90°-150°	2278.7	31.7
90°-180°	3135.0	43.7
0°-180°	7177.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	1	9	15	19	21	7
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P914599

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1



TEST NUMBER: P914599

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P914599

CATALOG NUMBER: DFN2DIP-SQ3F0-060D040US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.50	11.39	11.41	12.31	13.49	6.46	7.35	7.37	8.27	9.45
	3H	12.18	12.97	13.10	13.90	15.11	7.65	8.44	8.57	9.37	10.58
	4H	12.79	13.53	13.72	14.47	15.69	8.10	8.84	9.03	9.78	11.00
	6H	13.21	13.90	14.15	14.84	16.07	8.42	9.10	9.36	10.05	11.27
	8H	13.33	13.99	14.29	14.95	16.17	8.51	9.16	9.46	10.12	11.34
	12H	13.40	14.02	14.35	14.97	16.22	8.55	9.17	9.51	10.12	11.37
4H	2H	10.53	11.27	11.47	12.21	13.42	7.06	7.81	8.00	8.75	9.96
	3H	12.35	12.97	13.30	13.94	15.17	8.41	9.03	9.36	10.00	11.23
	4H	13.04	13.61	14.00	14.57	15.83	8.96	9.52	9.92	10.48	11.74
	6H	13.56	14.05	14.53	15.03	16.28	9.37	9.86	10.34	10.84	12.10
	8H	13.73	14.19	14.71	15.17	16.43	9.50	9.95	10.47	10.93	12.20
	12H	13.83	14.24	14.82	15.23	16.50	9.56	9.97	10.55	10.97	12.24
8H	4H	13.02	13.47	13.99	14.45	15.72	9.24	9.69	10.21	10.67	11.94
	6H	13.58	13.95	14.58	14.97	16.24	9.75	10.12	10.75	11.14	12.41
	8H	13.79	14.12	14.80	15.13	16.41	9.94	10.27	10.94	11.27	12.56
	12H	13.93	14.22	14.94	15.22	16.55	10.05	10.34	11.06	11.34	12.67
12H	4H	12.97	13.38	13.96	14.37	15.65	9.24	9.65	10.24	10.65	11.92
	6H	13.55	13.88	14.56	14.89	16.18	9.80	10.13	10.80	11.14	12.42
	8H	13.77	14.06	14.78	15.07	16.40	10.00	10.30	11.01	11.30	12.63

END OF REPORT