

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914601

Luminaire Tested: DFN2DIP-SQ3F0-060D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914601
REPORT IS A COMBINATION OF REPORTS P901403 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D050US927-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8626.8 lumens
Efficiency: N/A
Efficacy: 95.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914601

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US927-FLLONL

Luminous Intensity Polar Plot

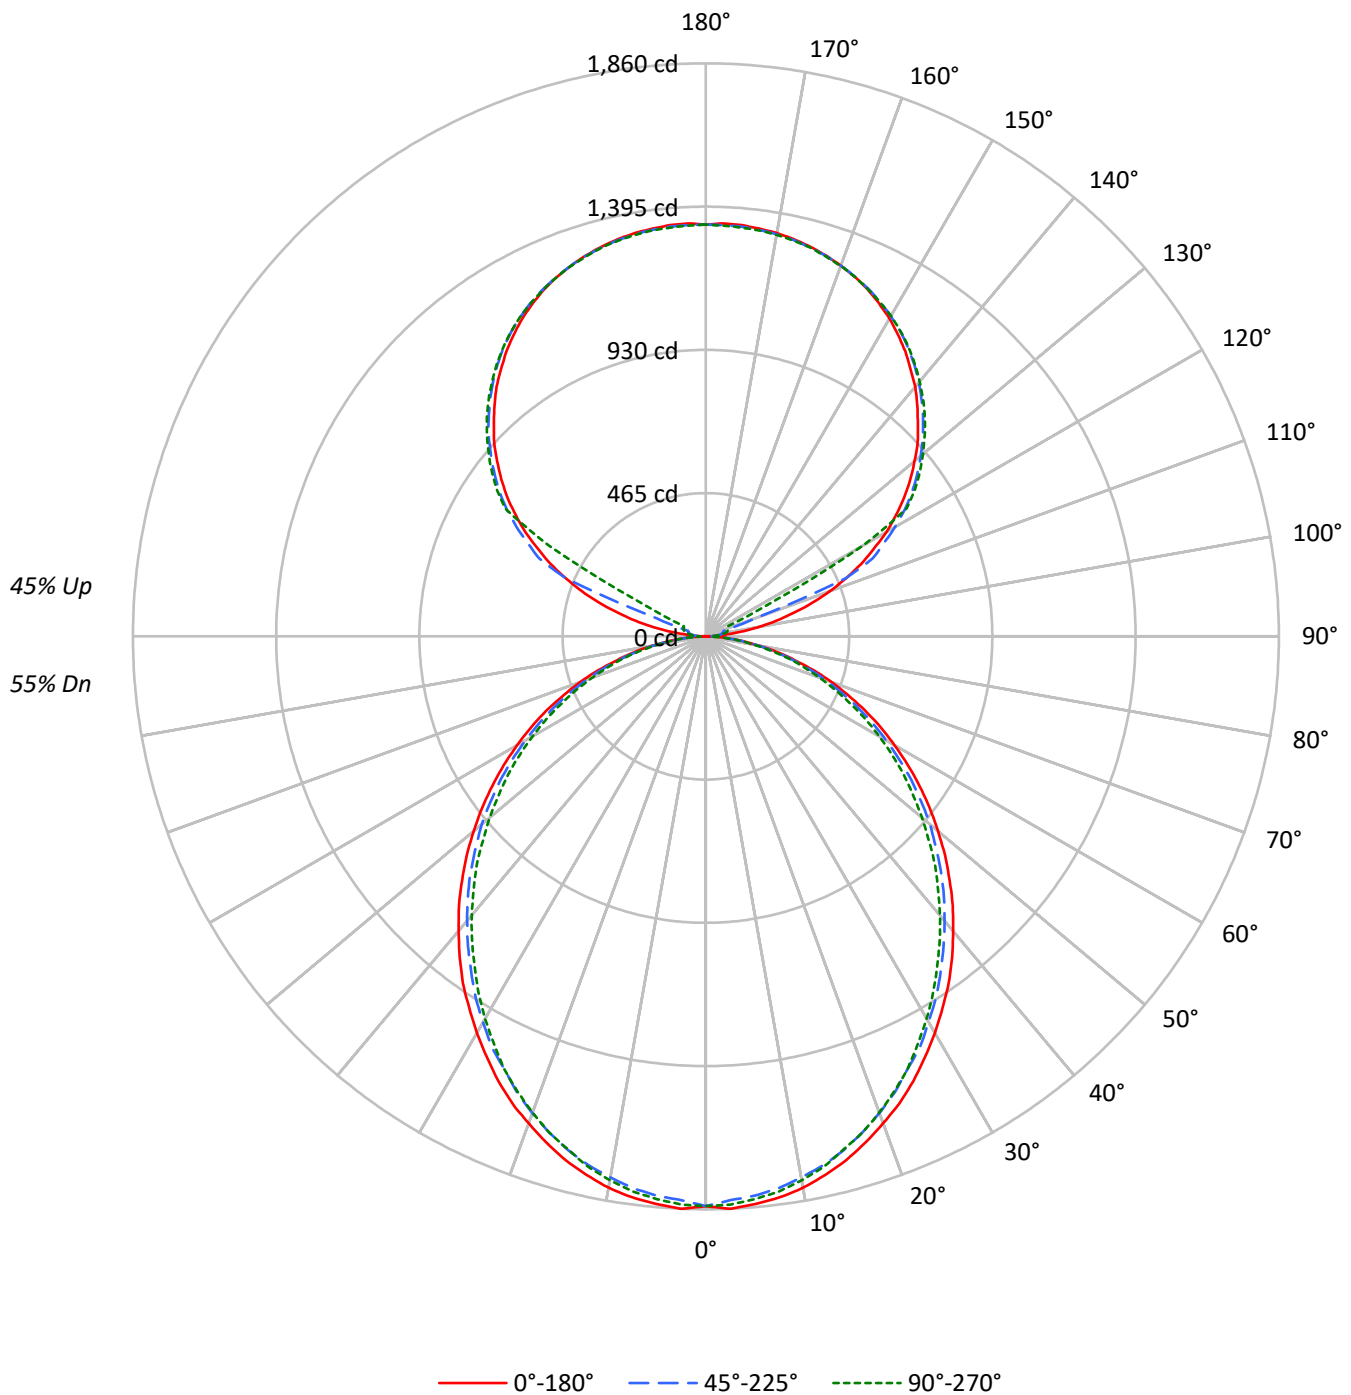

TEST NUMBER: P914601

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2119	2119	2119
5°	2121	2088	2103
10°	2103	2059	2074
15°	2070	2023	2029
20°	2027	1975	1982
25°	1984	1917	1929
30°	1931	1863	1861
35°	1880	1800	1790
40°	1818	1736	1722
45°	1755	1672	1652
50°	1687	1605	1571
55°	1616	1526	1497
60°	1535	1434	1412
65°	1447	1338	1311
70°	1334	1221	1203
75°	1179	1081	1102
80°	991	902	911
85°	697	597	597

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1755 cd/sqm

TEST NUMBER: P914601

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	2.0
10°-20°	489.8	5.7
20°-30°	719.8	8.3
30°-40°	836.0	9.7
40°-50°	834.9	9.7
50°-60°	728.0	8.4
60°-70°	538.2	6.2
70°-80°	304.5	3.5
80°-90°	82.7	1.0
90°-100°	44.1	0.5
100°-110°	164.3	1.9
110°-120°	435.8	5.1
120°-130°	722.8	8.4
130°-140°	767.8	8.9
140°-150°	713.6	8.3
150°-160°	573.7	6.7
160°-170°	369.7	4.3
170°-180°	127.2	1.5
0°-30°	1383.6	16.0
0°-40°	2219.6	25.7
0°-60°	3782.5	43.8
0°-90°	4707.9	54.6
90°-120°	644.2	7.5
90°-150°	2848.4	33.0
90°-180°	3919.0	45.4
0°-180°	8626.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	1	12	19	24	26	8
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914601

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P914601

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914601

CATALOG NUMBER: DFN2DIP-SQ3F0-060D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.26	11.16	11.18	12.10	13.30	9.82	10.72	10.73	11.65	12.86
	3H	11.92	12.73	12.85	13.67	14.90	11.43	12.24	12.36	13.18	14.41
	4H	12.51	13.27	13.45	14.22	15.46	12.01	12.78	12.95	13.73	14.97
	6H	12.90	13.61	13.86	14.57	15.82	12.40	13.11	13.36	14.07	15.32
	8H	13.01	13.68	13.97	14.65	15.90	12.51	13.18	13.47	14.15	15.40
	12H	13.06	13.70	14.02	14.66	15.94	12.55	13.19	13.51	14.15	15.43
4H	2H	10.72	11.49	11.67	12.44	13.68	10.37	11.13	11.32	12.08	13.32
	3H	12.59	13.23	13.55	14.21	15.46	12.18	12.82	13.14	13.80	15.05
	4H	13.30	13.88	14.27	14.86	16.13	12.87	13.46	13.84	14.43	15.71
	6H	13.81	14.32	14.79	15.31	16.59	13.38	13.88	14.36	14.88	16.16
	8H	13.96	14.43	14.94	15.42	16.71	13.52	13.99	14.51	14.99	16.27
	12H	14.03	14.46	15.03	15.47	16.76	13.58	14.01	14.59	15.02	16.31
8H	4H	13.49	13.97	14.48	14.96	16.25	13.12	13.59	14.10	14.58	15.87
	6H	14.12	14.51	15.13	15.54	16.83	13.74	14.13	14.75	15.16	16.45
	8H	14.34	14.68	15.36	15.70	17.01	13.95	14.29	14.96	15.31	16.62
	12H	14.47	14.77	15.49	15.79	17.14	14.06	14.36	15.08	15.38	16.73
12H	4H	13.48	13.91	14.48	14.91	16.21	13.11	13.54	14.11	14.55	15.84
	6H	14.15	14.49	15.17	15.51	16.82	13.78	14.12	14.79	15.14	16.45
	8H	14.39	14.69	15.41	15.71	17.06	14.01	14.31	15.03	15.33	16.68