

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914608

Luminaire Tested: DFN2DIP-SQ3F0-060D070US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914608
REPORT IS A COMBINATION OF REPORTS P899919 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D070US927-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9613.1 lumens
Efficiency: N/A
Efficacy: 90.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914608

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US927-FLLFLL

Luminous Intensity Polar Plot

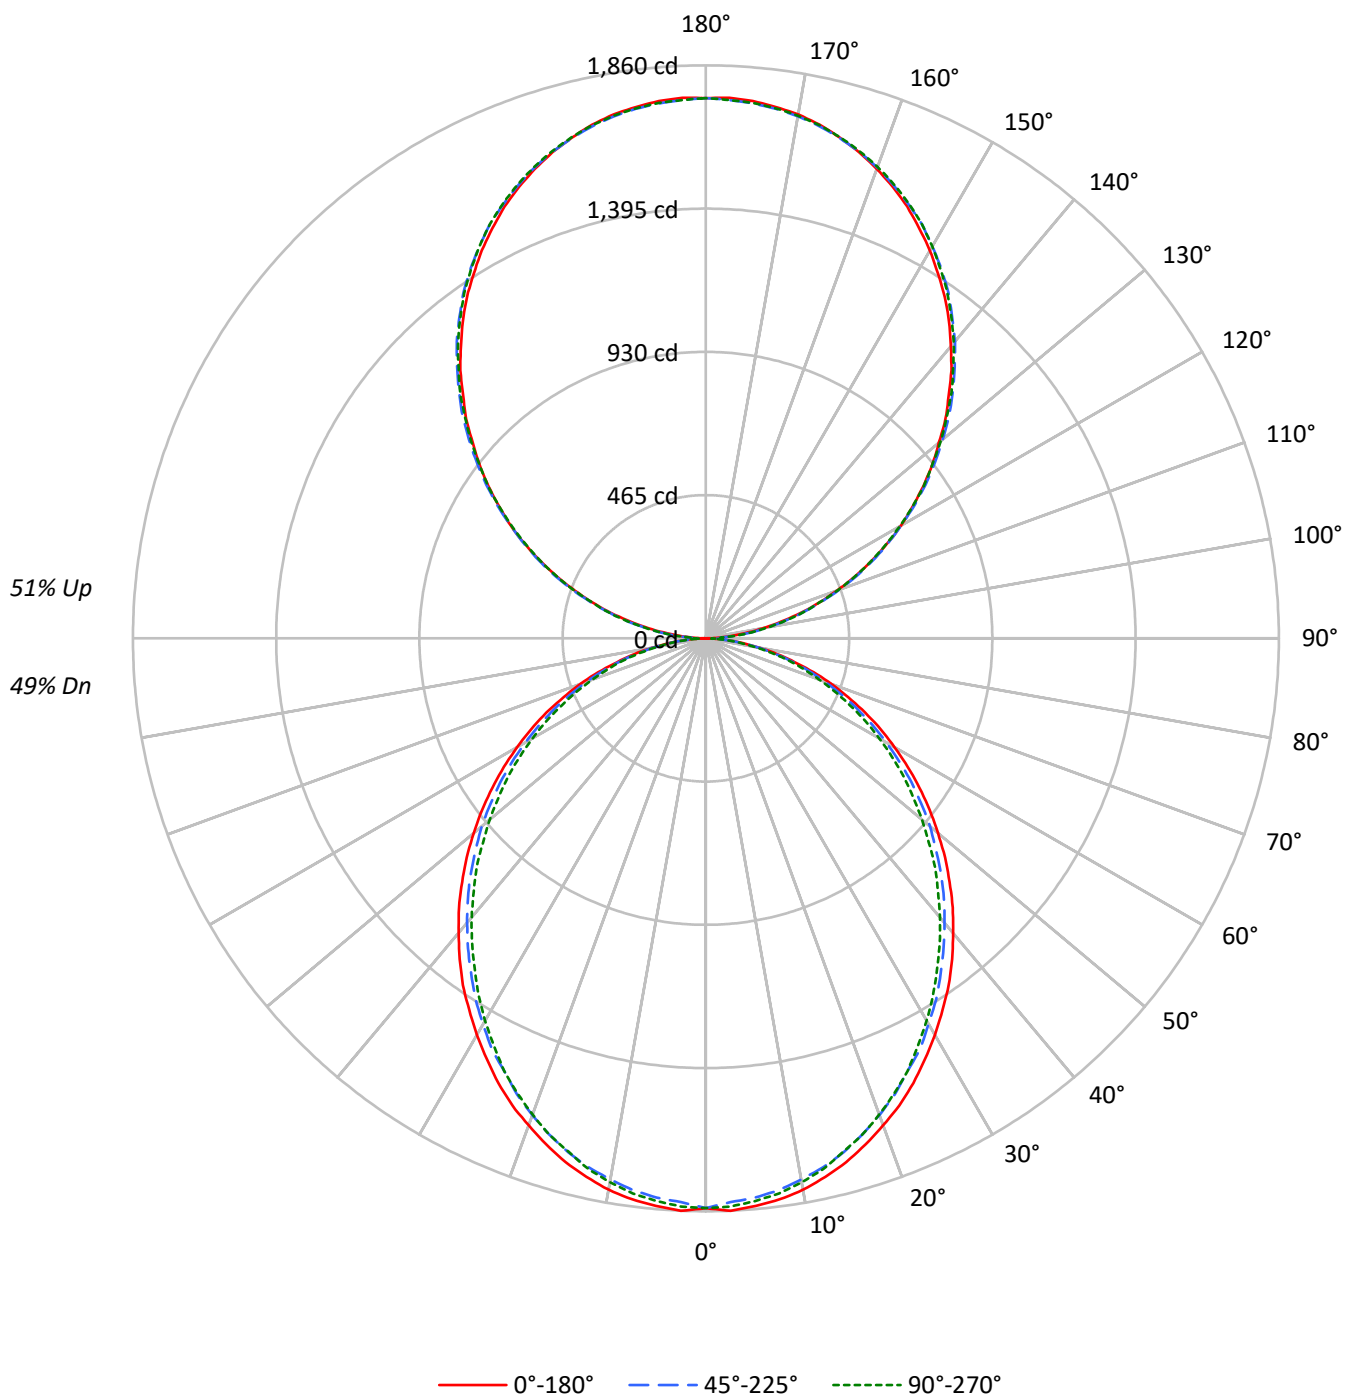

TEST NUMBER: P914608

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2119	2119	2119
5°	2121	2088	2103
10°	2103	2059	2074
15°	2070	2023	2029
20°	2027	1975	1982
25°	1984	1917	1929
30°	1931	1863	1861
35°	1880	1800	1790
40°	1818	1736	1722
45°	1755	1672	1652
50°	1687	1605	1571
55°	1616	1526	1497
60°	1535	1434	1412
65°	1447	1338	1311
70°	1334	1221	1203
75°	1179	1081	1102
80°	991	902	911
85°	697	597	597

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1763 cd/sqm

TEST NUMBER: P914608

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	1.8
10°-20°	489.8	5.1
20°-30°	719.8	7.5
30°-40°	836.0	8.7
40°-50°	834.9	8.7
50°-60°	728.0	7.6
60°-70°	538.2	5.6
70°-80°	304.5	3.2
80°-90°	85.3	0.9
90°-100°	108.5	1.1
100°-110°	344.8	3.6
110°-120°	590.1	6.1
120°-130°	776.1	8.1
130°-140°	871.1	9.1
140°-150°	854.2	8.9
150°-160°	716.6	7.5
160°-170°	475.2	4.9
170°-180°	166.1	1.7
0°-30°	1383.6	14.4
0°-40°	2219.6	23.1
0°-60°	3782.5	39.3
0°-90°	4710.5	49.0
90°-120°	1043.4	10.9
90°-150°	3544.8	36.9
90°-180°	4903.0	51.0
0°-180°	9613.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	2	19	52	49	50	9
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1372	1373	1367	845
155°	1546	1551	1556	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P914608

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	1.6	19.0	51.8	48.6	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.7	94.7	92.0
97.5°	128.5	142.2	148.1	148.1	148.1
100°	187.7	199.9	204.1	204.1	202.5
102.5°	250.1	259.0	264.9	266.5	264.9
105°	318.3	322.5	325.7	328.4	328.4
107.5°	386.0	392.3	392.3	393.4	386.0
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P914608

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.4	531.4	529.8	525.5	522.4
115°	592.2	600.6	598.0	596.4	592.2
117.5°	661.4	673.0	665.7	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.1	797.8	794.6
125°	861.3	874.5	870.3	865.5	864.0
127.5°	926.3	942.7	936.9	930.6	926.3
130°	987.1	1006.1	1003.5	1000.4	994.5
132.5°	1055.3	1070.2	1071.2	1063.8	1059.5
135°	1114.0	1130.4	1133.6	1131.9	1127.7
137.5°	1179.6	1192.8	1195.4	1194.4	1188.0
140°	1237.2	1250.5	1257.8	1257.8	1252.0
142.5°	1296.4	1309.6	1313.8	1315.4	1309.6
145°	1352.5	1363.0	1371.5	1373.1	1367.3
147.5°	1402.7	1415.9	1422.3	1424.9	1419.1
150°	1454.5	1463.5	1469.3	1474.1	1469.3
152.5°	1500.5	1509.5	1516.9	1522.7	1516.9
155°	1546.5	1550.7	1555.5	1562.9	1558.1
157.5°	1586.2	1589.4	1592.0	1602.6	1595.1
160°	1621.6	1624.8	1626.3	1635.3	1629.0
162.5°	1654.4	1654.4	1656.0	1666.0	1658.6
165°	1682.4	1680.8	1680.8	1691.4	1683.9
167.5°	1707.8	1703.0	1703.0	1713.6	1706.2
170°	1726.8	1722.6	1721.0	1731.5	1722.6
172.5°	1740.0	1735.7	1734.2	1744.8	1735.7
175°	1750.6	1746.4	1743.2	1753.7	1744.8
177.5°	1756.4	1752.1	1749.0	1758.0	1749.0
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P914608

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.75	10.60	10.72	11.58	12.87	9.31	10.16	10.27	11.14	12.43
	3H	11.41	12.17	12.38	13.16	14.47	10.92	11.68	11.89	12.67	13.98
	4H	11.99	12.72	12.98	13.71	15.02	11.50	12.22	12.49	13.21	14.53
	6H	12.39	13.05	13.39	14.05	15.38	11.89	12.55	12.89	13.55	14.88
	8H	12.49	13.13	13.50	14.14	15.47	11.99	12.62	13.00	13.64	14.96
	12H	12.54	13.14	13.55	14.15	15.50	12.03	12.63	13.04	13.64	14.99
4H	2H	10.21	10.93	11.20	11.93	13.24	9.85	10.58	10.85	11.57	12.89
	3H	12.07	12.67	13.07	13.69	15.02	11.66	12.26	12.67	13.29	14.62
	4H	12.78	13.33	13.79	14.35	15.70	12.35	12.91	13.37	13.92	15.27
	6H	13.29	13.76	14.31	14.80	16.15	12.86	13.33	13.88	14.37	15.72
	8H	13.44	13.88	14.46	14.91	16.28	13.00	13.44	14.02	14.47	15.84
	12H	13.51	13.91	14.55	14.95	16.32	13.06	13.46	14.10	14.51	15.87
8H	4H	12.97	13.41	14.00	14.45	15.81	12.59	13.04	13.62	14.07	15.43
	6H	13.59	13.96	14.64	15.04	16.40	13.21	13.58	14.26	14.65	16.01
	8H	13.81	14.14	14.87	15.19	16.57	13.42	13.74	14.48	14.80	16.18
	12H	13.94	14.22	15.00	15.28	16.70	13.53	13.81	14.59	14.87	16.29
12H	4H	12.95	13.36	14.00	14.40	15.77	12.59	12.99	13.63	14.03	15.40
	6H	13.62	13.95	14.68	15.00	16.39	13.25	13.57	14.31	14.63	16.01
	8H	13.86	14.15	14.92	15.20	16.62	13.48	13.76	14.54	14.82	16.24