

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914637

Luminaire Tested: DFN2DIP-SQ3F0-070D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914637
REPORT IS A COMBINATION OF REPORTS P901405 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D050US927-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9411.1 lumens
Efficiency: N/A
Efficacy: 91.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914637

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US927-FLLONL

Luminous Intensity Polar Plot

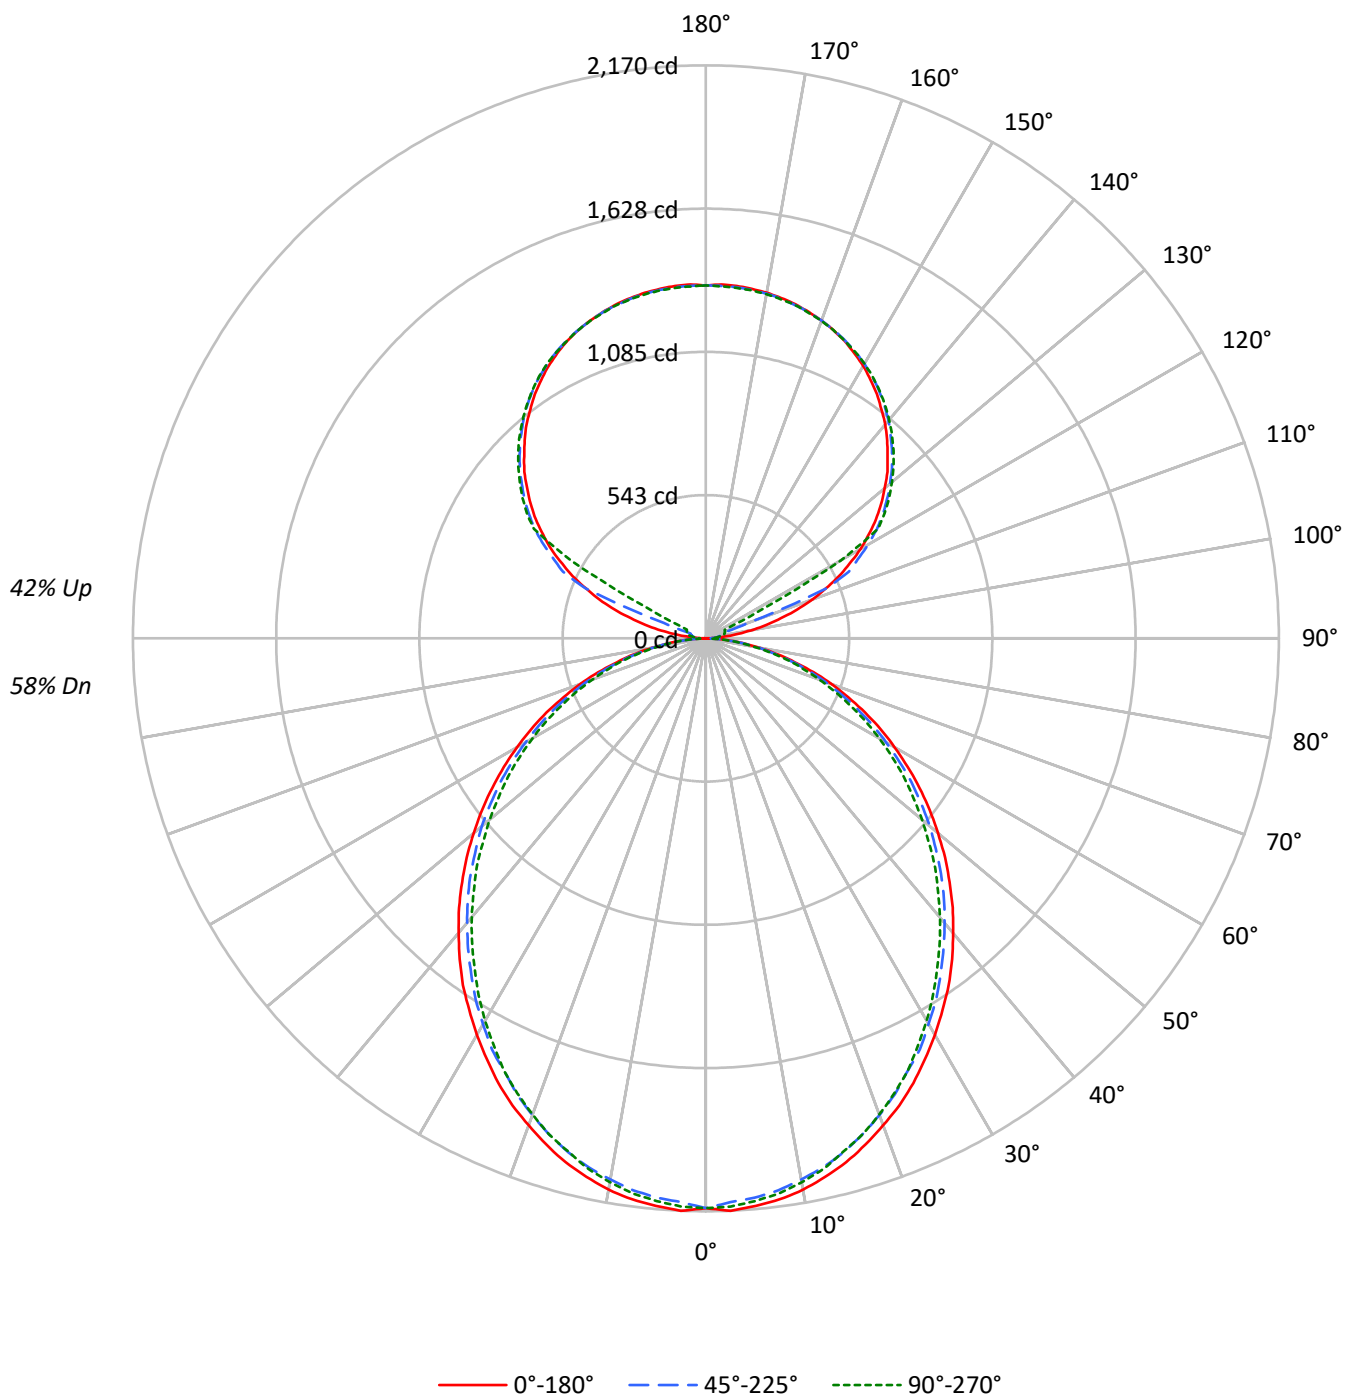

TEST NUMBER: P914637

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	53	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2472	2472	2472
5°	2475	2436	2453
10°	2453	2402	2419
15°	2415	2361	2367
20°	2365	2304	2313
25°	2315	2237	2251
30°	2253	2174	2172
35°	2193	2100	2088
40°	2121	2025	2009
45°	2048	1951	1927
50°	1969	1872	1833
55°	1885	1781	1746
60°	1791	1673	1647
65°	1688	1561	1530
70°	1557	1425	1404
75°	1375	1261	1286
80°	1156	1052	1062
85°	814	697	695

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2048 cd/sqm

TEST NUMBER: P914637

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.2
10°-20°	571.4	6.1
20°-30°	839.7	8.9
30°-40°	975.3	10.4
40°-50°	974.1	10.4
50°-60°	849.4	9.0
60°-70°	627.9	6.7
70°-80°	355.2	3.8
80°-90°	96.1	1.0
90°-100°	44.1	0.5
100°-110°	164.3	1.7
110°-120°	435.8	4.6
120°-130°	722.8	7.7
130°-140°	767.8	8.2
140°-150°	713.6	7.6
150°-160°	573.7	6.1
160°-170°	369.7	3.9
170°-180°	127.2	1.4
0°-30°	1614.2	17.2
0°-40°	2589.5	27.5
0°-60°	4412.9	46.9
0°-90°	5492.2	58.4
90°-120°	644.2	6.8
90°-150°	2848.4	30.3
90°-180°	3919.0	41.6
0°-180°	9411.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	12	19	24	26	9
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914637

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P914637

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914637

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.12	12.06	12.00	12.96	14.11	10.68	11.62	11.56	12.52	13.67
	3H	12.78	13.63	13.68	14.54	15.71	12.29	13.14	13.19	14.05	15.22
	4H	13.37	14.17	14.28	15.09	16.27	12.88	13.68	13.79	14.59	15.78
	6H	13.77	14.51	14.69	15.43	16.63	13.27	14.01	14.19	14.93	16.13
	8H	13.88	14.58	14.81	15.52	16.71	13.37	14.08	14.30	15.02	16.21
	12H	13.93	14.59	14.86	15.53	16.75	13.42	14.08	14.35	15.02	16.24
4H	2H	11.59	12.39	12.50	13.30	14.49	11.23	12.03	12.15	12.95	14.13
	3H	13.46	14.12	14.38	15.07	16.27	13.05	13.71	13.97	14.66	15.86
	4H	14.17	14.78	15.11	15.72	16.94	13.75	14.35	14.68	15.30	16.52
	6H	14.68	15.21	15.63	16.18	17.40	14.25	14.78	15.20	15.74	16.97
	8H	14.83	15.32	15.79	16.29	17.52	14.40	14.89	15.35	15.85	17.08
	12H	14.91	15.35	15.88	16.33	17.57	14.46	14.90	15.43	15.88	17.12
8H	4H	14.37	14.86	15.32	15.82	17.06	13.99	14.48	14.94	15.44	16.68
	6H	15.00	15.40	15.97	16.41	17.64	14.61	15.02	15.59	16.02	17.26
	8H	15.21	15.57	16.20	16.57	17.82	14.82	15.18	15.81	16.17	17.43
	12H	15.35	15.66	16.34	16.65	17.95	14.94	15.25	15.93	16.24	17.54
12H	4H	14.36	14.80	15.33	15.78	17.02	13.99	14.43	14.96	15.41	16.65
	6H	15.03	15.39	16.01	16.38	17.63	14.65	15.01	15.64	16.00	17.26
	8H	15.27	15.58	16.26	16.57	17.87	14.89	15.20	15.88	16.19	17.49