

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914643

Luminaire Tested: DFN2DIP-SQ3F0-070D060US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914643
REPORT IS A COMBINATION OF REPORTS P901424 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D060US927-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9419.0 lumens
Efficiency: N/A
Efficacy: 85.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914643

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US927-RLLONL

Luminous Intensity Polar Plot

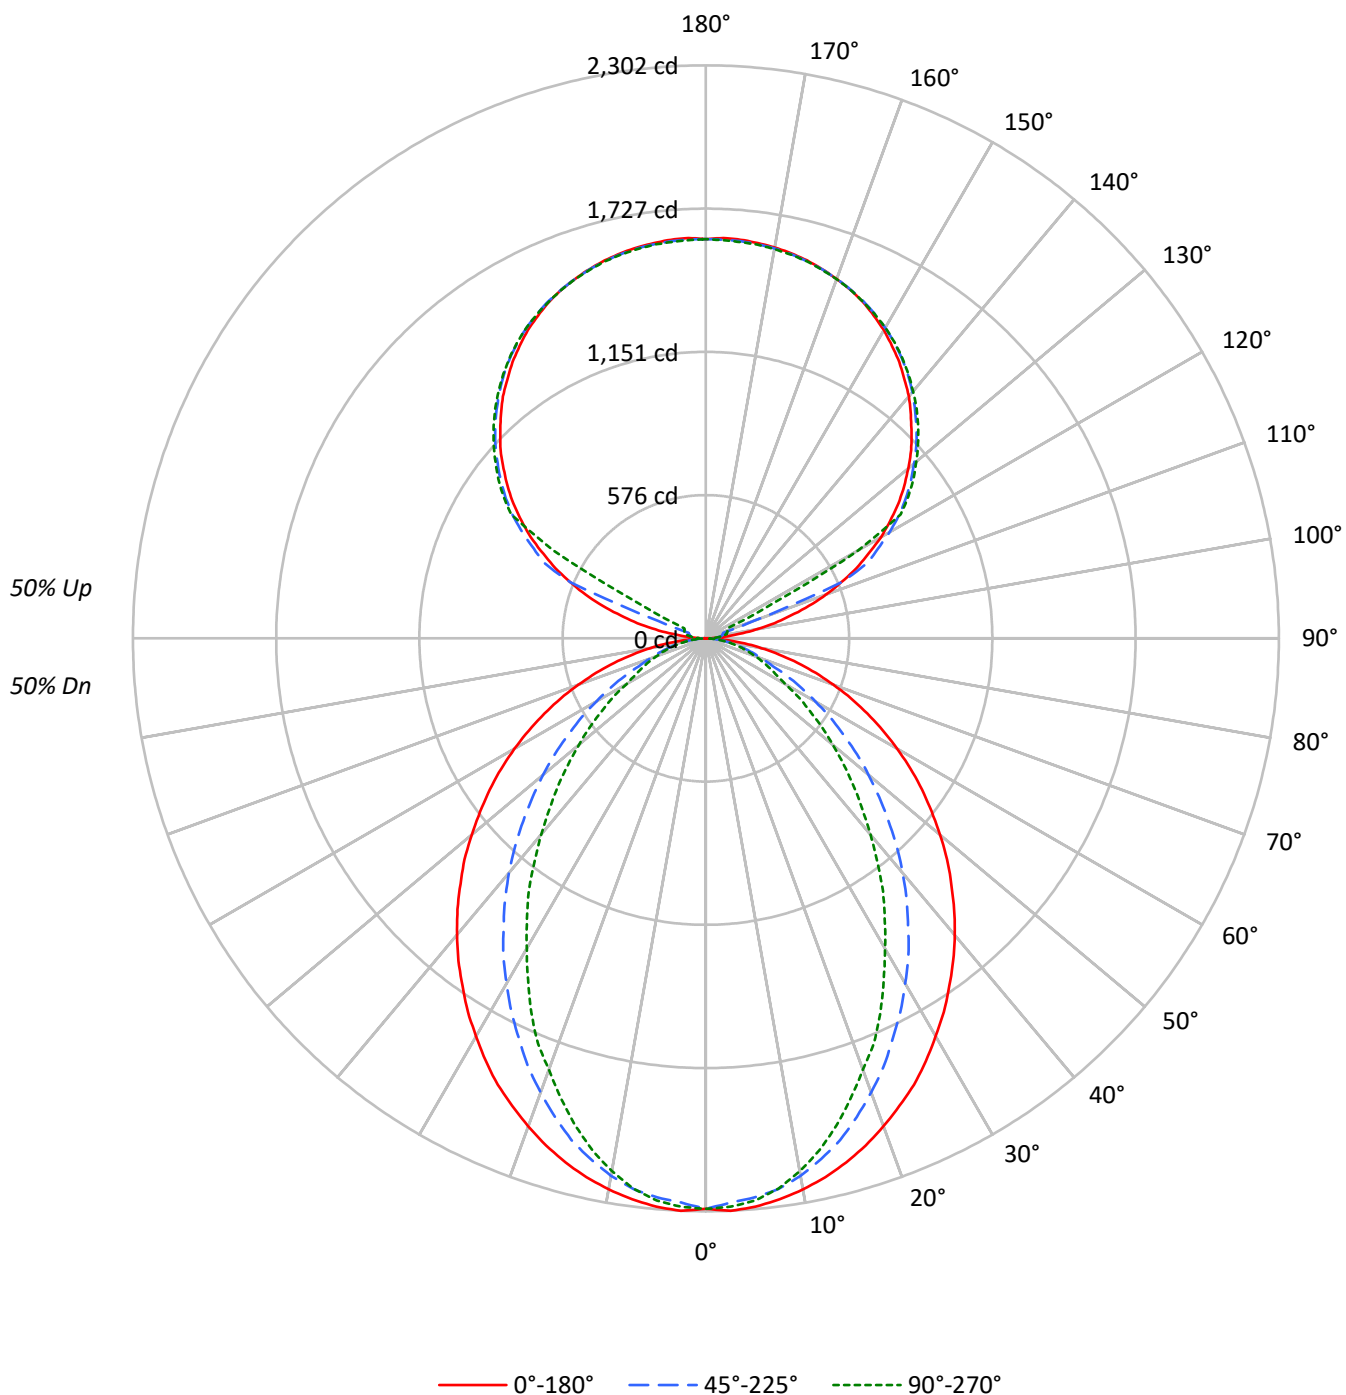

TEST NUMBER: P914643

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2626	2626	2626
5°	2629	2583	2600
10°	2601	2530	2515
15°	2563	2445	2383
20°	2514	2328	2222
25°	2464	2197	2066
30°	2397	2063	1869
35°	2331	1920	1696
40°	2265	1771	1498
45°	2187	1606	1318
50°	2107	1440	1143
55°	2023	1263	974
60°	1925	1078	801
65°	1813	890	720
70°	1677	715	650
75°	1506	627	590
80°	1258	520	508
85°	853	339	377

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2187 cd/sqm

TEST NUMBER: P914643

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	2.3
10°-20°	589.7	6.3
20°-30°	827.9	8.8
30°-40°	902.4	9.6
40°-50°	829.4	8.8
50°-60°	651.4	6.9
60°-70°	424.0	4.5
70°-80°	218.2	2.3
80°-90°	58.5	0.6
90°-100°	52.9	0.6
100°-110°	197.2	2.1
110°-120°	523.0	5.6
120°-130°	867.4	9.2
130°-140°	921.3	9.8
140°-150°	856.3	9.1
150°-160°	688.4	7.3
160°-170°	443.6	4.7
170°-180°	152.7	1.6
0°-30°	1632.3	17.3
0°-40°	2534.7	26.9
0°-60°	4015.5	42.6
0°-90°	4716.3	50.1
90°-120°	773.0	8.2
90°-150°	3418.0	36.3
90°-180°	4703.0	49.9
0°-180°	9419.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2282	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P914643

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.9	2291.9	2291.9	2291.9	2291.9
2.5°	2302.2	2291.9	2269.0	2289.9	2285.7
5°	2291.9	2281.5	2254.5	2273.2	2267.0
7.5°	2273.2	2260.8	2231.8	2239.9	2229.6
10°	2248.3	2233.8	2192.4	2186.0	2173.7
12.5°	2217.2	2198.5	2142.5	2130.1	2107.2
15°	2179.8	2157.0	2086.5	2047.2	2026.5
17.5°	2136.3	2103.1	2015.9	1970.3	1937.1
20°	2086.5	2044.9	1941.3	1889.6	1843.8
22.5°	2032.7	1984.9	1864.5	1794.1	1763.1
25°	1978.7	1912.2	1775.4	1690.4	1659.2
27.5°	1914.5	1843.8	1692.4	1595.0	1547.2
30°	1846.0	1767.0	1601.1	1495.5	1439.4
32.5°	1779.6	1684.1	1514.2	1389.6	1337.7
35°	1704.9	1599.1	1416.7	1286.0	1240.2
37.5°	1632.4	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.9	1082.7	1028.7
42.5°	1476.8	1344.1	1134.6	981.0	929.3
45°	1393.8	1254.7	1037.1	889.7	839.9
47.5°	1315.0	1167.8	943.8	796.4	750.8
50°	1227.9	1080.7	852.5	709.2	665.9
52.5°	1142.7	987.1	765.3	628.4	589.1
55°	1059.8	898.0	674.0	549.7	510.3
57.5°	974.9	808.9	593.3	477.1	443.9
60°	887.7	721.8	508.1	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.6	547.5	360.9	290.5	284.1
67.5°	632.6	464.5	290.5	255.0	248.9
70°	545.5	383.7	240.5	219.8	211.4
72.5°	462.6	309.0	201.1	184.7	180.5
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.7	122.3	118.2
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.1	45.6	39.4	39.4	39.4
87.5°	33.2	16.5	16.5	14.5	14.5
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P914643

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P914643

CATALOG NUMBER: DFN2DIP-SQ3F0-070D060US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.47	11.31	11.44	12.28	13.55	6.44	7.27	7.40	8.24	9.51
	3H	12.15	12.89	13.12	13.87	15.17	7.62	8.36	8.59	9.34	10.64
	4H	12.75	13.46	13.74	14.44	15.75	8.06	8.77	9.05	9.75	11.06
	6H	13.17	13.82	14.17	14.81	16.12	8.38	9.02	9.38	10.02	11.33
	8H	13.30	13.91	14.30	14.92	16.23	8.47	9.08	9.47	10.09	11.40
	12H	13.36	13.94	14.36	14.94	16.28	8.51	9.09	9.52	10.09	11.43
4H	2H	10.49	11.19	11.49	12.18	13.48	7.03	7.73	8.02	8.72	10.02
	3H	12.31	12.90	13.32	13.91	15.23	8.37	8.95	9.37	9.97	11.29
	4H	13.00	13.54	14.01	14.54	15.89	8.91	9.45	9.92	10.46	11.80
	6H	13.51	13.97	14.54	15.00	16.34	9.33	9.78	10.35	10.82	12.15
	8H	13.69	14.11	14.71	15.14	16.49	9.45	9.88	10.47	10.90	12.26
	12H	13.78	14.16	14.82	15.20	16.56	9.51	9.90	10.55	10.94	12.30
8H	4H	12.97	13.40	13.99	14.42	15.77	9.19	9.62	10.21	10.64	12.00
	6H	13.53	13.88	14.58	14.95	16.30	9.70	10.05	10.75	11.12	12.47
	8H	13.74	14.05	14.80	15.11	16.48	9.89	10.20	10.94	11.25	12.62
	12H	13.88	14.15	14.94	15.20	16.61	10.00	10.27	11.06	11.32	12.73
12H	4H	12.92	13.31	13.96	14.35	15.70	9.19	9.58	10.24	10.62	11.98
	6H	13.50	13.82	14.56	14.87	16.24	9.75	10.06	10.80	11.11	12.48
	8H	13.72	14.00	14.78	15.04	16.45	9.95	10.23	11.01	11.27	12.69