

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914651

Luminaire Tested: DFN2DIP-SQ3F0-070D080US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914651
REPORT IS A COMBINATION OF REPORTS P901460 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D080US927-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10987.5 lumens
Efficiency: N/A
Efficacy: 87.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 126
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914651

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US927-RLLONL

Luminous Intensity Polar Plot

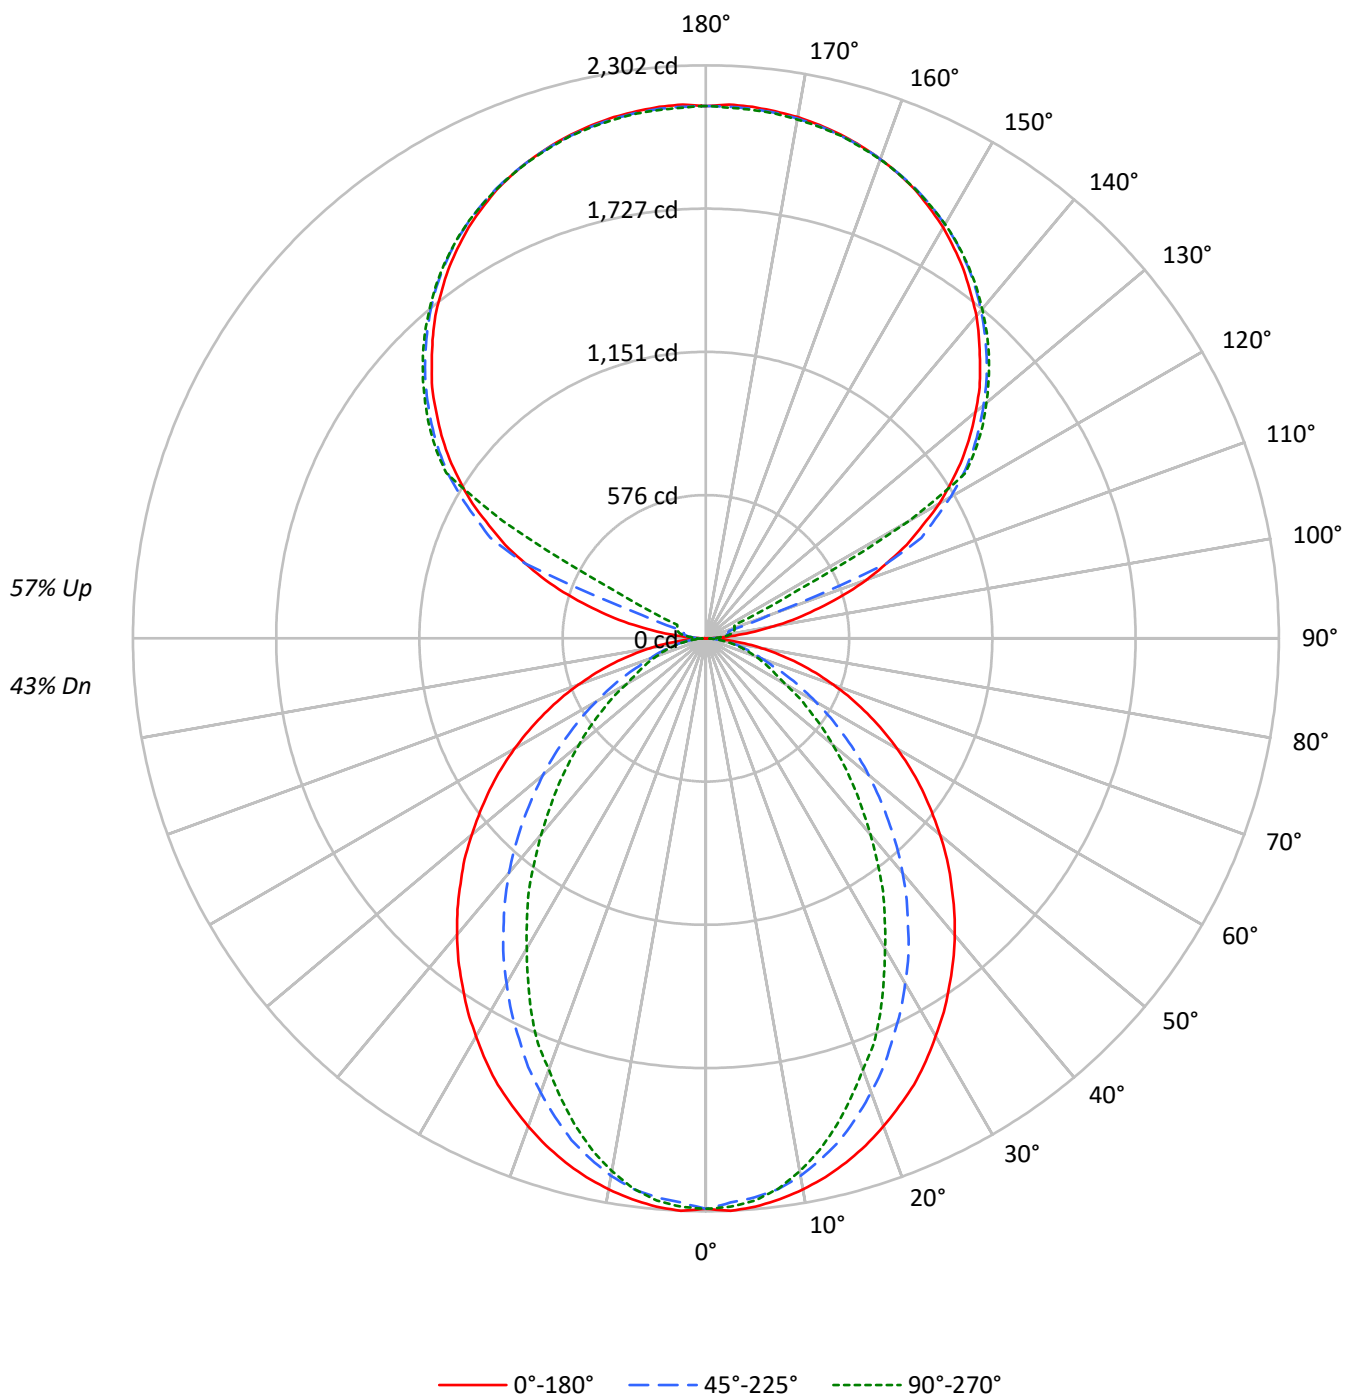

TEST NUMBER: P914651

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	97	92	89	85	88	85	82	79	70	68	66	57	55	54	44	44	43
2	88	81	75	70	81	75	70	65	62	58	55	50	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	33	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	26	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	26	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	28	24	21	22	20	17
9	50	38	31	26	46	36	29	25	30	25	22	25	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2626	2626	2626
5°	2629	2583	2600
10°	2601	2530	2515
15°	2563	2445	2383
20°	2514	2328	2222
25°	2464	2197	2066
30°	2397	2063	1869
35°	2331	1920	1696
40°	2265	1771	1498
45°	2187	1606	1318
50°	2107	1440	1143
55°	2023	1263	974
60°	1925	1078	801
65°	1813	890	720
70°	1677	715	650
75°	1506	627	590
80°	1258	520	508
85°	853	339	377

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2187 cd/sqm

TEST NUMBER: P914651

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	2.0
10°-20°	589.7	5.4
20°-30°	827.9	7.5
30°-40°	902.4	8.2
40°-50°	829.4	7.5
50°-60°	651.4	5.9
60°-70°	424.0	3.9
70°-80°	218.2	2.0
80°-90°	59.5	0.5
90°-100°	70.5	0.6
100°-110°	262.9	2.4
110°-120°	697.3	6.3
120°-130°	1156.5	10.5
130°-140°	1228.4	11.2
140°-150°	1141.7	10.4
150°-160°	917.9	8.4
160°-170°	591.5	5.4
170°-180°	203.6	1.9
0°-30°	1632.3	14.9
0°-40°	2534.7	23.1
0°-60°	4015.5	36.5
0°-90°	4717.2	42.9
90°-120°	1030.7	9.4
90°-150°	4557.3	41.5
90°-180°	6270.0	57.1
0°-180°	10987.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2282	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	2	18	31	39	42	10
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1308	1319	1323	1122
135°	1557	1582	1596	1611	1608	1203
145°	1806	1804	1831	1842	1834	1130
155°	1989	1975	1993	2003	1990	916
165°	2096	2086	2091	2102	2091	592
175°	2143	2133	2136	2146	2131	204
180°	2139	2139	2139	2139	2139	

TEST NUMBER: P914651

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.9	2291.9	2291.9	2291.9	2291.9
2.5°	2302.2	2291.9	2269.0	2289.9	2285.7
5°	2291.9	2281.5	2254.5	2273.2	2267.0
7.5°	2273.2	2260.8	2231.8	2239.9	2229.6
10°	2248.3	2233.8	2192.4	2186.0	2173.7
12.5°	2217.2	2198.5	2142.5	2130.1	2107.2
15°	2179.8	2157.0	2086.5	2047.2	2026.5
17.5°	2136.3	2103.1	2015.9	1970.3	1937.1
20°	2086.5	2044.9	1941.3	1889.6	1843.8
22.5°	2032.7	1984.9	1864.5	1794.1	1763.1
25°	1978.7	1912.2	1775.4	1690.4	1659.2
27.5°	1914.5	1843.8	1692.4	1595.0	1547.2
30°	1846.0	1767.0	1601.1	1495.5	1439.4
32.5°	1779.6	1684.1	1514.2	1389.6	1337.7
35°	1704.9	1599.1	1416.7	1286.0	1240.2
37.5°	1632.4	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.9	1082.7	1028.7
42.5°	1476.8	1344.1	1134.6	981.0	929.3
45°	1393.8	1254.7	1037.1	889.7	839.9
47.5°	1315.0	1167.8	943.8	796.4	750.8
50°	1227.9	1080.7	852.5	709.2	665.9
52.5°	1142.7	987.1	765.3	628.4	589.1
55°	1059.8	898.0	674.0	549.7	510.3
57.5°	974.9	808.9	593.3	477.1	443.9
60°	887.7	721.8	508.1	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.6	547.5	360.9	290.5	284.1
67.5°	632.6	464.5	290.5	255.0	248.9
70°	545.5	383.7	240.5	219.8	211.4
72.5°	462.6	309.0	201.1	184.7	180.5
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.7	122.3	118.2
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.1	45.6	39.4	39.4	39.4
87.5°	33.2	16.5	16.5	14.5	14.5
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.2	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.7	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.5	517.0	94.4	111.4	117.6
107.5°	580.4	618.9	97.6	114.5	120.7
110°	685.7	718.0	270.9	116.1	122.2

TEST NUMBER: P914651

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	784.7	812.5	786.2	119.1	123.9
115°	889.9	916.2	954.9	238.4	127.0
117.5°	981.2	1012.1	1038.5	817.1	411.7
120°	1083.4	1106.5	1134.5	1153.0	944.0
122.5°	1169.9	1194.8	1225.8	1235.0	1236.7
125°	1258.1	1278.3	1307.7	1318.6	1323.2
127.5°	1338.6	1360.3	1383.7	1399.1	1400.6
130°	1414.5	1439.3	1456.3	1473.4	1471.9
132.5°	1491.9	1512.1	1529.1	1543.0	1541.5
135°	1557.0	1581.7	1595.5	1611.2	1608.0
137.5°	1625.0	1643.5	1659.1	1674.6	1670.0
140°	1691.5	1704.0	1720.9	1734.9	1727.1
142.5°	1747.4	1758.2	1778.2	1790.6	1782.8
145°	1806.2	1804.5	1830.8	1841.7	1833.9
147.5°	1857.1	1852.5	1878.7	1886.5	1880.4
150°	1906.7	1895.8	1920.6	1929.8	1922.1
152.5°	1948.4	1936.1	1959.2	1968.6	1957.8
155°	1988.7	1974.9	1993.4	2002.6	1990.4
157.5°	2021.2	2008.9	2022.8	2033.7	2021.2
160°	2049.1	2039.8	2049.1	2058.3	2047.5
162.5°	2073.8	2064.6	2072.3	2083.1	2069.2
165°	2095.5	2086.3	2090.9	2101.7	2090.9
167.5°	2112.5	2103.2	2107.9	2118.8	2104.8
170°	2126.5	2117.1	2120.3	2131.1	2117.1
172.5°	2135.7	2126.5	2129.6	2140.5	2126.5
175°	2143.4	2132.6	2135.7	2146.5	2131.1
177.5°	2146.5	2135.7	2137.3	2148.2	2134.2
180°	2138.8	2138.8	2138.8	2138.8	2138.8

TEST NUMBER: P914651

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.77	10.55	10.79	11.57	12.94	5.73	6.51	6.75	7.53	8.90
	3H	11.44	12.13	12.47	13.17	14.56	6.91	7.60	7.94	8.64	10.03
	4H	12.04	12.70	13.09	13.74	15.13	7.35	8.01	8.40	9.05	10.44
	6H	12.46	13.06	13.51	14.10	15.51	7.66	8.27	8.72	9.31	10.72
	8H	12.58	13.15	13.64	14.21	15.62	7.75	8.32	8.81	9.38	10.79
	12H	12.64	13.18	13.70	14.23	15.66	7.79	8.33	8.85	9.39	10.81
4H	2H	9.78	10.44	10.83	11.47	12.87	6.32	6.97	7.37	8.01	9.41
	3H	11.60	12.14	12.66	13.21	14.62	7.65	8.20	8.71	9.27	10.68
	4H	12.28	12.78	13.35	13.84	15.27	8.20	8.70	9.26	9.75	11.19
	6H	12.79	13.22	13.87	14.30	15.73	8.60	9.03	9.68	10.11	11.54
	8H	12.96	13.36	14.04	14.44	15.88	8.73	9.13	9.80	10.20	11.64
	12H	13.05	13.42	14.14	14.50	15.95	8.79	9.15	9.88	10.23	11.68
8H	4H	12.25	12.65	13.32	13.72	15.16	8.47	8.87	9.54	9.94	11.38
	6H	12.81	13.14	13.90	14.25	15.69	8.98	9.31	10.07	10.42	11.86
	8H	13.02	13.31	14.12	14.41	15.87	9.16	9.45	10.27	10.55	12.01
	12H	13.15	13.41	14.26	14.50	16.00	9.27	9.53	10.38	10.62	12.12
12H	4H	12.20	12.56	13.29	13.64	15.09	8.47	8.83	9.56	9.92	11.37
	6H	12.78	13.07	13.88	14.17	15.63	9.02	9.31	10.13	10.41	11.87
	8H	12.99	13.25	14.10	14.34	15.84	9.23	9.48	10.33	10.57	12.07

END OF REPORT