

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914669

Luminaire Tested: DFN2DIP-SQ3F0-080D040US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914669
REPORT IS A COMBINATION OF REPORTS P901389 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D040US927-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9411.1 lumens
Efficiency: N/A
Efficacy: 88.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 106.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914669

CATALOG NUMBER: DFN2DIP-SQ3F0-080D040US927-FLLONL

Luminous Intensity Polar Plot

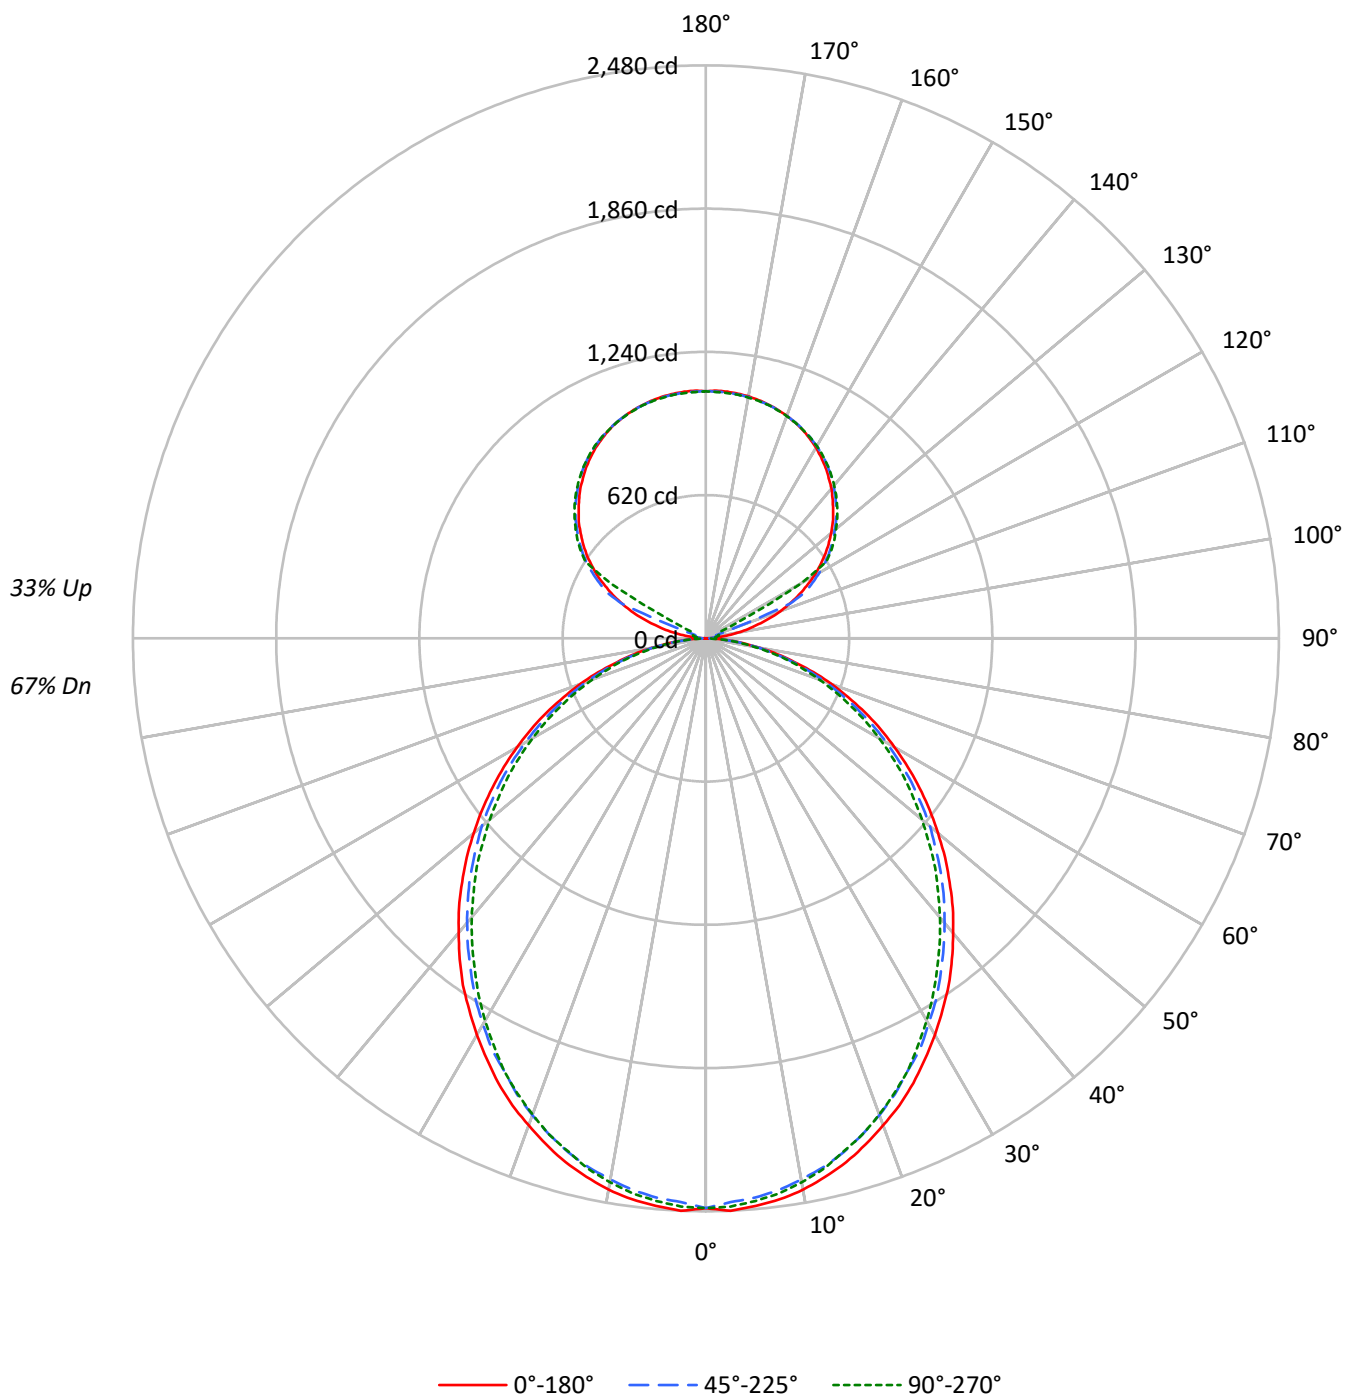

TEST NUMBER: P914669

CATALOG NUMBER: DFN2DIP-SQ3F0-080D040US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	71	71	71
1	102	97	93	90	95	92	88	85	81	79	76	72	70	68	63	62	60
2	92	85	79	73	87	80	75	70	71	67	63	63	60	57	56	53	51
3	84	75	67	61	79	71	64	58	63	58	53	56	52	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	50	43	37	45	39	34	41	35	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2825	2825	2825
5°	2828	2784	2804
10°	2803	2745	2765
15°	2761	2698	2705
20°	2703	2633	2643
25°	2646	2556	2572
30°	2574	2485	2482
35°	2507	2400	2387
40°	2424	2315	2296
45°	2341	2229	2203
50°	2250	2139	2095
55°	2155	2036	1996
60°	2047	1912	1883
65°	1929	1784	1749
70°	1779	1628	1604
75°	1571	1442	1469
80°	1321	1203	1214
85°	930	797	795

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2341 cd/sqm

TEST NUMBER: P914669

CATALOG NUMBER: DFN2DIP-SQ3F0-080D040US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.1	2.5
10°-20°	653.0	6.9
20°-30°	959.7	10.2
30°-40°	1114.6	11.8
40°-50°	1113.2	11.8
50°-60°	970.7	10.3
60°-70°	717.6	7.6
70°-80°	406.0	4.3
80°-90°	109.0	1.2
90°-100°	35.2	0.4
100°-110°	131.5	1.4
110°-120°	348.6	3.7
120°-130°	578.2	6.1
130°-140°	614.2	6.5
140°-150°	570.9	6.1
150°-160°	458.9	4.9
160°-170°	295.7	3.1
170°-180°	101.8	1.1
0°-30°	1844.8	19.6
0°-40°	2959.4	31.4
0°-60°	5043.4	53.6
0°-90°	6275.9	66.7
90°-120°	515.3	5.5
90°-150°	2278.7	24.2
90°-180°	3135.0	33.3
0°-180°	9411.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2466	2466	2466	2466	2466	
5°	2466	2457	2430	2449	2445	234
15°	2348	2333	2302	2312	2300	661
25°	2125	2106	2066	2070	2066	978
35°	1833	1809	1771	1757	1745	1145
45°	1492	1475	1439	1413	1404	1151
55°	1129	1114	1086	1058	1046	1009
65°	761	747	723	702	690	753
75°	398	394	382	368	372	425
85°	97	95	93	85	83	108
90°	1	9	15	19	21	9
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P914669

CATALOG NUMBER: DFN2DIP-SQ3F0-080D040US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2465.9	2465.9	2465.9	2465.9	2465.9
2.5°	2480.2	2468.4	2442.3	2465.9	2461.4
5°	2465.9	2456.6	2430.5	2449.3	2444.8
7.5°	2449.3	2435.2	2409.1	2428.2	2423.4
10°	2423.4	2406.8	2378.4	2397.2	2390.2
12.5°	2387.7	2373.6	2345.2	2357.0	2352.2
15°	2347.5	2333.4	2302.4	2312.0	2300.2
17.5°	2297.6	2283.5	2252.6	2264.4	2252.6
20°	2243.1	2229.0	2195.8	2202.8	2193.5
22.5°	2188.7	2167.3	2136.4	2136.4	2131.6
25°	2124.6	2105.7	2065.5	2070.0	2065.5
27.5°	2053.3	2036.8	2006.0	1999.0	1987.2
30°	1982.4	1963.3	1927.9	1920.8	1911.2
32.5°	1906.5	1892.4	1854.3	1840.0	1830.5
35°	1832.9	1809.3	1771.3	1757.0	1745.2
37.5°	1749.9	1728.5	1690.6	1674.0	1662.2
40°	1664.7	1645.5	1607.6	1586.4	1576.8
42.5°	1581.7	1562.5	1524.8	1500.9	1486.8
45°	1491.6	1475.0	1439.2	1413.3	1403.8
47.5°	1403.8	1387.2	1349.2	1323.0	1308.9
50°	1311.2	1299.4	1266.1	1233.0	1221.1
52.5°	1221.1	1204.5	1173.9	1147.7	1131.1
55°	1128.8	1114.4	1086.1	1057.6	1045.8
57.5°	1036.3	1024.4	993.5	965.0	955.4
60°	943.6	934.4	901.1	875.0	867.9
62.5°	853.6	837.0	813.3	789.7	780.1
65°	761.3	746.9	723.3	701.9	690.1
67.5°	666.4	654.3	633.2	616.6	607.0
70°	578.6	569.0	547.7	531.1	521.7
72.5°	488.5	479.0	467.1	450.6	443.5
75°	398.2	393.7	381.7	367.6	372.3
77.5°	317.7	308.2	303.4	296.4	289.3
80°	237.3	234.7	230.0	222.9	218.1
82.5°	161.3	161.3	159.0	149.4	149.4
85°	97.1	94.8	92.6	85.3	83.0
87.5°	42.8	38.0	33.2	26.1	23.7
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1

TEST NUMBER: P914669

CATALOG NUMBER: DFN2DIP-SQ3F0-080D040US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P914669

CATALOG NUMBER: DFN2DIP-SQ3F0-080D040US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.26	13.29	13.06	14.12	15.13	11.81	12.85	12.61	13.67	14.68
	3H	13.93	14.86	14.74	15.69	16.73	13.44	14.37	14.25	15.20	16.24
	4H	14.52	15.40	15.35	16.24	17.29	14.03	14.90	14.86	15.74	16.79
	6H	14.93	15.74	15.77	16.58	17.65	14.43	15.23	15.27	16.08	17.15
	8H	15.03	15.80	15.88	16.67	17.74	14.53	15.30	15.38	16.17	17.23
	12H	15.09	15.82	15.94	16.68	17.77	14.58	15.31	15.43	16.17	17.26
4H	2H	12.74	13.61	13.57	14.45	15.51	12.38	13.26	13.22	14.10	15.15
	3H	14.61	15.35	15.46	16.22	17.28	14.21	14.94	15.05	15.81	16.88
	4H	15.33	16.00	16.19	16.87	17.96	14.91	15.57	15.77	16.44	17.54
	6H	15.85	16.43	16.73	17.32	18.42	15.42	16.00	16.29	16.89	17.99
	8H	16.00	16.54	16.88	17.43	18.54	15.57	16.10	16.44	16.99	18.10
	12H	16.08	16.57	16.98	17.48	18.59	15.63	16.12	16.53	17.03	18.14
8H	4H	15.54	16.08	16.41	16.97	18.08	15.16	15.70	16.04	16.59	17.70
	6H	16.17	16.62	17.07	17.55	18.66	15.79	16.23	16.69	17.16	18.27
	8H	16.39	16.78	17.30	17.71	18.84	16.00	16.39	16.91	17.32	18.44
	12H	16.52	16.87	17.44	17.79	18.97	16.11	16.46	17.03	17.38	18.56
12H	4H	15.53	16.02	16.43	16.92	18.04	15.16	15.65	16.06	16.56	17.67
	6H	16.20	16.60	17.11	17.52	18.65	15.83	16.22	16.74	17.15	18.27
	8H	16.45	16.79	17.36	17.71	18.89	16.06	16.41	16.98	17.33	18.51