

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914682

Luminaire Tested: DFN2DIP-SQ3F0-080D070US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914682
REPORT IS A COMBINATION OF REPORTS P899924 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D070US927-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10294.4 lumens
Efficiency: N/A
Efficacy: 80.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 128.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914682

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US927-RLLFLL

Luminous Intensity Polar Plot

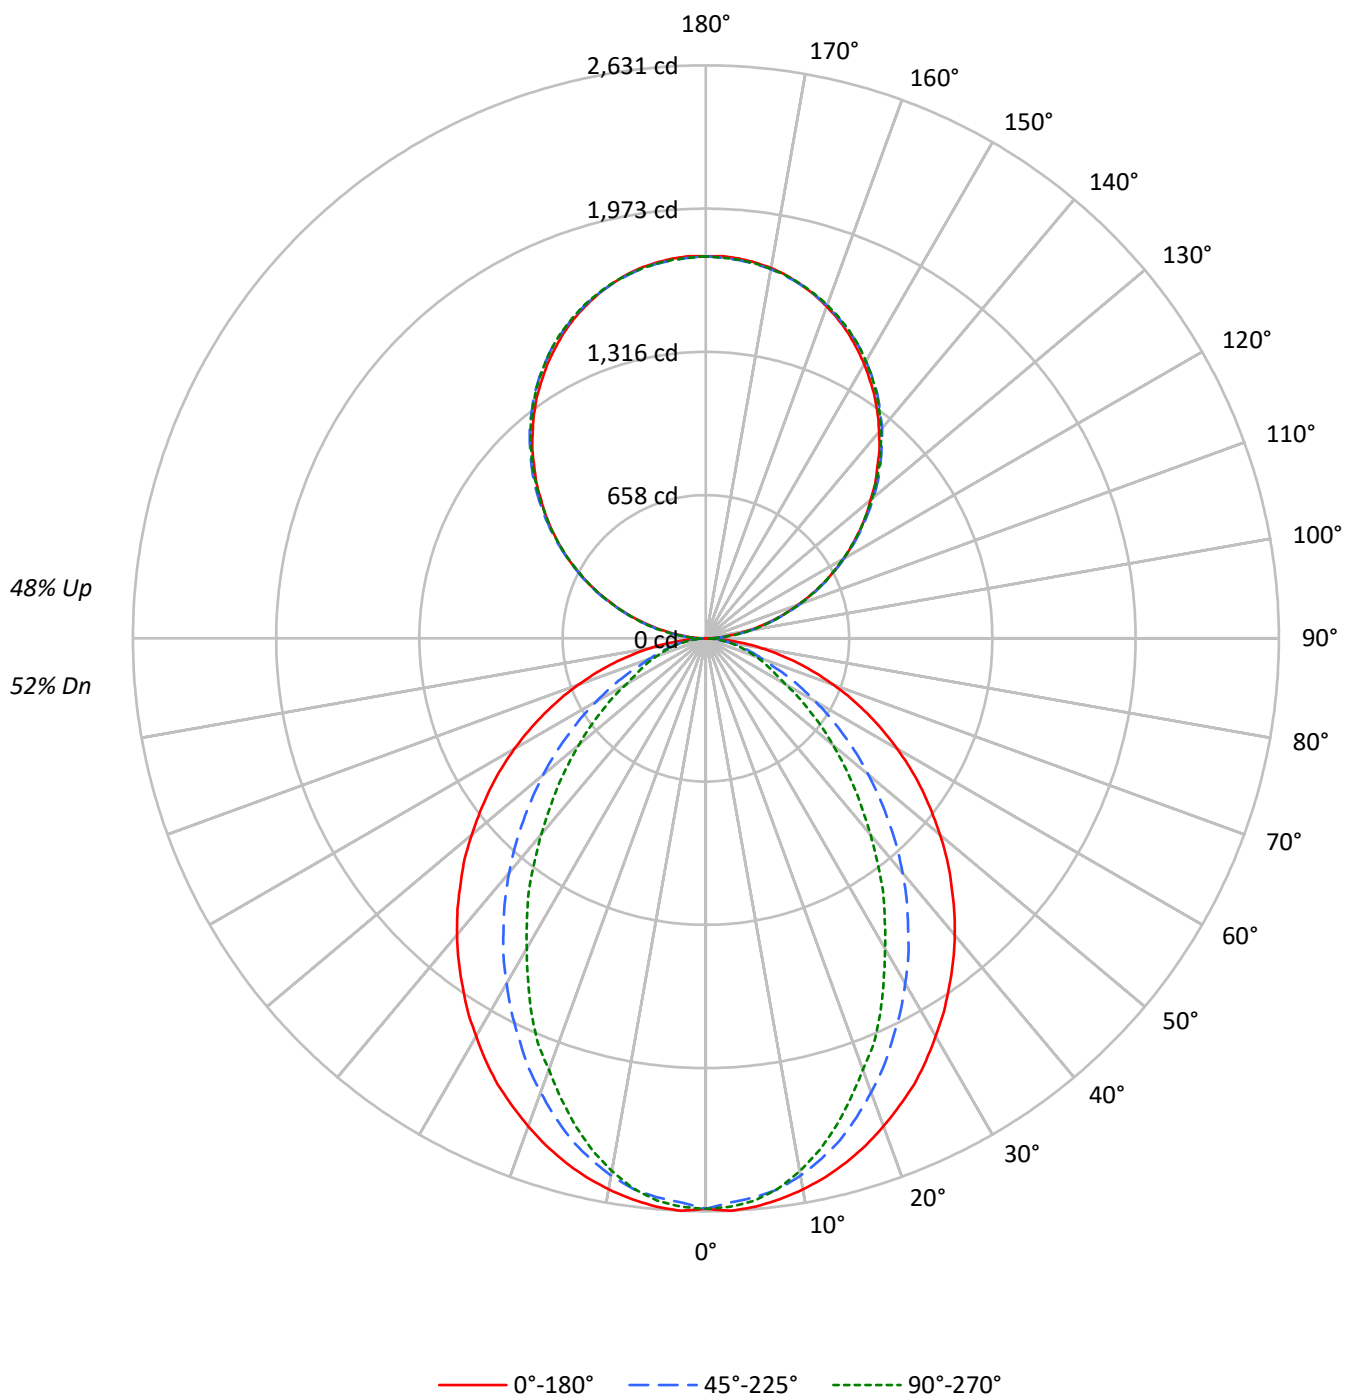

TEST NUMBER: P914682

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US927-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	99	95	91	88	91	88	85	82	75	73	71	63	62	60	52	51	50
2	90	83	77	72	83	77	72	68	66	63	59	56	53	51	47	45	43
3	83	74	67	61	76	69	62	57	59	54	50	50	47	44	42	39	37
4	76	66	58	52	70	61	54	49	53	48	43	45	41	38	38	35	33
5	70	59	51	45	65	55	48	43	47	42	38	41	36	33	34	31	29
6	65	53	45	39	60	49	42	37	43	37	33	37	33	29	31	28	25
7	60	48	40	35	55	45	38	33	39	34	30	34	29	26	29	25	23
8	56	44	36	31	52	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	38	31	26	33	28	24	29	24	21	24	21	19
10	49	37	30	25	45	35	28	24	30	25	22	26	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3001	3001	3001
5°	3004	2952	2971
10°	2972	2892	2874
15°	2930	2794	2723
20°	2874	2661	2539
25°	2816	2511	2361
30°	2740	2358	2136
35°	2665	2194	1938
40°	2588	2024	1712
45°	2500	1836	1506
50°	2408	1646	1306
55°	2312	1444	1113
60°	2200	1232	915
65°	2072	1017	823
70°	1917	817	743
75°	1721	716	674
80°	1438	595	581
85°	976	387	431

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2500 cd/sqm

TEST NUMBER: P914682

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	2.4
10°-20°	673.9	6.5
20°-30°	946.1	9.2
30°-40°	1031.3	10.0
40°-50°	947.9	9.2
50°-60°	744.4	7.2
60°-70°	484.5	4.7
70°-80°	249.4	2.4
80°-90°	68.6	0.7
90°-100°	108.5	1.1
100°-110°	344.8	3.3
110°-120°	590.1	5.7
120°-130°	776.1	7.5
130°-140°	871.1	8.5
140°-150°	854.2	8.3
150°-160°	716.6	7.0
160°-170°	475.2	4.6
170°-180°	166.1	1.6
0°-30°	1865.5	18.1
0°-40°	2896.8	28.1
0°-60°	4589.2	44.6
0°-90°	5391.8	52.4
90°-120°	1043.4	10.1
90°-150°	3544.8	34.4
90°-180°	4903.0	47.6
0°-180°	10294.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	2	19	52	49	50	10
95°	77	92	95	95	92	86
105°	318	322	326	328	328	336
115°	592	601	598	596	592	586
125°	861	874	870	866	864	770
135°	1114	1130	1134	1132	1128	861
145°	1352	1363	1372	1373	1367	845
155°	1546	1551	1556	1563	1558	712
165°	1682	1681	1681	1691	1684	475
175°	1751	1746	1743	1754	1745	166
180°	1754	1754	1754	1754	1754	

TEST NUMBER: P914682

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	1.6	19.0	51.8	48.6	50.2
92.5°	32.8	44.4	46.0	47.6	47.6
95°	77.2	92.0	94.7	94.7	92.0
97.5°	128.5	142.2	148.1	148.1	148.1
100°	187.7	199.9	204.1	204.1	202.5
102.5°	250.1	259.0	264.9	266.5	264.9
105°	318.3	322.5	325.7	328.4	328.4
107.5°	386.0	392.3	392.3	393.4	386.0
110°	451.5	460.0	460.0	460.0	455.7

TEST NUMBER: P914682

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US927-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	522.4	531.4	529.8	525.5	522.4
115°	592.2	600.6	598.0	596.4	592.2
117.5°	661.4	673.0	665.7	661.4	657.2
120°	731.2	742.8	731.2	731.2	726.4
122.5°	794.6	809.5	802.1	797.8	794.6
125°	861.3	874.5	870.3	865.5	864.0
127.5°	926.3	942.7	936.9	930.6	926.3
130°	987.1	1006.1	1003.5	1000.4	994.5
132.5°	1055.3	1070.2	1071.2	1063.8	1059.5
135°	1114.0	1130.4	1133.6	1131.9	1127.7
137.5°	1179.6	1192.8	1195.4	1194.4	1188.0
140°	1237.2	1250.5	1257.8	1257.8	1252.0
142.5°	1296.4	1309.6	1313.8	1315.4	1309.6
145°	1352.5	1363.0	1371.5	1373.1	1367.3
147.5°	1402.7	1415.9	1422.3	1424.9	1419.1
150°	1454.5	1463.5	1469.3	1474.1	1469.3
152.5°	1500.5	1509.5	1516.9	1522.7	1516.9
155°	1546.5	1550.7	1555.5	1562.9	1558.1
157.5°	1586.2	1589.4	1592.0	1602.6	1595.1
160°	1621.6	1624.8	1626.3	1635.3	1629.0
162.5°	1654.4	1654.4	1656.0	1666.0	1658.6
165°	1682.4	1680.8	1680.8	1691.4	1683.9
167.5°	1707.8	1703.0	1703.0	1713.6	1706.2
170°	1726.8	1722.6	1721.0	1731.5	1722.6
172.5°	1740.0	1735.7	1734.2	1744.8	1735.7
175°	1750.6	1746.4	1743.2	1753.7	1744.8
177.5°	1756.4	1752.1	1749.0	1758.0	1749.0
180°	1753.7	1753.7	1753.7	1753.7	1753.7

TEST NUMBER: P914682

CATALOG NUMBER: DFN2DIP-SQ3F0-080D070US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.15	12.00	12.09	12.95	14.19	7.11	7.96	8.05	8.92	10.16
	3H	12.82	13.58	13.78	14.55	15.81	8.29	9.05	9.25	10.02	11.28
	4H	13.43	14.15	14.40	15.12	16.39	8.74	9.46	9.71	10.43	11.70
	6H	13.85	14.51	14.83	15.48	16.77	9.06	9.72	10.04	10.69	11.98
	8H	13.97	14.60	14.96	15.59	16.88	9.15	9.77	10.13	10.76	12.05
	12H	14.04	14.63	15.03	15.62	16.92	9.19	9.78	10.18	10.77	12.07
4H	2H	11.17	11.89	12.14	12.86	14.13	7.71	8.42	8.68	9.39	10.66
	3H	12.99	13.59	13.98	14.59	15.87	9.05	9.65	10.03	10.65	11.93
	4H	13.68	14.23	14.68	15.22	16.53	9.59	10.14	10.59	11.13	12.44
	6H	14.20	14.66	15.20	15.68	16.99	10.01	10.48	11.01	11.49	12.80
	8H	14.37	14.81	15.37	15.81	17.14	10.13	10.57	11.14	11.58	12.90
	12H	14.46	14.86	15.48	15.88	17.21	10.19	10.59	11.22	11.61	12.94
8H	4H	13.65	14.09	14.66	15.10	16.42	9.87	10.31	10.88	11.32	12.64
	6H	14.21	14.57	15.24	15.62	16.94	10.38	10.74	11.41	11.79	13.11
	8H	14.43	14.74	15.46	15.78	17.12	10.57	10.89	11.61	11.92	13.26
	12H	14.56	14.84	15.60	15.87	17.25	10.68	10.96	11.72	11.99	13.38
12H	4H	13.60	14.00	14.63	15.02	16.35	9.88	10.27	10.90	11.30	12.62
	6H	14.19	14.51	15.23	15.54	16.88	10.43	10.75	11.47	11.79	13.12
	8H	14.41	14.69	15.45	15.72	17.10	10.64	10.92	11.68	11.95	13.33

END OF REPORT