

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914747

Luminaire Tested: DFN2DIP-SQ3F0-100D050US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914747
REPORT IS A COMBINATION OF REPORTS P901412 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D050US927-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10654.8 lumens
Efficiency: N/A
Efficacy: 78.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 135.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914747

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US927-RLLONL

Luminous Intensity Polar Plot

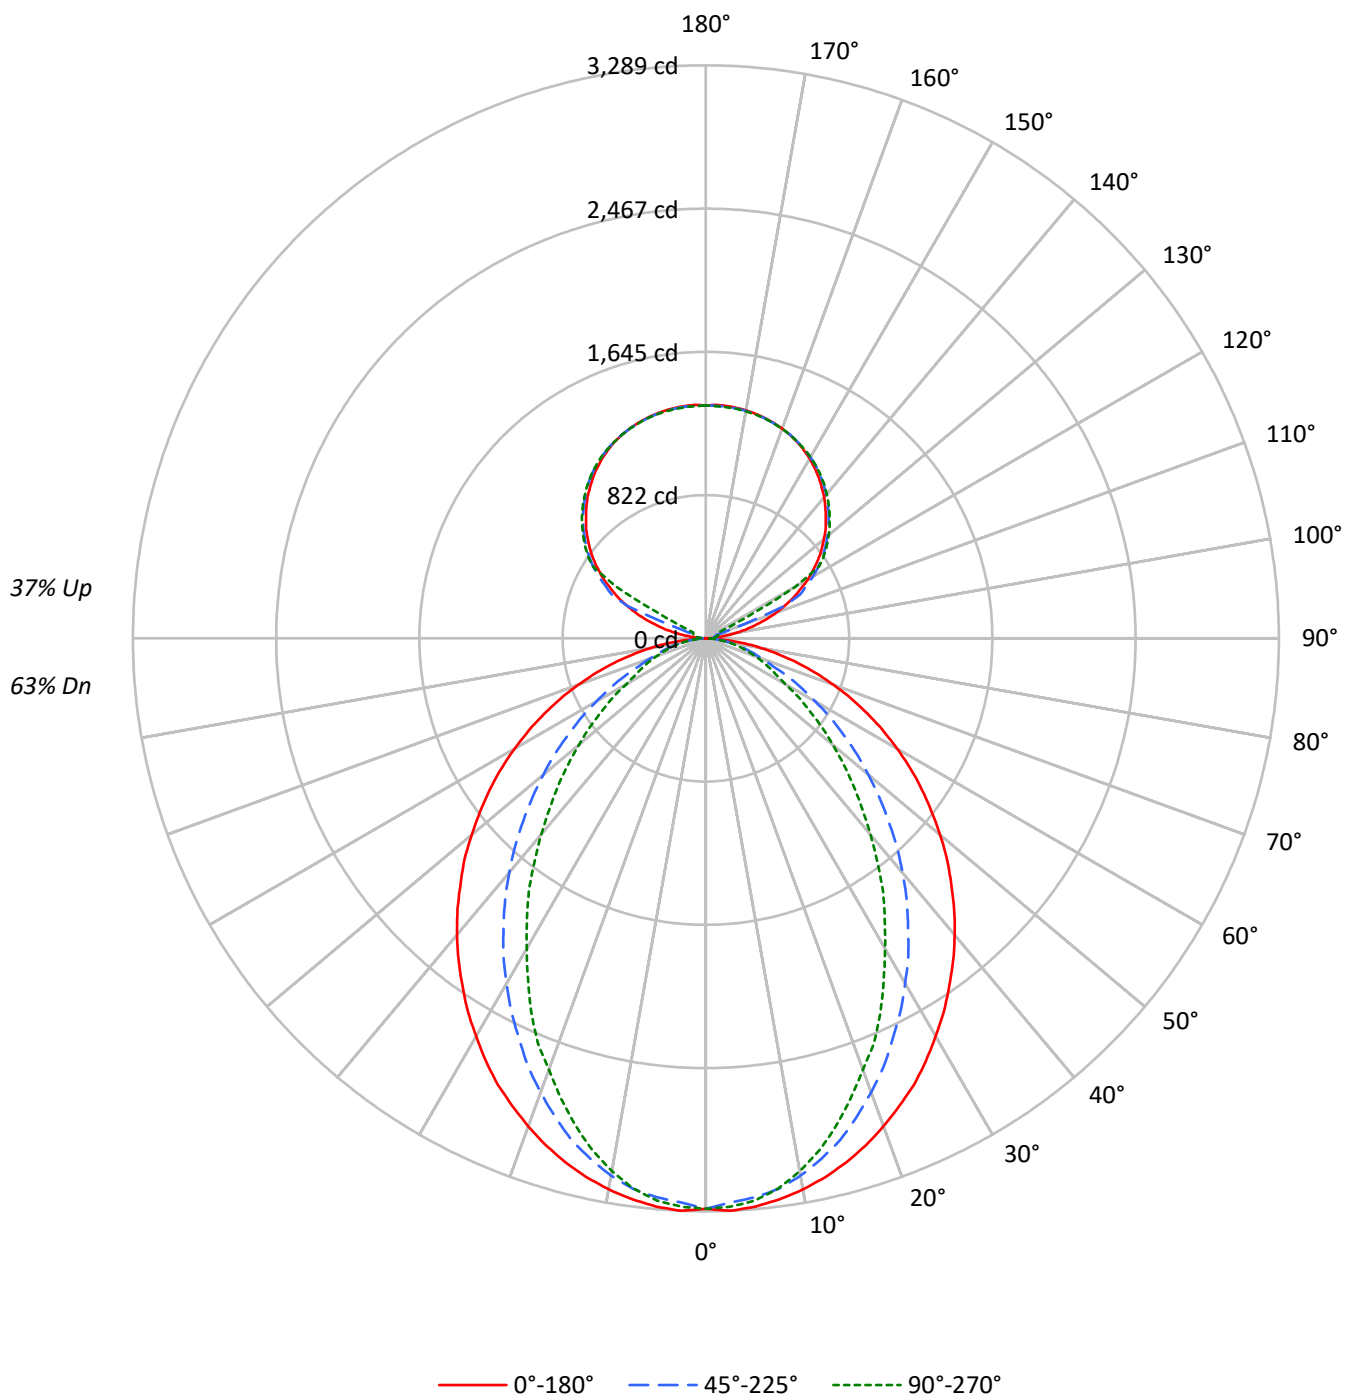

TEST NUMBER: P914747

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3751	3751	3751
5°	3755	3689	3714
10°	3715	3615	3592
15°	3662	3493	3404
20°	3592	3326	3174
25°	3520	3139	2952
30°	3425	2948	2670
35°	3331	2742	2423
40°	3235	2530	2140
45°	3124	2295	1883
50°	3010	2058	1632
55°	2890	1805	1391
60°	2751	1540	1144
65°	2590	1272	1028
70°	2396	1022	929
75°	2151	895	842
80°	1797	743	727
85°	1219	484	538

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3124 cd/sqm

TEST NUMBER: P914747

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	306.9	2.9
10°-20°	842.4	7.9
20°-30°	1182.6	11.1
30°-40°	1289.2	12.1
40°-50°	1184.9	11.1
50°-60°	930.5	8.7
60°-70°	605.7	5.7
70°-80°	311.8	2.9
80°-90°	82.0	0.8
90°-100°	44.1	0.4
100°-110°	164.3	1.5
110°-120°	435.8	4.1
120°-130°	722.8	6.8
130°-140°	767.8	7.2
140°-150°	713.6	6.7
150°-160°	573.7	5.4
160°-170°	369.7	3.5
170°-180°	127.2	1.2
0°-30°	2331.9	21.9
0°-40°	3621.0	34.0
0°-60°	5736.5	53.8
0°-90°	6735.9	63.2
90°-120°	644.2	6.0
90°-150°	2848.4	26.7
90°-180°	3919.0	36.8
0°-180°	10654.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3274	3274	3274	3274	3274	
5°	3274	3259	3221	3247	3238	310
15°	3114	3081	2981	2924	2895	878
25°	2827	2732	2536	2415	2370	1300
35°	2436	2284	2024	1837	1772	1524
45°	1991	1792	1482	1271	1200	1538
55°	1514	1283	963	785	729	1353
65°	1022	782	516	415	406	1014
75°	545	338	237	216	213	577
85°	127	65	56	56	56	146
90°	1	12	19	24	26	10
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914747

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3274.1	3274.1	3274.1	3274.1	3274.1
2.5°	3288.8	3274.1	3241.4	3271.2	3265.3
5°	3274.1	3259.3	3220.6	3247.4	3238.5
7.5°	3247.4	3229.7	3188.2	3199.9	3185.1
10°	3211.8	3191.1	3132.0	3122.9	3105.3
12.5°	3167.5	3140.8	3060.6	3043.0	3010.3
15°	3114.1	3081.3	2980.7	2924.5	2894.9
17.5°	3051.8	3004.3	2879.9	2814.8	2767.3
20°	2980.7	2921.3	2773.3	2699.4	2634.0
22.5°	2903.7	2835.5	2663.6	2563.0	2518.7
25°	2826.7	2731.8	2536.2	2414.9	2370.3
27.5°	2734.9	2634.0	2417.7	2278.5	2210.3
30°	2637.2	2524.3	2287.3	2136.4	2056.3
32.5°	2542.3	2405.8	2163.1	1985.2	1911.0
35°	2435.6	2284.5	2023.9	1837.1	1771.7
37.5°	2331.9	2168.8	1893.4	1688.8	1614.9
40°	2222.2	2044.6	1757.0	1546.7	1469.7
42.5°	2109.7	1920.1	1620.9	1401.4	1327.5
45°	1991.1	1792.5	1481.6	1271.0	1199.9
47.5°	1878.7	1668.3	1348.3	1137.7	1072.6
50°	1754.1	1543.8	1217.8	1013.2	951.3
52.5°	1632.4	1410.2	1093.4	897.8	841.5
55°	1513.9	1282.9	962.9	785.3	729.0
57.5°	1392.7	1155.6	847.6	681.5	634.1
60°	1268.1	1031.1	725.9	575.0	527.5
62.5°	1146.8	909.7	622.1	480.1	456.5
65°	1022.3	782.1	515.6	414.9	405.8
67.5°	903.8	663.6	414.9	364.3	355.5
70°	779.3	548.3	343.6	314.0	302.1
72.5°	660.8	441.3	287.3	263.7	257.8
75°	545.1	337.6	237.0	216.3	213.4
77.5°	429.8	239.9	186.7	174.8	168.8
80°	322.8	172.0	142.1	130.5	130.5
82.5°	225.1	115.7	97.8	91.8	91.8
85°	127.3	65.0	56.2	56.2	56.2
87.5°	47.5	23.6	23.6	20.8	20.8
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P914747

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914747

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.86	13.81	13.70	14.67	15.74	8.82	9.77	9.66	10.63	11.70
	3H	14.54	15.39	15.40	16.26	17.36	10.01	10.86	10.87	11.73	12.83
	4H	15.15	15.95	16.02	16.83	17.94	10.46	11.26	11.33	12.14	13.25
	6H	15.58	16.32	16.46	17.20	18.32	10.78	11.52	11.67	12.40	13.53
	8H	15.70	16.41	16.60	17.31	18.43	10.87	11.58	11.77	12.48	13.60
	12H	15.77	16.44	16.66	17.33	18.48	10.92	11.59	11.82	12.48	13.63
4H	2H	12.89	13.69	13.77	14.57	15.68	9.43	10.23	10.30	11.11	12.22
	3H	14.73	15.39	15.61	16.30	17.42	10.78	11.45	11.67	12.35	13.48
	4H	15.42	16.02	16.32	16.93	18.08	11.33	11.93	12.23	12.84	13.99
	6H	15.94	16.46	16.85	17.39	18.54	11.75	12.27	12.66	13.20	14.35
	8H	16.11	16.60	17.03	17.52	18.69	11.87	12.36	12.79	13.28	14.45
	12H	16.21	16.65	17.14	17.59	18.76	11.94	12.38	12.88	13.32	14.49
8H	4H	15.39	15.88	16.31	16.80	17.97	11.61	12.10	12.53	13.02	14.19
	6H	15.96	16.36	16.90	17.33	18.49	12.13	12.53	13.07	13.50	14.66
	8H	16.17	16.53	17.12	17.48	18.67	12.32	12.67	13.27	13.63	14.81
	12H	16.31	16.63	17.27	17.57	18.81	12.43	12.75	13.39	13.70	14.93
12H	4H	15.35	15.79	16.28	16.73	17.90	11.62	12.06	12.56	13.00	14.17
	6H	15.93	16.29	16.89	17.25	18.43	12.18	12.53	13.13	13.49	14.67
	8H	16.16	16.47	17.11	17.42	18.65	12.39	12.70	13.34	13.65	14.88

END OF REPORT