

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914749

Luminaire Tested: DFN2DIP-SQ3F0-100D060US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914749
REPORT IS A COMBINATION OF REPORTS P901429 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D060US927-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12548.1 lumens
Efficiency: N/A
Efficacy: 87.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 143.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914749

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US927-FLLONL

Luminous Intensity Polar Plot

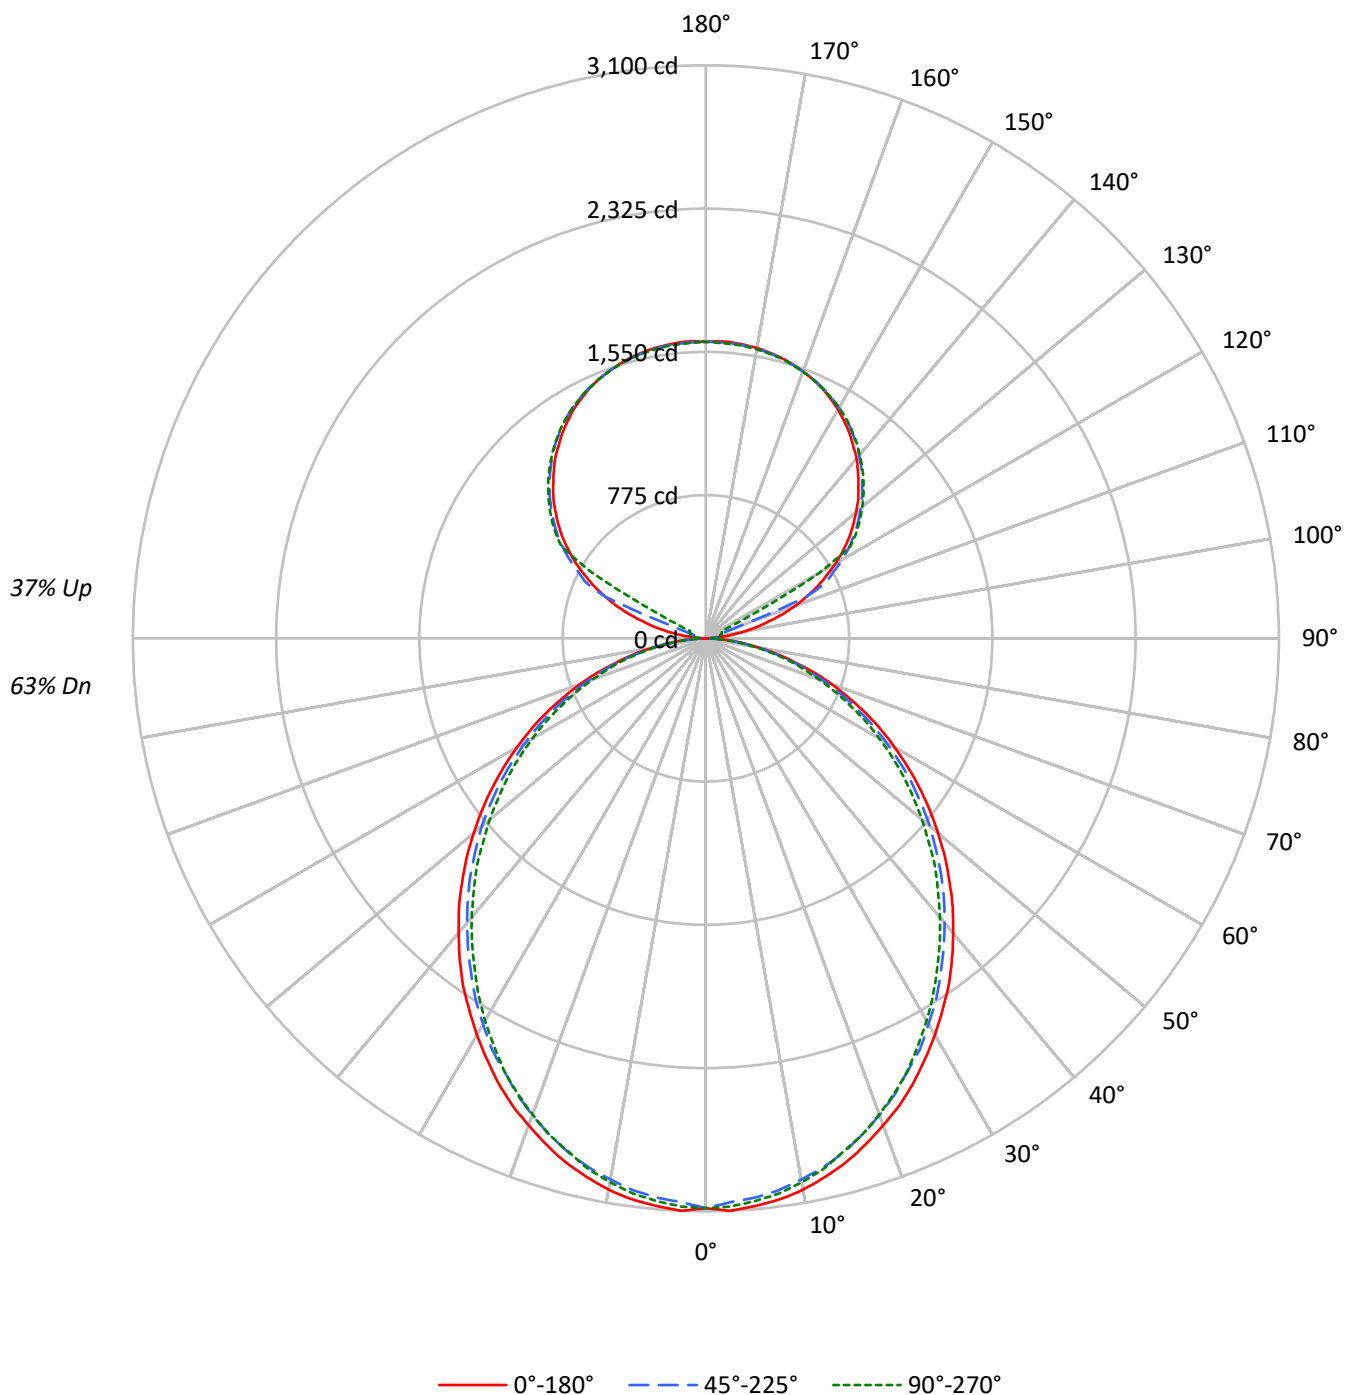

TEST NUMBER: P914749

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	65	60	58	57
2	92	84	78	72	86	79	73	69	69	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	57	61	56	52	54	50	46	47	44	41
4	77	65	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	34	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	47	39	34	56	45	38	32	40	34	30	35	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	37	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	34	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3532	3532	3532
5°	3535	3480	3505
10°	3504	3431	3456
15°	3451	3372	3381
20°	3379	3291	3304
25°	3307	3195	3215
30°	3218	3105	3102
35°	3133	3000	2983
40°	3029	2894	2870
45°	2926	2787	2754
50°	2812	2674	2619
55°	2693	2544	2495
60°	2559	2390	2353
65°	2411	2230	2186
70°	2224	2035	2005
75°	1965	1802	1837
80°	1651	1503	1518
85°	1162	996	994

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2926 cd/sqm

TEST NUMBER: P914749

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	290.1	2.3
10°-20°	816.3	6.5
20°-30°	1199.6	9.6
30°-40°	1393.3	11.1
40°-50°	1391.5	11.1
50°-60°	1213.4	9.7
60°-70°	897.0	7.1
70°-80°	507.5	4.0
80°-90°	136.8	1.1
90°-100°	52.9	0.4
100°-110°	197.2	1.6
110°-120°	523.0	4.2
120°-130°	867.4	6.9
130°-140°	921.3	7.3
140°-150°	856.3	6.8
150°-160°	688.4	5.5
160°-170°	443.6	3.5
170°-180°	152.7	1.2
0°-30°	2306.0	18.4
0°-40°	3699.3	29.5
0°-60°	6304.2	50.2
0°-90°	7845.4	62.5
90°-120°	773.0	6.2
90°-150°	3418.0	27.2
90°-180°	4703.0	37.5
0°-180°	12548.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3082	3082	3082	3082	3082	
5°	3082	3071	3038	3062	3056	293
15°	2934	2917	2878	2890	2875	826
25°	2656	2632	2582	2587	2582	1222
35°	2291	2262	2214	2196	2181	1431
45°	1864	1844	1799	1767	1755	1439
55°	1411	1393	1358	1322	1307	1262
65°	952	934	904	877	863	941
75°	498	492	477	460	465	531
85°	121	119	116	107	104	135
90°	1	14	23	29	31	12
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P914749

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3082.5	3082.5	3082.5	3082.5	3082.5
2.5°	3100.4	3085.5	3052.8	3082.5	3076.8
5°	3082.5	3070.8	3038.1	3061.7	3056.0
7.5°	3061.7	3044.0	3011.3	3035.2	3029.3
10°	3029.3	3008.5	2973.0	2996.6	2987.8
12.5°	2984.6	2967.0	2931.5	2946.3	2940.3
15°	2934.3	2916.7	2878.0	2890.0	2875.2
17.5°	2872.1	2854.5	2815.7	2830.5	2815.7
20°	2803.8	2786.2	2744.7	2753.5	2741.8
22.5°	2735.9	2709.2	2670.4	2670.4	2664.5
25°	2655.7	2632.1	2581.8	2587.4	2581.8
27.5°	2566.7	2545.9	2507.6	2498.8	2484.0
30°	2478.0	2454.1	2409.7	2400.9	2389.0
32.5°	2383.0	2365.5	2317.9	2300.0	2288.1
35°	2291.2	2261.7	2214.1	2196.2	2181.4
37.5°	2187.4	2160.7	2113.2	2092.5	2077.7
40°	2080.8	2056.9	2009.4	1983.1	1971.1
42.5°	1977.0	1953.1	1906.0	1876.1	1858.5
45°	1864.5	1843.7	1799.0	1766.6	1754.8
47.5°	1754.8	1734.0	1686.5	1653.8	1636.2
50°	1639.0	1624.2	1582.7	1541.2	1526.5
52.5°	1526.5	1505.7	1467.3	1434.6	1413.9
55°	1411.0	1393.1	1357.6	1322.0	1307.3
57.5°	1295.3	1280.5	1241.8	1206.3	1194.4
60°	1179.6	1167.9	1126.4	1093.7	1084.9
62.5°	1067.0	1046.2	1016.7	987.1	975.2
65°	951.6	933.7	904.1	877.3	862.6
67.5°	833.1	817.9	791.5	770.8	758.8
70°	723.3	711.3	684.6	663.8	652.2
72.5°	610.7	598.7	584.0	563.2	554.4
75°	497.8	492.2	477.1	459.5	465.4
77.5°	397.2	385.2	379.2	370.4	361.6
80°	296.5	293.4	287.4	278.6	272.7
82.5°	201.6	201.6	198.8	186.8	186.8
85°	121.4	118.6	115.7	106.6	103.8
87.5°	53.5	47.5	41.5	32.7	29.5
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P914749

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P914749

CATALOG NUMBER: DFN2DIP-SQ3F0-100D060US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.70	13.69	13.54	14.55	15.63	12.26	13.25	13.10	14.11	15.19
	3H	14.37	15.25	15.22	16.13	17.23	13.88	14.76	14.73	15.64	16.74
	4H	14.96	15.80	15.83	16.68	17.79	14.46	15.30	15.34	16.18	17.30
	6H	15.36	16.13	16.24	17.02	18.15	14.86	15.63	15.74	16.52	17.65
	8H	15.47	16.20	16.36	17.11	18.24	14.97	15.70	15.86	16.61	17.74
	12H	15.52	16.22	16.42	17.12	18.27	15.01	15.71	15.91	16.61	17.77
4H	2H	13.18	14.01	14.05	14.89	16.01	12.82	13.66	13.70	14.54	15.66
	3H	15.05	15.75	15.93	16.66	17.79	14.64	15.34	15.53	16.25	17.38
	4H	15.76	16.40	16.66	17.31	18.47	15.34	15.98	16.24	16.88	18.04
	6H	16.28	16.83	17.19	17.76	18.92	15.85	16.40	16.76	17.33	18.49
	8H	16.43	16.95	17.35	17.87	19.05	15.99	16.51	16.91	17.43	18.61
	12H	16.51	16.97	17.44	17.92	19.10	16.06	16.52	16.99	17.47	18.65
8H	4H	15.97	16.48	16.88	17.41	18.58	15.59	16.10	16.50	17.03	18.20
	6H	16.60	17.02	17.54	17.99	19.16	16.21	16.64	17.15	17.61	18.78
	8H	16.81	17.19	17.77	18.15	19.34	16.42	16.80	17.37	17.76	18.95
	12H	16.95	17.28	17.90	18.23	19.47	16.54	16.87	17.49	17.82	19.06
12H	4H	15.96	16.42	16.89	17.36	18.54	15.59	16.05	16.52	17.00	18.18
	6H	16.62	17.00	17.58	17.96	19.15	16.25	16.63	17.20	17.59	18.78
	8H	16.87	17.20	17.82	18.15	19.39	16.49	16.82	17.44	17.77	19.01

END OF REPORT