

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914781

Luminaire Tested: DFN2DIP-SQ3F0-110D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914781
REPORT IS A COMBINATION OF REPORTS P901413 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D050US927-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12548.1 lumens
Efficiency: N/A
Efficacy: 84.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 148.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914781

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US927-FLLONL

Luminous Intensity Polar Plot

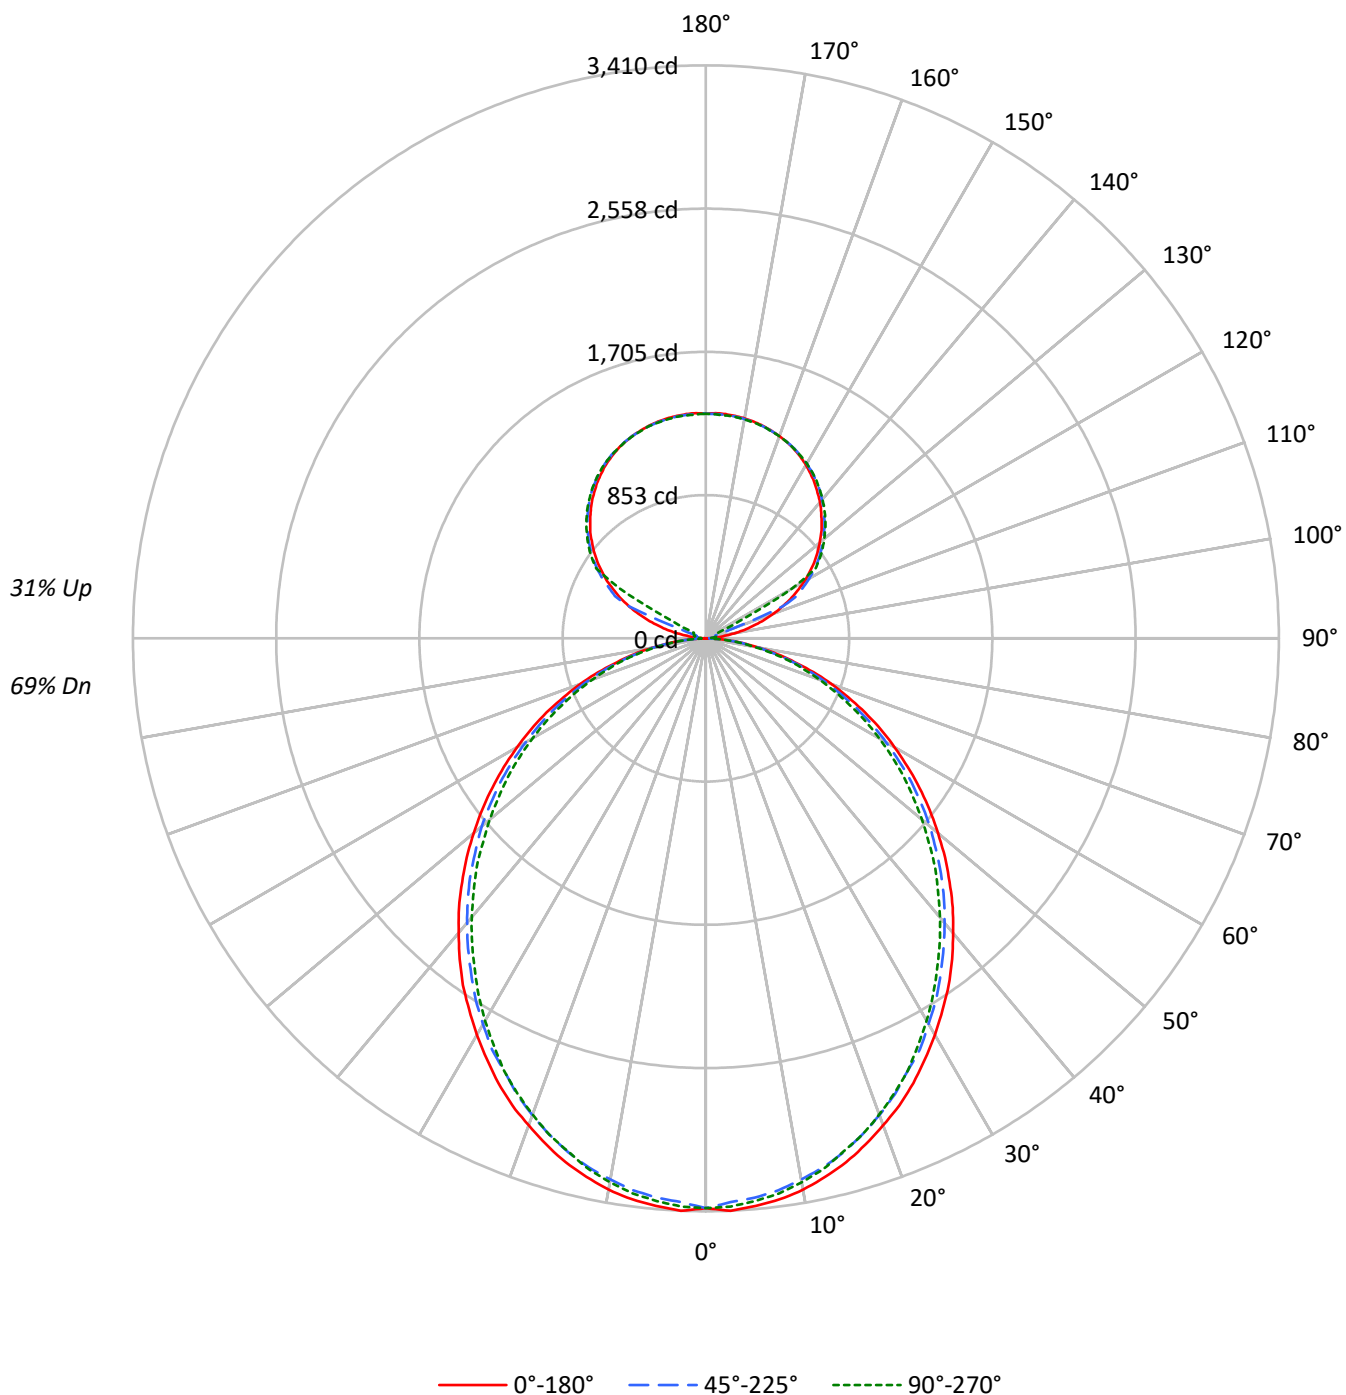

TEST NUMBER: P914781

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	105	105	105	105	94	94	94	83	83	83	73	73	73
1	102	98	94	90	96	92	89	86	82	80	77	73	71	69	65	63	62
2	93	85	79	74	87	81	75	70	72	68	64	64	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	47	45
4	78	66	58	52	73	63	56	50	57	51	46	51	46	42	45	42	38
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	33
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	57	46	38	33	42	35	31	38	32	29	34	30	26
8	57	44	36	30	53	42	35	29	38	32	27	35	29	26	31	27	24
9	53	40	33	27	50	38	31	26	35	29	25	32	27	23	29	24	21
10	50	37	30	25	47	35	29	24	32	26	22	29	24	21	27	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3885	3885	3885
5°	3889	3828	3855
10°	3855	3774	3802
15°	3796	3709	3719
20°	3717	3621	3634
25°	3638	3515	3537
30°	3540	3416	3413
35°	3447	3300	3282
40°	3332	3183	3157
45°	3218	3065	3029
50°	3093	2942	2881
55°	2963	2799	2745
60°	2814	2629	2589
65°	2652	2454	2404
70°	2446	2239	2206
75°	2161	1982	2021
80°	1816	1654	1670
85°	1279	1096	1094

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3218 cd/sqm

TEST NUMBER: P914781

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	319.1	2.5
10°-20°	897.9	7.2
20°-30°	1319.6	10.5
30°-40°	1532.6	12.2
40°-50°	1530.7	12.2
50°-60°	1334.7	10.6
60°-70°	986.7	7.9
70°-80°	558.2	4.4
80°-90°	149.7	1.2
90°-100°	44.1	0.4
100°-110°	164.3	1.3
110°-120°	435.8	3.5
120°-130°	722.8	5.8
130°-140°	767.8	6.1
140°-150°	713.6	5.7
150°-160°	573.7	4.6
160°-170°	369.7	2.9
170°-180°	127.2	1.0
0°-30°	2536.6	20.2
0°-40°	4069.2	32.4
0°-60°	6934.6	55.3
0°-90°	8629.2	68.8
90°-120°	644.2	5.1
90°-150°	2848.4	22.7
90°-180°	3919.0	31.2
0°-180°	12548.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3391	3391	3391	3391	3391	
5°	3391	3378	3342	3368	3362	322
15°	3228	3208	3166	3179	3163	909
25°	2921	2895	2840	2846	2840	1344
35°	2520	2488	2436	2416	2400	1574
45°	2051	2028	1979	1943	1930	1583
55°	1552	1532	1493	1454	1438	1388
65°	1047	1027	994	965	949	1035
75°	548	541	525	505	512	585
85°	134	130	127	117	114	149
90°	1	12	19	24	26	12
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P914781

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3390.7	3390.7	3390.7	3390.7	3390.7
2.5°	3410.3	3394.1	3358.1	3390.7	3384.4
5°	3390.7	3377.9	3341.9	3367.8	3361.6
7.5°	3367.8	3348.5	3312.5	3338.8	3332.2
10°	3332.2	3309.3	3270.3	3296.2	3286.5
12.5°	3283.1	3263.7	3224.7	3240.9	3234.3
15°	3227.7	3208.3	3165.8	3178.9	3162.7
17.5°	3159.2	3139.9	3097.3	3113.6	3097.3
20°	3084.2	3064.8	3019.2	3028.8	3016.1
22.5°	3009.5	2980.0	2937.5	2937.5	2930.9
25°	2921.2	2895.3	2840.0	2846.2	2840.0
27.5°	2823.3	2800.5	2758.3	2748.6	2732.4
30°	2725.8	2699.5	2650.7	2641.1	2627.9
32.5°	2621.3	2602.0	2549.7	2530.0	2516.8
35°	2520.3	2487.8	2435.6	2415.8	2399.6
37.5°	2406.2	2376.8	2324.6	2301.7	2285.4
40°	2288.9	2262.6	2210.4	2181.4	2168.2
42.5°	2174.8	2148.5	2096.6	2063.7	2044.4
45°	2051.0	2028.1	1978.9	1943.4	1930.2
47.5°	1930.2	1907.4	1855.1	1819.2	1799.8
50°	1802.9	1786.7	1741.0	1695.3	1679.1
52.5°	1679.1	1656.2	1614.1	1578.0	1555.2
55°	1552.1	1532.4	1493.3	1454.2	1438.0
57.5°	1424.8	1408.6	1366.0	1326.9	1313.8
60°	1297.5	1284.8	1239.1	1203.1	1193.4
62.5°	1173.7	1150.9	1118.3	1085.8	1072.7
65°	1046.7	1027.0	994.5	965.1	948.9
67.5°	916.3	899.8	870.7	847.9	834.7
70°	795.6	782.4	753.0	730.2	717.4
72.5°	671.8	658.6	642.4	619.6	609.8
75°	547.6	541.4	524.7	505.4	512.0
77.5°	436.9	423.7	417.2	407.5	397.8
80°	326.2	322.7	316.2	306.5	299.9
82.5°	221.7	221.7	218.6	205.5	205.5
85°	133.6	130.4	127.3	117.2	114.2
87.5°	58.8	52.2	45.6	36.0	32.5
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P914781

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P914781

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.53	14.59	14.31	15.39	16.36	13.08	14.14	13.86	14.94	15.92
	3H	15.20	16.15	15.99	16.96	17.96	14.71	15.66	15.50	16.47	17.47
	4H	15.79	16.69	16.60	17.51	18.52	15.30	16.20	16.11	17.01	18.03
	6H	16.20	17.03	17.02	17.85	18.88	15.70	16.53	16.52	17.35	18.38
	8H	16.31	17.10	17.14	17.94	18.97	15.81	16.60	16.64	17.44	18.47
	12H	16.36	17.11	17.20	17.95	19.01	15.85	16.60	16.69	17.44	18.50
4H	2H	14.01	14.91	14.82	15.73	16.74	13.65	14.55	14.47	15.37	16.39
	3H	15.89	16.64	16.71	17.49	18.52	15.48	16.23	16.30	17.08	18.11
	4H	16.61	17.29	17.44	18.14	19.20	16.18	16.86	17.02	17.71	18.77
	6H	17.13	17.72	17.98	18.59	19.66	16.69	17.29	17.55	18.16	19.22
	8H	17.28	17.83	18.14	18.70	19.78	16.84	17.39	17.70	18.26	19.34
	12H	17.36	17.86	18.24	18.75	19.83	16.91	17.41	17.79	18.30	19.38
8H	4H	16.81	17.37	17.67	18.24	19.31	16.44	16.99	17.29	17.86	18.94
	6H	17.45	17.90	18.33	18.82	19.89	17.06	17.52	17.95	18.43	19.51
	8H	17.67	18.07	18.56	18.98	20.07	17.27	17.68	18.17	18.58	19.68
	12H	17.80	18.16	18.70	19.06	20.21	17.39	17.75	18.29	18.65	19.80
12H	4H	16.81	17.31	17.69	18.20	19.28	16.44	16.94	17.32	17.83	18.91
	6H	17.48	17.88	18.37	18.79	19.88	17.10	17.51	18.00	18.42	19.51
	8H	17.72	18.08	18.62	18.98	20.13	17.34	17.70	18.24	18.60	19.75

END OF REPORT