

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914839

Luminaire Tested: DFN2DIP-SQ3F0-120D100US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914839
REPORT IS A COMBINATION OF REPORTS P901506 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D100US927-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15922.8 lumens
Efficiency: N/A
Efficacy: 78.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 203.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914839

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US927-RLLONL

Luminous Intensity Polar Plot

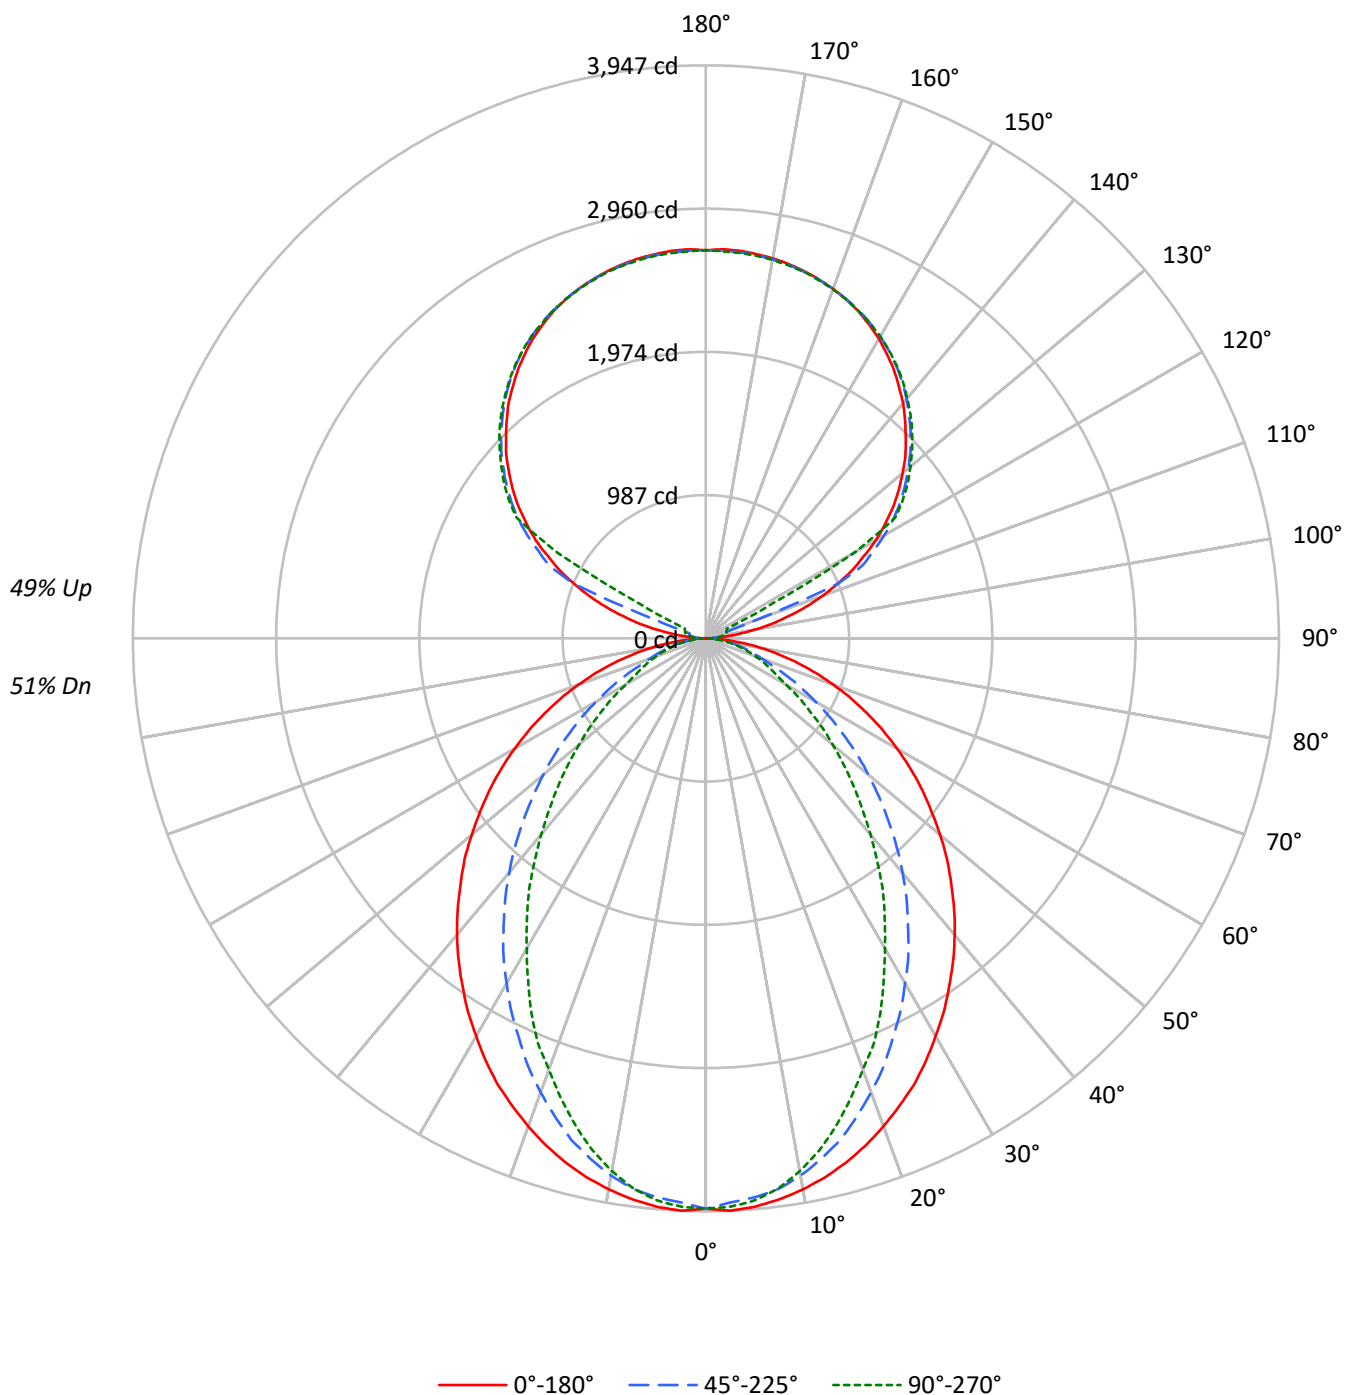

TEST NUMBER: P914839

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4502	4502	4502
5°	4506	4427	4457
10°	4459	4337	4311
15°	4394	4191	4085
20°	4310	3991	3809
25°	4224	3767	3542
30°	4110	3537	3204
35°	3997	3291	2907
40°	3882	3036	2568
45°	3749	2754	2260
50°	3612	2469	1959
55°	3468	2166	1670
60°	3301	1848	1373
65°	3109	1526	1234
70°	2875	1226	1115
75°	2581	1074	1011
80°	2158	892	871
85°	1463	581	646

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3749 cd/sqm

TEST NUMBER: P914839

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	368.2	2.3
10°-20°	1010.8	6.3
20°-30°	1419.2	8.9
30°-40°	1547.0	9.7
40°-50°	1421.9	8.9
50°-60°	1116.7	7.0
60°-70°	726.9	4.6
70°-80°	374.2	2.3
80°-90°	100.2	0.6
90°-100°	88.1	0.6
100°-110°	328.6	2.1
110°-120°	871.6	5.5
120°-130°	1445.6	9.1
130°-140°	1535.6	9.6
140°-150°	1427.1	9.0
150°-160°	1147.4	7.2
160°-170°	739.3	4.6
170°-180°	254.5	1.6
0°-30°	2798.2	17.6
0°-40°	4345.2	27.3
0°-60°	6883.7	43.2
0°-90°	8085.0	50.8
90°-120°	1288.4	8.1
90°-150°	5696.7	35.8
90°-180°	7838.0	49.2
0°-180°	15922.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3929	3929	3929	3929	3929	
5°	3929	3911	3865	3897	3886	373
15°	3737	3698	3577	3509	3474	1053
25°	3392	3278	3044	2898	2844	1560
35°	2923	2741	2429	2205	2126	1829
45°	2389	2151	1778	1525	1440	1845
55°	1817	1540	1156	942	875	1623
65°	1227	939	619	498	487	1216
75°	654	405	284	260	256	692
85°	153	78	68	68	68	175
90°	2	23	39	48	52	15
95°	126	62	75	85	83	149
105°	588	646	118	139	147	628
115°	1112	1145	1194	298	159	1095
125°	1573	1598	1635	1648	1654	1403
135°	1946	1977	1994	2014	2010	1503
145°	2258	2256	2288	2302	2292	1412
155°	2486	2469	2492	2503	2488	1146
165°	2619	2608	2614	2627	2614	740
175°	2679	2666	2670	2683	2664	255
180°	2674	2674	2674	2674	2674	

TEST NUMBER: P914839

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3928.9	3928.9	3928.9	3928.9	3928.9
2.5°	3946.6	3928.9	3889.7	3925.5	3918.3
5°	3928.9	3911.2	3864.7	3896.8	3886.3
7.5°	3896.8	3875.7	3825.9	3839.9	3822.1
10°	3854.2	3829.3	3758.3	3747.4	3726.3
12.5°	3801.0	3769.0	3672.7	3651.6	3612.4
15°	3736.9	3697.7	3576.9	3509.4	3474.0
17.5°	3662.2	3605.2	3455.8	3377.8	3320.8
20°	3576.9	3505.6	3328.0	3239.3	3160.8
22.5°	3484.5	3402.7	3196.3	3075.6	3022.4
25°	3392.1	3278.1	3043.5	2897.9	2844.3
27.5°	3281.9	3160.8	2901.3	2734.2	2652.3
30°	3164.6	3029.2	2744.7	2563.7	2467.5
32.5°	3050.7	2886.9	2595.7	2382.2	2293.2
35°	2922.8	2741.3	2428.6	2204.6	2126.1
37.5°	2798.3	2602.6	2272.1	2026.5	1937.8
40°	2666.6	2453.5	2108.4	1856.0	1763.6
42.5°	2531.6	2304.1	1945.0	1681.7	1593.1
45°	2389.4	2151.0	1777.9	1525.2	1439.9
47.5°	2254.3	2002.0	1618.0	1365.2	1287.1
50°	2105.0	1852.6	1461.4	1215.8	1141.5
52.5°	1959.0	1692.3	1312.0	1077.4	1009.9
55°	1816.8	1539.5	1155.5	942.3	874.8
57.5°	1671.1	1386.7	1017.0	817.8	760.9
60°	1521.8	1237.3	871.0	690.0	633.0
62.5°	1376.2	1091.7	746.6	576.1	547.7
65°	1226.8	938.6	618.7	498.0	487.0
67.5°	1084.6	796.3	498.0	437.2	426.7
70°	935.2	657.9	412.3	376.8	362.5
72.5°	793.0	529.7	344.8	316.5	309.3
75°	654.1	405.1	284.5	259.5	256.1
77.5°	515.7	287.8	224.1	209.8	202.6
80°	387.5	206.4	170.5	156.5	156.5
82.5°	270.1	138.8	117.3	110.1	110.1
85°	152.8	78.1	67.5	67.5	67.5
87.5°	57.0	28.3	28.3	24.9	24.9
90°	1.8	23.2	38.6	48.5	52.1
92.5°	48.5	40.6	46.4	50.3	52.1
95°	125.6	61.8	75.3	85.2	83.2
97.5°	226.2	67.7	98.5	104.5	106.4
100°	342.5	77.4	110.3	125.6	129.6
102.5°	470.0	466.4	114.2	135.3	141.2
105°	588.1	646.2	118.1	139.2	147.0
107.5°	725.5	773.7	122.0	143.1	150.9
110°	857.1	897.5	338.6	145.2	152.7

TEST NUMBER: P914839

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	980.9	1015.6	982.8	148.9	154.9
115°	1112.3	1145.2	1193.7	297.9	158.8
117.5°	1226.5	1265.1	1298.1	1021.4	514.6
120°	1354.2	1383.1	1418.1	1441.3	1180.1
122.5°	1462.4	1493.4	1532.2	1543.7	1545.8
125°	1572.7	1598.0	1634.7	1648.3	1654.0
127.5°	1673.3	1700.4	1729.6	1748.9	1750.7
130°	1768.1	1799.2	1820.4	1841.7	1839.8
132.5°	1864.9	1890.1	1911.3	1928.7	1926.9
135°	1946.2	1977.2	1994.5	2014.0	2010.1
137.5°	2031.2	2054.4	2073.9	2093.3	2087.5
140°	2114.3	2130.0	2151.1	2168.6	2158.9
142.5°	2184.2	2197.7	2222.8	2238.1	2228.6
145°	2257.7	2255.7	2288.5	2302.1	2292.4
147.5°	2321.3	2315.6	2348.4	2358.1	2350.6
150°	2383.4	2369.8	2400.9	2412.4	2402.7
152.5°	2435.5	2420.1	2449.1	2460.8	2447.2
155°	2485.9	2468.6	2491.8	2503.3	2487.9
157.5°	2526.5	2511.1	2528.6	2542.1	2526.5
160°	2561.4	2549.7	2561.4	2572.9	2559.4
162.5°	2592.2	2580.7	2590.4	2603.9	2586.5
165°	2619.3	2607.8	2613.6	2627.1	2613.6
167.5°	2640.7	2628.9	2635.0	2648.5	2631.0
170°	2658.1	2646.4	2650.3	2663.9	2646.4
172.5°	2669.6	2658.1	2662.0	2675.6	2658.1
175°	2679.2	2665.7	2669.6	2683.2	2663.9
177.5°	2683.2	2669.6	2671.7	2685.3	2667.7
180°	2673.5	2673.5	2673.5	2673.5	2673.5

TEST NUMBER: P914839

CATALOG NUMBER: DFN2DIP-SQ3F0-120D100US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.41	13.25	13.37	14.22	15.48	8.37	9.21	9.33	10.18	11.44
	3H	14.09	14.83	15.05	15.81	17.10	9.56	10.30	10.52	11.28	12.57
	4H	14.69	15.40	15.67	16.38	17.67	10.00	10.71	10.98	11.69	12.98
	6H	15.11	15.76	16.10	16.75	18.05	10.32	10.97	11.31	11.95	13.26
	8H	15.23	15.85	16.23	16.86	18.16	10.40	11.02	11.40	12.03	13.33
	12H	15.29	15.88	16.30	16.88	18.21	10.45	11.03	11.45	12.03	13.36
4H	2H	12.43	13.14	13.42	14.12	15.41	8.97	9.67	9.96	10.66	11.95
	3H	14.25	14.84	15.25	15.85	17.16	10.31	10.90	11.31	11.91	13.22
	4H	14.94	15.48	15.95	16.48	17.81	10.85	11.39	11.86	12.39	13.72
	6H	15.45	15.92	16.47	16.94	18.27	11.27	11.73	12.28	12.75	14.08
	8H	15.63	16.06	16.64	17.08	18.42	11.39	11.82	12.41	12.84	14.18
	12H	15.72	16.11	16.76	17.14	18.49	11.45	11.84	12.49	12.88	14.22
8H	4H	14.91	15.34	15.93	16.36	17.70	11.13	11.56	12.15	12.58	13.92
	6H	15.47	15.83	16.51	16.89	18.23	11.64	12.00	12.68	13.06	14.40
	8H	15.68	16.00	16.73	17.04	18.40	11.83	12.14	12.88	13.19	14.55
	12H	15.82	16.09	16.87	17.14	18.54	11.94	12.22	12.99	13.26	14.66
12H	4H	14.86	15.25	15.90	16.29	17.63	11.14	11.52	12.17	12.56	13.91
	6H	15.45	15.76	16.50	16.81	18.17	11.69	12.00	12.74	13.05	14.41
	8H	15.66	15.94	16.72	16.98	18.38	11.89	12.17	12.95	13.21	14.61

END OF REPORT