

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917303

Luminaire Tested: DFN2DIP-SQ3F0-050D070US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917303
REPORT IS A COMBINATION OF REPORTS P901438 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D070US930-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9115.0 lumens
Efficiency: N/A
Efficacy: 96.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 94.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917303

CATALOG NUMBER: DFN2DIP-SQ3F0-050D070US930-RLLONL

Luminous Intensity Polar Plot

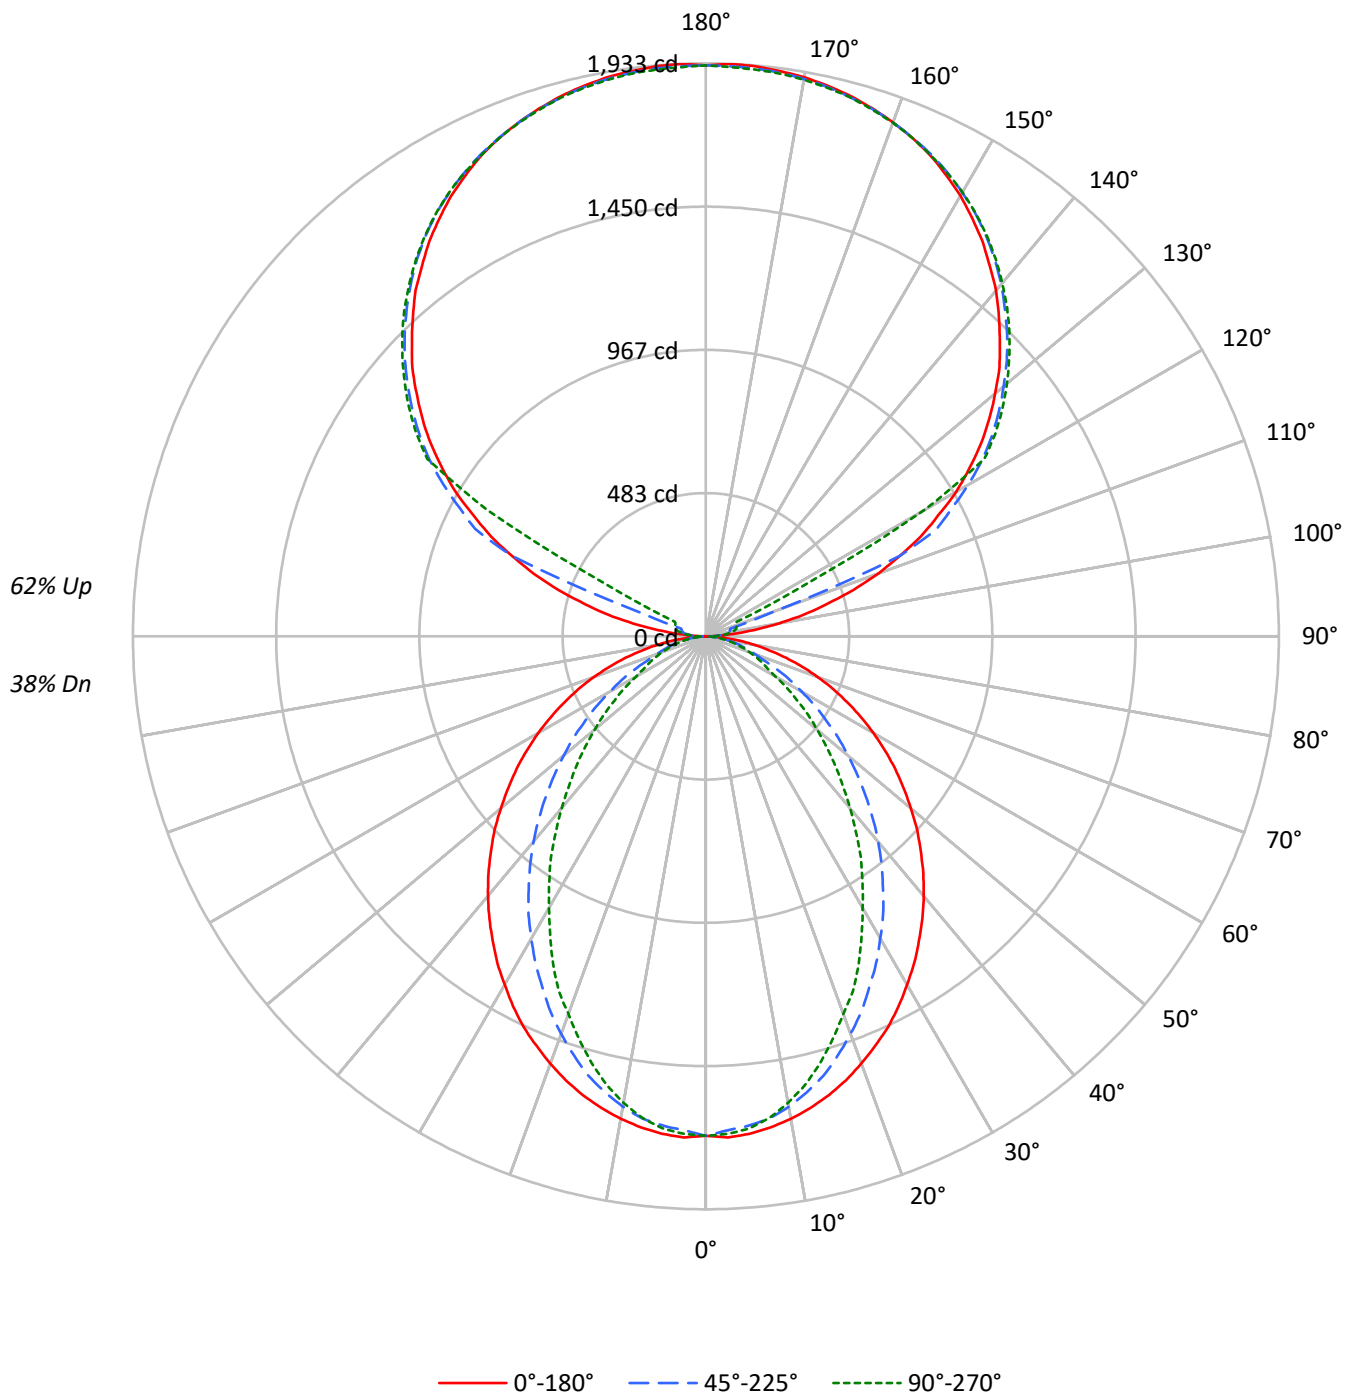

TEST NUMBER: P917303

CATALOG NUMBER: DFN2DIP-SQ3F0-050D070US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	60	60	60	45	45	45
1	95	91	88	84	87	83	80	77	68	66	64	54	52	51	40	40	39
2	87	80	74	69	79	73	68	64	60	56	53	47	45	43	36	35	33
3	80	71	64	58	72	65	59	54	53	49	45	42	39	37	32	30	29
4	73	63	55	50	66	57	51	46	47	42	39	38	34	32	29	27	25
5	67	56	48	43	61	51	45	40	42	37	34	34	31	28	26	24	22
6	62	50	43	37	56	46	39	34	38	33	29	31	27	24	24	22	20
7	57	45	38	32	52	42	35	30	35	30	26	28	24	22	22	19	18
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	50	38	31	26	45	35	28	24	29	24	21	24	20	18	19	16	14
10	46	35	28	23	42	32	26	22	27	22	19	22	18	16	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1930	1930	1930
5°	1932	1899	1911
10°	1912	1860	1848
15°	1884	1797	1752
20°	1848	1711	1633
25°	1811	1615	1519
30°	1762	1517	1374
35°	1714	1411	1247
40°	1665	1302	1101
45°	1608	1181	969
50°	1549	1059	840
55°	1487	929	716
60°	1416	793	589
65°	1333	655	529
70°	1233	526	478
75°	1107	461	433
80°	925	382	374
85°	627	249	277

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1608 cd/sqm

TEST NUMBER: P917303

CATALOG NUMBER: DFN2DIP-SQ3F0-050D070US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.9	1.7
10°-20°	433.5	4.8
20°-30°	608.6	6.7
30°-40°	663.4	7.3
40°-50°	609.7	6.7
50°-60°	478.8	5.3
60°-70°	311.7	3.4
70°-80°	160.4	1.8
80°-90°	44.3	0.5
90°-100°	63.5	0.7
100°-110°	236.8	2.6
110°-120°	627.9	6.9
120°-130°	1041.5	11.4
130°-140°	1106.3	12.1
140°-150°	1028.1	11.3
150°-160°	826.6	9.1
160°-170°	532.6	5.8
170°-180°	183.3	2.0
0°-30°	1200.0	13.2
0°-40°	1863.4	20.4
0°-60°	2951.9	32.4
0°-90°	3468.4	38.1
90°-120°	928.2	10.2
90°-150°	4104.1	45.0
90°-180°	5647.0	62.0
0°-180°	9115.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1685	1685	1685	1685	1685	
5°	1685	1677	1657	1671	1667	160
15°	1602	1586	1534	1505	1490	452
25°	1455	1406	1305	1243	1220	669
35°	1253	1176	1042	945	912	784
45°	1025	922	762	654	617	791
55°	779	660	496	404	375	696
65°	526	402	265	214	209	521
75°	280	174	122	111	110	297
85°	66	34	29	29	29	75
90°	1	17	28	35	38	8
95°	90	44	54	61	60	107
105°	424	466	85	100	106	453
115°	801	825	860	215	114	789
125°	1133	1151	1178	1188	1192	1010
135°	1402	1424	1437	1451	1448	1083
145°	1626	1625	1649	1658	1652	1017
155°	1791	1778	1795	1803	1792	825
165°	1887	1879	1883	1893	1883	533
175°	1930	1920	1923	1933	1919	184
180°	1926	1926	1926	1926	1926	

TEST NUMBER: P917303

CATALOG NUMBER: DFN2DIP-SQ3F0-050D070US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1684.8	1684.8	1684.8	1684.8	1684.8
2.5°	1692.4	1684.8	1668.0	1683.3	1680.2
5°	1684.8	1677.2	1657.3	1671.0	1666.6
7.5°	1671.0	1662.0	1640.6	1646.7	1639.0
10°	1652.8	1642.1	1611.7	1607.0	1597.9
12.5°	1629.9	1616.2	1575.0	1565.9	1549.1
15°	1602.5	1585.7	1533.9	1505.0	1489.7
17.5°	1570.4	1546.1	1482.0	1448.5	1424.0
20°	1533.9	1503.3	1427.1	1389.1	1355.4
22.5°	1494.3	1459.1	1370.7	1318.9	1296.1
25°	1454.6	1405.7	1305.1	1242.7	1219.7
27.5°	1407.4	1355.4	1244.1	1172.5	1137.4
30°	1357.1	1299.0	1177.0	1099.3	1058.1
32.5°	1308.2	1238.0	1113.1	1021.6	983.4
35°	1253.4	1175.6	1041.5	945.3	911.7
37.5°	1200.0	1116.1	974.4	869.0	831.0
40°	1143.5	1052.1	904.1	795.9	756.3
42.5°	1085.7	988.1	834.1	721.1	683.1
45°	1024.7	922.4	762.4	654.0	617.4
47.5°	966.7	858.5	693.8	585.5	552.0
50°	902.7	794.4	626.7	521.4	489.5
52.5°	840.1	725.7	562.6	462.0	433.1
55°	779.1	660.1	495.5	404.1	375.1
57.5°	716.6	594.7	436.1	350.7	326.3
60°	652.6	530.6	373.5	295.9	271.4
62.5°	590.1	468.1	320.2	247.0	234.9
65°	526.0	402.5	265.3	213.5	208.9
67.5°	465.0	341.5	213.5	187.5	183.0
70°	401.0	282.1	176.8	161.6	155.5
72.5°	340.1	227.1	147.9	135.7	132.6
75°	280.5	173.7	122.0	111.3	109.8
77.5°	221.1	123.4	96.1	89.9	86.8
80°	166.2	88.5	73.1	67.1	67.1
82.5°	115.9	59.5	50.3	47.2	47.2
85°	65.5	33.5	28.9	28.9	28.9
87.5°	24.5	12.1	12.1	10.7	10.7
90°	1.3	16.7	27.8	34.9	37.6
92.5°	34.9	29.3	33.4	36.3	37.6
95°	90.5	44.5	54.3	61.4	59.9
97.5°	163.0	48.8	71.0	75.3	76.6
100°	246.8	55.8	79.4	90.5	93.4
102.5°	338.6	336.0	82.3	97.5	101.7
105°	423.7	465.5	85.0	100.3	105.9
107.5°	522.6	557.4	87.9	103.1	108.8
110°	617.5	646.6	243.9	104.6	110.1

TEST NUMBER: P917303

CATALOG NUMBER: DFN2DIP-SQ3F0-050D070US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	706.7	731.6	708.0	107.2	111.5
115°	801.4	825.0	859.9	214.7	114.4
117.5°	883.6	911.4	935.2	735.8	370.7
120°	975.6	996.5	1021.7	1038.4	850.2
122.5°	1053.5	1075.9	1103.9	1112.1	1113.6
125°	1133.0	1151.2	1177.7	1187.5	1191.6
127.5°	1205.5	1225.0	1246.0	1260.0	1261.3
130°	1273.8	1296.2	1311.4	1326.8	1325.5
132.5°	1343.5	1361.7	1377.0	1389.5	1388.2
135°	1402.1	1424.4	1436.9	1450.9	1448.1
137.5°	1463.3	1480.1	1494.1	1508.1	1503.9
140°	1523.2	1534.5	1549.7	1562.3	1555.3
142.5°	1573.5	1583.3	1601.3	1612.4	1605.5
145°	1626.5	1625.1	1648.7	1658.5	1651.5
147.5°	1672.3	1668.3	1691.9	1698.8	1693.4
150°	1717.0	1707.3	1729.7	1737.9	1731.0
152.5°	1754.6	1743.5	1764.4	1772.8	1763.1
155°	1790.9	1778.4	1795.1	1803.4	1792.4
157.5°	1820.2	1809.1	1821.6	1831.4	1820.2
160°	1845.3	1836.9	1845.3	1853.6	1843.8
162.5°	1867.5	1859.2	1866.1	1875.9	1863.4
165°	1887.0	1878.8	1882.8	1892.6	1882.8
167.5°	1902.4	1893.9	1898.3	1908.0	1895.5
170°	1915.0	1906.6	1909.3	1919.1	1906.6
172.5°	1923.3	1915.0	1917.8	1927.5	1915.0
175°	1930.2	1920.4	1923.3	1933.0	1919.1
177.5°	1933.0	1923.3	1924.8	1934.5	1921.9
180°	1926.1	1926.1	1926.1	1926.1	1926.1

TEST NUMBER: P917303

CATALOG NUMBER: DFN2DIP-SQ3F0-050D070US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.17	8.91	9.23	9.97	11.40	4.13	4.87	5.19	5.93	7.36
	3H	9.84	10.50	10.90	11.57	13.02	5.31	5.97	6.37	7.04	8.49
	4H	10.44	11.07	11.52	12.13	13.59	5.75	6.38	6.83	7.44	8.90
	6H	10.85	11.43	11.94	12.50	13.97	6.06	6.64	7.15	7.71	9.18
	8H	10.97	11.52	12.07	12.61	14.08	6.14	6.69	7.24	7.78	9.25
	12H	11.03	11.55	12.13	12.63	14.12	6.18	6.70	7.28	7.78	9.27
4H	2H	8.18	8.80	9.26	9.87	11.33	4.71	5.34	5.80	6.41	7.87
	3H	9.99	10.51	11.08	11.61	13.08	6.05	6.57	7.14	7.67	9.14
	4H	10.68	11.15	11.77	12.24	13.73	6.59	7.07	7.68	8.15	9.65
	6H	11.18	11.59	12.29	12.70	14.19	6.99	7.40	8.10	8.51	10.00
	8H	11.35	11.74	12.46	12.84	14.34	7.12	7.50	8.22	8.60	10.10
	12H	11.44	11.79	12.56	12.90	14.41	7.17	7.52	8.30	8.63	10.14
8H	4H	10.64	11.02	11.74	12.12	13.62	6.86	7.24	7.96	8.34	9.84
	6H	11.19	11.51	12.32	12.65	14.15	7.36	7.68	8.49	8.82	10.32
	8H	11.41	11.68	12.54	12.81	14.33	7.55	7.82	8.68	8.95	10.47
	12H	11.54	11.78	12.67	12.90	14.46	7.66	7.90	8.79	9.02	10.58
12H	4H	10.58	10.93	11.71	12.04	13.55	6.86	7.20	7.98	8.32	9.83
	6H	11.17	11.44	12.30	12.57	14.09	7.41	7.69	8.54	8.81	10.33
	8H	11.38	11.62	12.52	12.74	14.30	7.61	7.85	8.75	8.98	10.53

END OF REPORT