

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917317

Luminaire Tested: DFN2DIP-SQ3F0-050D110US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917317
REPORT IS A COMBINATION OF REPORTS P901509 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D110US930-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12914.3 lumens
Efficiency: N/A
Efficacy: 100.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 128.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917317

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US930-FLLONL

Luminous Intensity Polar Plot

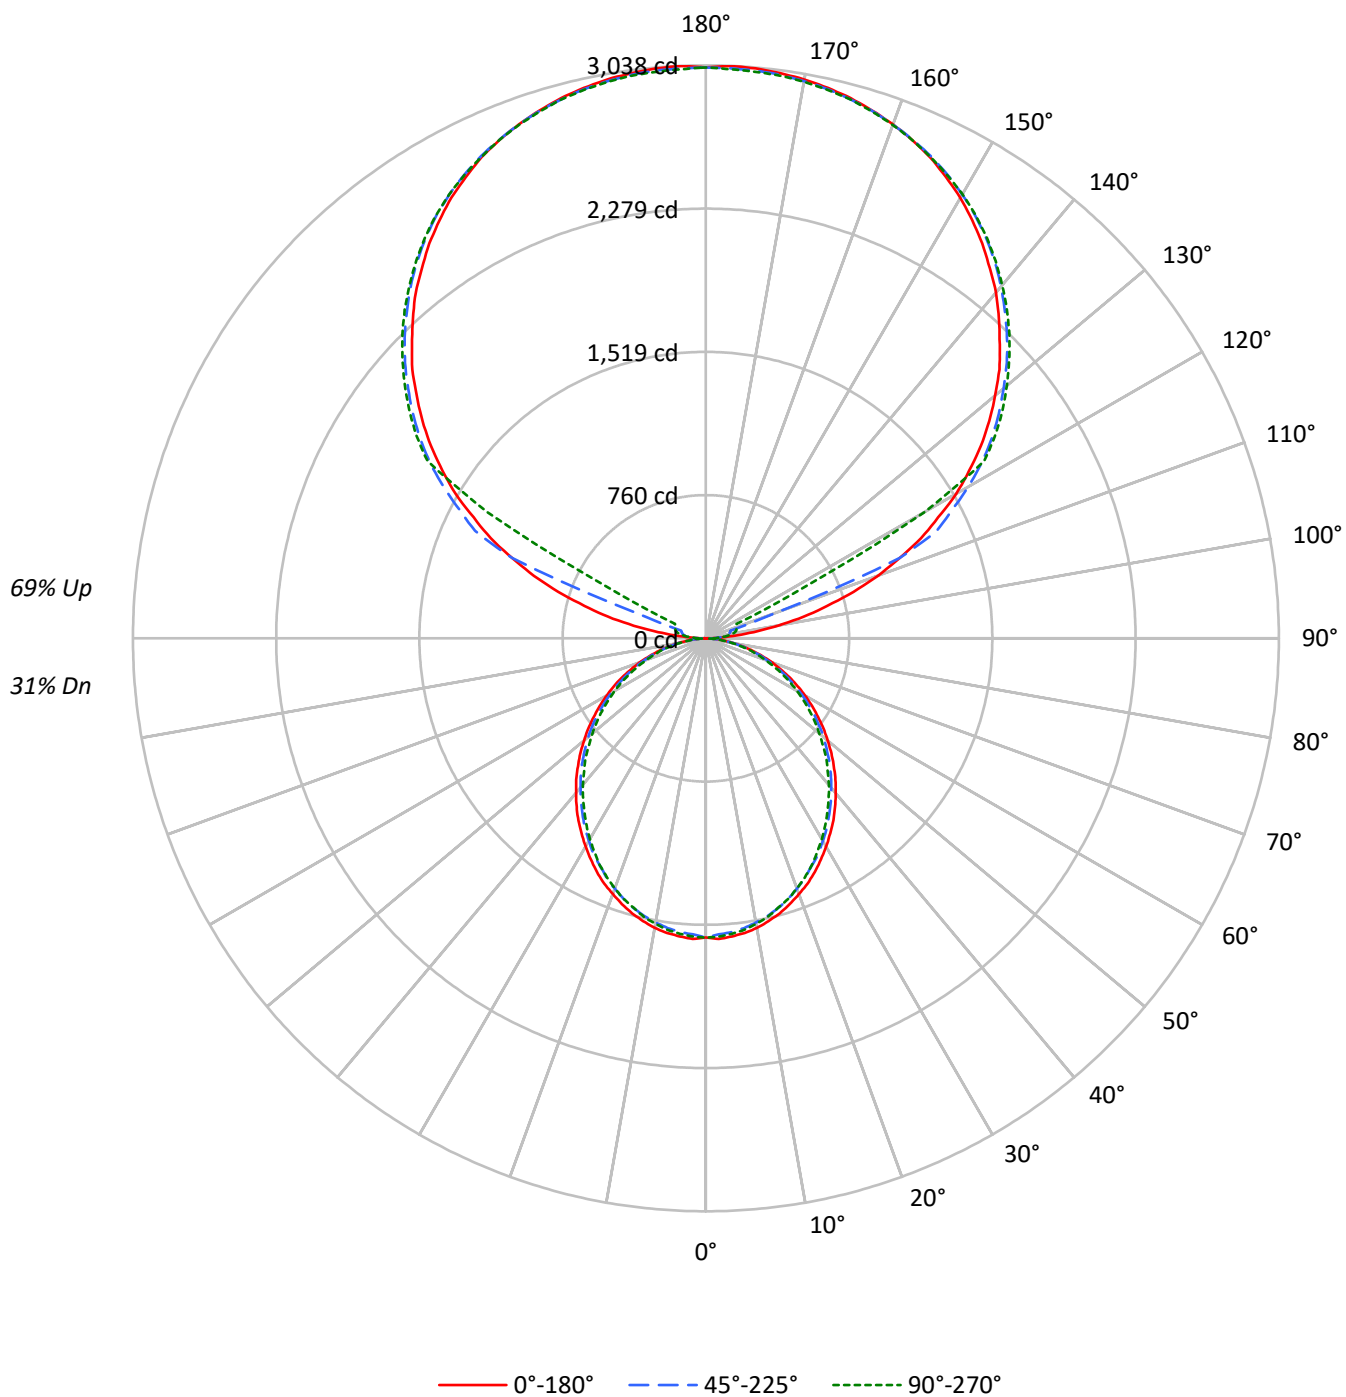

TEST NUMBER: P917317

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	92	92	92	92	73	73	73	55	55	55	39	39	39
1	94	89	86	82	84	80	77	74	64	62	60	48	47	46	34	34	33
2	85	78	72	67	76	70	65	61	56	52	49	43	40	38	30	29	28
3	78	69	61	56	70	62	56	51	49	45	41	38	35	32	27	25	24
4	71	61	53	47	64	55	48	43	44	39	35	33	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	27	24	22	19	18
6	60	48	40	35	54	44	37	32	35	30	26	27	24	21	20	17	15
7	55	43	36	30	50	39	33	28	32	27	23	25	21	18	18	15	14
8	51	39	32	27	46	36	29	24	29	24	20	22	19	16	16	14	12
9	48	36	28	24	43	32	26	22	26	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	19	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1817	1817	1817
5°	1819	1791	1804
10°	1803	1766	1779
15°	1776	1735	1740
20°	1739	1694	1700
25°	1702	1644	1654
30°	1656	1598	1596
35°	1612	1544	1535
40°	1559	1489	1477
45°	1506	1434	1417
50°	1447	1376	1348
55°	1386	1309	1284
60°	1317	1230	1211
65°	1241	1148	1125
70°	1144	1047	1032
75°	1011	927	945
80°	850	773	781
85°	598	512	511

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2072 cd/sqm

TEST NUMBER: P917317

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.3	1.2
10°-20°	420.0	3.3
20°-30°	617.3	4.8
30°-40°	717.0	5.6
40°-50°	716.1	5.5
50°-60°	624.4	4.8
60°-70°	461.6	3.6
70°-80°	261.1	2.0
80°-90°	74.2	0.6
90°-100°	99.8	0.8
100°-110°	372.1	2.9
110°-120°	986.7	7.6
120°-130°	1636.6	12.7
130°-140°	1738.4	13.5
140°-150°	1615.7	12.5
150°-160°	1298.9	10.1
160°-170°	837.0	6.5
170°-180°	288.1	2.2
0°-30°	1186.6	9.2
0°-40°	1903.6	14.7
0°-60°	3244.1	25.1
0°-90°	4041.0	31.3
90°-120°	1458.6	11.3
90°-150°	6449.2	49.9
90°-180°	8873.0	68.7
0°-180°	12914.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1586	1586	1586	1586	1586	
5°	1586	1580	1563	1576	1573	151
15°	1510	1501	1481	1487	1480	425
25°	1367	1354	1328	1332	1328	629
35°	1179	1164	1139	1130	1123	736
45°	959	949	926	909	903	740
55°	726	717	698	680	673	649
65°	490	480	465	452	444	484
75°	256	253	246	236	240	273
85°	62	61	60	55	53	70
90°	2	26	44	55	59	12
95°	142	70	85	96	94	169
105°	666	732	134	158	166	711
115°	1259	1296	1351	337	180	1240
125°	1780	1809	1851	1866	1872	1588
135°	2203	2238	2258	2280	2276	1702
145°	2556	2554	2591	2606	2595	1599
155°	2814	2795	2821	2834	2816	1297
165°	2965	2952	2959	2974	2959	838
175°	3033	3018	3022	3038	3016	289
180°	3027	3027	3027	3027	3027	

TEST NUMBER: P917317

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1586.2	1586.2	1586.2	1586.2	1586.2
2.5°	1595.4	1587.8	1571.0	1586.2	1583.3
5°	1586.2	1580.2	1563.3	1575.5	1572.6
7.5°	1575.5	1566.4	1549.6	1561.9	1558.9
10°	1558.9	1548.2	1529.9	1542.0	1537.5
12.5°	1535.9	1526.8	1508.5	1516.1	1513.0
15°	1509.9	1500.9	1481.0	1487.2	1479.5
17.5°	1477.9	1468.8	1448.9	1456.5	1448.9
20°	1442.8	1433.8	1412.4	1416.9	1411.0
22.5°	1407.9	1394.1	1374.2	1374.2	1371.1
25°	1366.6	1354.5	1328.5	1331.5	1328.5
27.5°	1320.8	1310.1	1290.4	1285.8	1278.2
30°	1275.1	1262.9	1240.1	1235.5	1229.4
32.5°	1226.3	1217.2	1192.8	1183.6	1177.5
35°	1179.0	1163.8	1139.4	1130.2	1122.6
37.5°	1125.6	1111.9	1087.4	1076.8	1069.2
40°	1070.8	1058.5	1034.0	1020.4	1014.3
42.5°	1017.4	1005.1	980.8	965.4	956.3
45°	959.4	948.8	925.8	909.1	902.9
47.5°	902.9	892.3	867.9	851.0	842.0
50°	843.4	835.8	814.5	793.1	785.5
52.5°	785.5	774.8	755.0	738.3	727.6
55°	726.1	716.9	698.5	680.3	672.7
57.5°	666.5	658.9	639.0	620.8	614.6
60°	607.0	601.0	579.7	562.8	558.3
62.5°	549.1	538.4	523.2	507.9	501.8
65°	489.7	480.5	465.2	451.5	443.8
67.5°	428.7	420.9	407.3	396.6	390.4
70°	372.2	366.1	352.3	341.6	335.7
72.5°	314.3	308.1	300.5	289.8	285.3
75°	256.2	253.2	245.5	236.4	239.5
77.5°	204.4	198.2	195.2	190.6	186.1
80°	152.6	151.0	147.9	143.4	140.3
82.5°	103.7	103.7	102.2	96.1	96.1
85°	62.5	61.0	59.5	54.9	53.4
87.5°	27.5	24.5	21.4	16.8	15.2
90°	2.1	26.3	43.7	54.9	59.0
92.5°	54.9	46.1	52.5	57.0	59.0
95°	142.3	70.0	85.3	96.4	94.2
97.5°	256.2	76.7	111.5	118.3	120.4
100°	387.8	87.6	124.8	142.3	146.7
102.5°	532.1	527.9	129.2	153.2	160.0
105°	665.8	731.6	133.7	157.6	166.5
107.5°	821.3	875.9	138.1	162.0	170.9
110°	970.3	1016.1	383.4	164.4	172.9

TEST NUMBER: P917317

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1110.5	1149.7	1112.6	168.5	175.3
115°	1259.2	1296.4	1351.4	337.3	179.7
117.5°	1388.5	1432.2	1469.7	1156.3	582.5
120°	1533.1	1565.9	1605.4	1631.7	1335.9
122.5°	1655.6	1690.7	1734.6	1747.7	1750.0
125°	1780.4	1809.1	1850.6	1866.0	1872.5
127.5°	1894.3	1925.0	1958.0	1979.9	1982.0
130°	2001.7	2036.9	2060.7	2085.0	2082.9
132.5°	2111.2	2139.8	2163.8	2183.5	2181.5
135°	2203.3	2238.4	2257.9	2280.1	2275.6
137.5°	2299.5	2325.8	2347.9	2369.7	2363.2
140°	2393.7	2411.3	2435.3	2455.0	2444.1
142.5°	2472.7	2488.0	2516.4	2533.9	2522.9
145°	2556.0	2553.6	2590.8	2606.2	2595.3
147.5°	2628.0	2621.5	2658.7	2669.6	2661.1
150°	2698.2	2682.9	2718.0	2731.0	2720.1
152.5°	2757.3	2739.8	2772.6	2785.9	2770.5
155°	2814.2	2794.7	2820.9	2834.0	2816.5
157.5°	2860.2	2842.8	2862.6	2877.9	2860.2
160°	2899.8	2886.5	2899.8	2912.7	2897.4
162.5°	2934.6	2921.6	2932.5	2947.9	2928.1
165°	2965.3	2952.3	2958.8	2974.1	2958.8
167.5°	2989.5	2976.2	2983.0	2998.3	2978.6
170°	3009.3	2996.0	3000.4	3015.8	2996.0
172.5°	3022.2	3009.3	3013.7	3029.0	3009.3
175°	3033.2	3017.8	3022.2	3037.6	3015.8
177.5°	3037.6	3022.2	3024.6	3039.9	3020.2
180°	3026.7	3026.7	3026.7	3026.7	3026.7

TEST NUMBER: P917317

CATALOG NUMBER: DFN2DIP-SQ3F0-050D110US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.27	7.99	8.38	9.09	10.60	6.83	7.54	7.93	8.64	10.16
	3H	8.92	9.56	10.03	10.67	12.20	8.43	9.07	9.54	10.18	11.71
	4H	9.50	10.10	10.62	11.21	12.75	9.00	9.61	10.12	10.72	12.26
	6H	9.88	10.44	11.01	11.56	13.11	9.38	9.94	10.51	11.06	12.60
	8H	9.98	10.52	11.12	11.64	13.19	9.48	10.01	10.61	11.14	12.68
	12H	10.02	10.53	11.16	11.65	13.22	9.52	10.02	10.65	11.14	12.71
4H	2H	7.71	8.32	8.84	9.43	10.97	7.36	7.97	8.49	9.07	10.61
	3H	9.56	10.07	10.69	11.20	12.75	9.15	9.66	10.29	10.79	12.34
	4H	10.26	10.73	11.40	11.85	13.42	9.84	10.31	10.98	11.43	13.00
	6H	10.77	11.17	11.91	12.31	13.87	10.33	10.73	11.48	11.88	13.44
	8H	10.91	11.28	12.05	12.42	14.00	10.47	10.85	11.62	11.98	13.56
	12H	10.97	11.31	12.13	12.46	14.05	10.52	10.86	11.69	12.01	13.60
8H	4H	10.44	10.82	11.59	11.96	13.53	10.07	10.44	11.21	11.58	13.16
	6H	11.06	11.37	12.23	12.55	14.13	10.68	10.99	11.84	12.17	13.74
	8H	11.28	11.55	12.45	12.71	14.30	10.89	11.16	12.06	12.32	13.91
	12H	11.40	11.64	12.57	12.79	14.42	10.99	11.23	12.16	12.38	14.01
12H	4H	10.42	10.76	11.58	11.91	13.49	10.05	10.39	11.21	11.54	13.13
	6H	11.09	11.36	12.26	12.52	14.11	10.72	10.99	11.89	12.15	13.74
	8H	11.32	11.56	12.49	12.71	14.34	10.94	11.18	12.11	12.33	13.96

END OF REPORT