

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917333

Luminaire Tested: DFN2DIP-SQ3F0-060D060US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917333
REPORT IS A COMBINATION OF REPORTS P901421 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D060US930-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9685.7 lumens
Efficiency: N/A
Efficacy: 98.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917333

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-FLLONL

Luminous Intensity Polar Plot

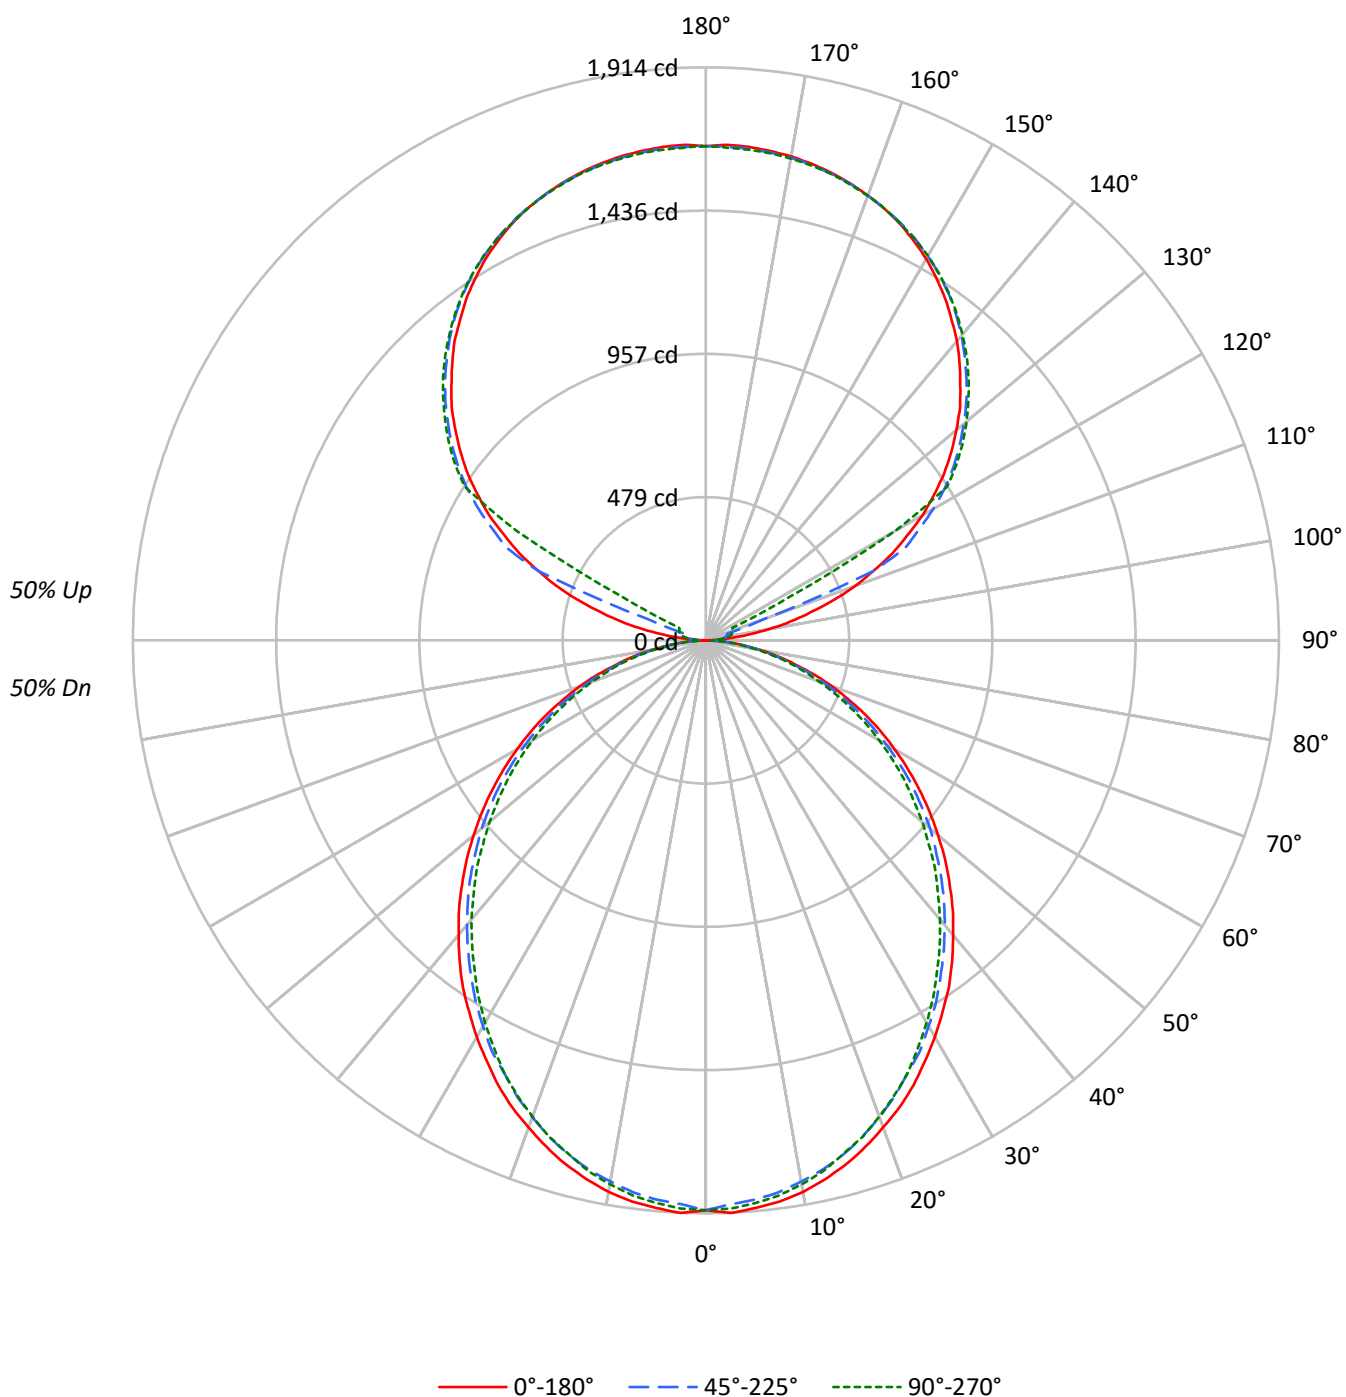

TEST NUMBER: P917333

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2181	2181	2181
5°	2183	2149	2164
10°	2164	2119	2134
15°	2131	2082	2088
20°	2086	2032	2040
25°	2042	1973	1985
30°	1987	1918	1916
35°	1935	1853	1842
40°	1871	1787	1772
45°	1807	1721	1700
50°	1737	1651	1617
55°	1663	1571	1541
60°	1580	1476	1453
65°	1489	1377	1350
70°	1373	1257	1238
75°	1213	1113	1134
80°	1020	928	938
85°	717	615	614

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1807 cd/sqm

TEST NUMBER: P917333

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	179.1	1.8
10°-20°	504.1	5.2
20°-30°	740.8	7.6
30°-40°	860.4	8.9
40°-50°	859.3	8.9
50°-60°	749.3	7.7
60°-70°	553.9	5.7
70°-80°	313.4	3.2
80°-90°	85.6	0.9
90°-100°	54.4	0.6
100°-110°	202.9	2.1
110°-120°	538.2	5.6
120°-130°	892.7	9.2
130°-140°	948.2	9.8
140°-150°	881.3	9.1
150°-160°	708.5	7.3
160°-170°	456.5	4.7
170°-180°	157.1	1.6
0°-30°	1424.0	14.7
0°-40°	2284.3	23.6
0°-60°	3892.9	40.2
0°-90°	4845.8	50.0
90°-120°	795.6	8.2
90°-150°	3517.8	36.3
90°-180°	4840.0	50.0
0°-180°	9685.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1903	1903	1903	1903	1903	
5°	1903	1896	1876	1891	1887	181
15°	1812	1801	1777	1785	1776	510
25°	1640	1625	1594	1598	1594	755
35°	1415	1397	1367	1356	1347	884
45°	1151	1138	1111	1091	1084	889
55°	871	860	838	816	807	779
65°	588	577	558	542	533	581
75°	307	304	295	284	287	328
85°	75	73	71	66	64	84
90°	1	14	24	30	32	9
95°	78	38	47	53	51	92
105°	363	399	73	86	91	388
115°	687	707	737	184	98	676
125°	971	987	1009	1018	1021	866
135°	1202	1221	1232	1244	1241	928
145°	1394	1393	1413	1422	1416	872
155°	1535	1524	1539	1546	1536	707
165°	1618	1610	1614	1622	1614	457
175°	1654	1646	1648	1657	1645	157
180°	1651	1651	1651	1651	1651	

TEST NUMBER: P917333

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1903.4	1903.4	1903.4	1903.4	1903.4
2.5°	1914.5	1905.4	1885.1	1903.4	1899.9
5°	1903.4	1896.2	1876.0	1890.6	1887.1
7.5°	1890.6	1879.8	1859.5	1874.3	1870.6
10°	1870.6	1857.8	1835.8	1850.4	1844.9
12.5°	1843.1	1832.1	1810.2	1819.3	1815.7
15°	1811.9	1801.1	1777.2	1784.6	1775.5
17.5°	1773.5	1762.7	1738.8	1747.8	1738.8
20°	1731.4	1720.5	1694.8	1700.3	1693.1
22.5°	1689.5	1672.9	1649.0	1649.0	1645.4
25°	1639.9	1625.4	1594.2	1597.7	1594.2
27.5°	1584.9	1572.1	1548.4	1543.0	1533.9
30°	1530.2	1515.4	1488.1	1482.6	1475.2
32.5°	1471.5	1460.7	1431.3	1420.2	1412.9
35°	1414.9	1396.6	1367.3	1356.2	1347.0
37.5°	1350.8	1334.2	1305.0	1292.1	1283.0
40°	1284.9	1270.2	1240.9	1224.6	1217.2
42.5°	1220.8	1206.1	1177.0	1158.5	1147.6
45°	1151.4	1138.5	1110.9	1091.0	1083.5
47.5°	1083.5	1070.7	1041.5	1021.2	1010.3
50°	1012.1	1003.0	977.4	951.7	942.6
52.5°	942.6	929.8	906.0	885.9	873.1
55°	871.3	860.2	838.3	816.4	807.2
57.5°	799.9	790.8	766.9	744.9	737.5
60°	728.4	721.2	695.6	675.4	669.9
62.5°	658.8	646.0	627.8	609.5	602.2
65°	587.6	576.6	558.3	541.8	532.6
67.5°	514.4	505.1	488.8	476.0	468.6
70°	446.6	439.3	422.7	409.9	402.8
72.5°	377.1	369.7	360.6	347.8	342.3
75°	307.4	303.9	294.6	283.7	287.4
77.5°	245.2	237.9	234.2	228.8	223.3
80°	183.1	181.2	177.5	172.0	168.4
82.5°	124.5	124.5	122.7	115.4	115.4
85°	74.9	73.2	71.4	65.8	64.1
87.5°	33.0	29.4	25.6	20.2	18.3
90°	1.1	14.3	23.8	29.9	32.2
92.5°	29.9	25.1	28.6	31.1	32.2
95°	77.6	38.2	46.6	52.7	51.4
97.5°	139.7	41.8	60.8	64.6	65.7
100°	211.5	47.8	68.1	77.6	80.0
102.5°	290.2	288.0	70.5	83.6	87.2
105°	363.1	399.0	72.9	85.9	90.8
107.5°	448.0	477.8	75.3	88.4	93.2
110°	529.3	554.2	209.1	89.7	94.3

TEST NUMBER: P917333

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	605.7	627.1	606.8	91.9	95.6
115°	686.9	707.2	737.1	184.0	98.0
117.5°	757.3	781.2	801.6	630.7	317.7
120°	836.3	854.1	875.7	890.0	728.7
122.5°	903.0	922.2	946.2	953.2	954.6
125°	971.2	986.8	1009.4	1017.8	1021.3
127.5°	1033.3	1050.0	1068.0	1079.9	1081.1
130°	1091.8	1111.0	1124.1	1137.3	1136.1
132.5°	1151.6	1167.2	1180.2	1191.0	1189.8
135°	1201.8	1221.0	1231.6	1243.7	1241.2
137.5°	1254.3	1268.6	1280.7	1292.6	1289.1
140°	1305.6	1315.3	1328.4	1339.1	1333.2
142.5°	1348.7	1357.1	1372.6	1382.1	1376.1
145°	1394.2	1392.9	1413.2	1421.6	1415.6
147.5°	1433.5	1429.9	1450.2	1456.1	1451.5
150°	1471.8	1463.4	1482.5	1489.6	1483.7
152.5°	1504.0	1494.4	1512.3	1519.6	1511.2
155°	1535.0	1524.4	1538.7	1545.8	1536.3
157.5°	1560.2	1550.6	1561.4	1569.8	1560.2
160°	1581.7	1574.4	1581.7	1588.8	1580.5
162.5°	1600.7	1593.6	1599.5	1607.9	1597.2
165°	1617.5	1610.4	1613.9	1622.3	1613.9
167.5°	1630.6	1623.4	1627.1	1635.5	1624.6
170°	1641.4	1634.2	1636.6	1644.9	1634.2
172.5°	1648.5	1641.4	1643.8	1652.2	1641.4
175°	1654.5	1646.1	1648.5	1656.8	1644.9
177.5°	1656.8	1648.5	1649.8	1658.2	1647.4
180°	1650.9	1650.9	1650.9	1650.9	1650.9

TEST NUMBER: P917333

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.95	10.81	10.91	11.78	13.06	9.51	10.37	10.46	11.34	12.61
	3H	11.61	12.38	12.57	13.36	14.65	11.12	11.89	12.08	12.87	14.16
	4H	12.19	12.92	13.17	13.91	15.21	11.70	12.43	12.68	13.41	14.71
	6H	12.59	13.26	13.58	14.25	15.57	12.09	12.76	13.08	13.75	15.07
	8H	12.69	13.33	13.69	14.34	15.65	12.19	12.83	13.19	13.84	15.15
	12H	12.74	13.35	13.74	14.35	15.68	12.23	12.84	13.23	13.84	15.17
4H	2H	10.41	11.14	11.40	12.12	13.43	10.05	10.78	11.04	11.77	13.07
	3H	12.27	12.88	13.27	13.89	15.21	11.86	12.47	12.86	13.48	14.80
	4H	12.98	13.54	13.98	14.54	15.88	12.55	13.11	13.56	14.12	15.46
	6H	13.49	13.97	14.51	15.00	16.34	13.06	13.54	14.07	14.57	15.90
	8H	13.64	14.09	14.65	15.11	16.46	13.20	13.65	14.22	14.67	16.02
	12H	13.71	14.11	14.74	15.15	16.51	13.26	13.66	14.30	14.70	16.06
8H	4H	13.17	13.62	14.19	14.64	15.99	12.79	13.24	13.81	14.27	15.62
	6H	13.80	14.17	14.84	15.23	16.58	13.41	13.78	14.45	14.85	16.20
	8H	14.01	14.34	15.06	15.39	16.76	13.62	13.95	14.67	15.00	16.37
	12H	14.14	14.43	15.20	15.48	16.89	13.73	14.02	14.78	15.06	16.47
12H	4H	13.16	13.56	14.19	14.60	15.96	12.79	13.19	13.82	14.23	15.59
	6H	13.82	14.15	14.87	15.20	16.57	13.45	13.78	14.50	14.83	16.20
	8H	14.06	14.35	15.12	15.40	16.81	13.68	13.97	14.74	15.02	16.43

END OF REPORT