

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917335

Luminaire Tested: DFN2DIP-SQ3F0-060D060US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917335
REPORT IS A COMBINATION OF REPORTS P901422 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D060US930-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9000.9 lumens
Efficiency: N/A
Efficacy: 91.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917335

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-RLLONL

Luminous Intensity Polar Plot

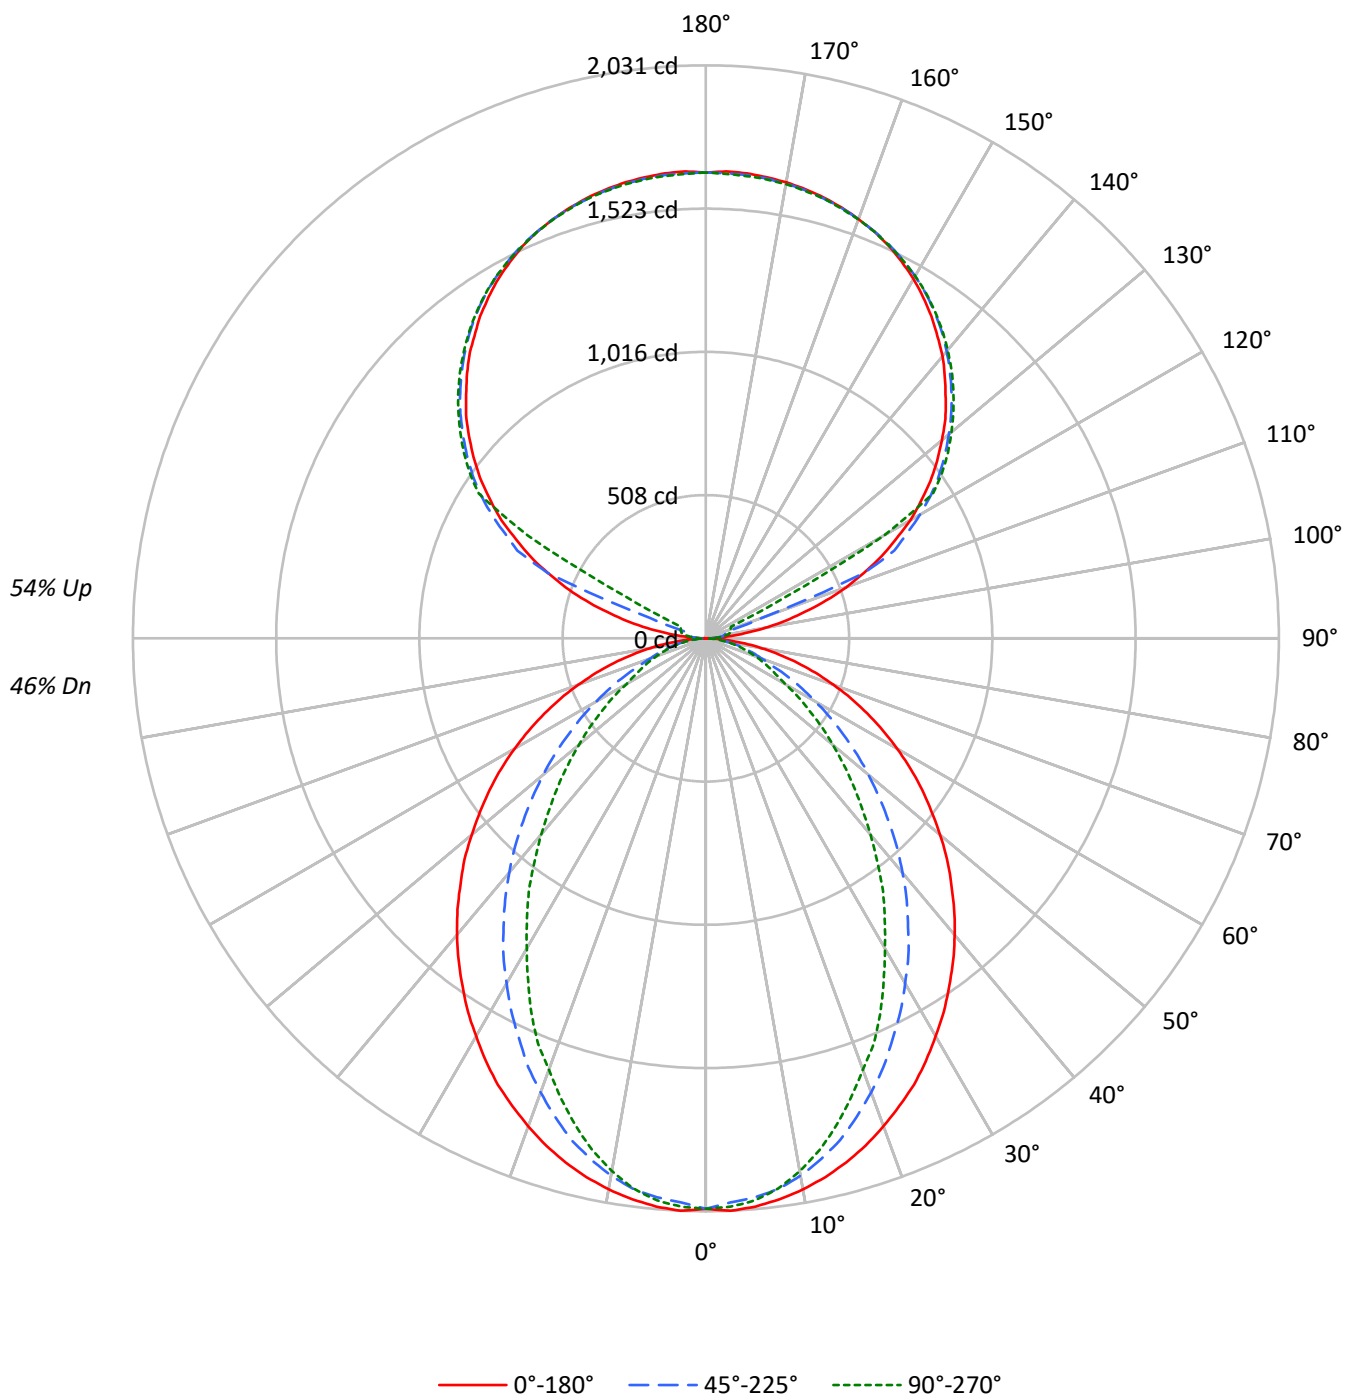

TEST NUMBER: P917335

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2317	2317	2317
5°	2319	2278	2294
10°	2294	2232	2218
15°	2261	2157	2102
20°	2218	2054	1960
25°	2174	1938	1823
30°	2115	1820	1649
35°	2057	1693	1496
40°	1998	1562	1321
45°	1930	1417	1163
50°	1859	1271	1008
55°	1784	1114	859
60°	1699	951	706
65°	1600	786	635
70°	1479	631	573
75°	1328	553	520
80°	1110	459	449
85°	753	299	332

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1930 cd/sqm

TEST NUMBER: P917335

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	2.1
10°-20°	520.2	5.8
20°-30°	730.3	8.1
30°-40°	796.1	8.8
40°-50°	731.7	8.1
50°-60°	574.6	6.4
60°-70°	374.0	4.2
70°-80°	192.5	2.1
80°-90°	52.0	0.6
90°-100°	54.4	0.6
100°-110°	202.9	2.3
110°-120°	538.2	6.0
120°-130°	892.7	9.9
130°-140°	948.2	10.5
140°-150°	881.3	9.8
150°-160°	708.5	7.9
160°-170°	456.5	5.1
170°-180°	157.1	1.7
0°-30°	1439.9	16.0
0°-40°	2236.0	24.8
0°-60°	3542.3	39.4
0°-90°	4160.9	46.2
90°-120°	795.6	8.8
90°-150°	3517.8	39.1
90°-180°	4840.0	53.8
0°-180°	9000.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	1	14	24	30	32	8
95°	78	38	47	53	51	92
105°	363	399	73	86	91	388
115°	687	707	737	184	98	676
125°	971	987	1009	1018	1021	866
135°	1202	1221	1232	1244	1241	928
145°	1394	1393	1413	1422	1416	872
155°	1535	1524	1539	1546	1536	707
165°	1618	1610	1614	1622	1614	457
175°	1654	1646	1648	1657	1645	157
180°	1651	1651	1651	1651	1651	

TEST NUMBER: P917335

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	1.1	14.3	23.8	29.9	32.2
92.5°	29.9	25.1	28.6	31.1	32.2
95°	77.6	38.2	46.6	52.7	51.4
97.5°	139.7	41.8	60.8	64.6	65.7
100°	211.5	47.8	68.1	77.6	80.0
102.5°	290.2	288.0	70.5	83.6	87.2
105°	363.1	399.0	72.9	85.9	90.8
107.5°	448.0	477.8	75.3	88.4	93.2
110°	529.3	554.2	209.1	89.7	94.3

TEST NUMBER: P917335

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	605.7	627.1	606.8	91.9	95.6
115°	686.9	707.2	737.1	184.0	98.0
117.5°	757.3	781.2	801.6	630.7	317.7
120°	836.3	854.1	875.7	890.0	728.7
122.5°	903.0	922.2	946.2	953.2	954.6
125°	971.2	986.8	1009.4	1017.8	1021.3
127.5°	1033.3	1050.0	1068.0	1079.9	1081.1
130°	1091.8	1111.0	1124.1	1137.3	1136.1
132.5°	1151.6	1167.2	1180.2	1191.0	1189.8
135°	1201.8	1221.0	1231.6	1243.7	1241.2
137.5°	1254.3	1268.6	1280.7	1292.6	1289.1
140°	1305.6	1315.3	1328.4	1339.1	1333.2
142.5°	1348.7	1357.1	1372.6	1382.1	1376.1
145°	1394.2	1392.9	1413.2	1421.6	1415.6
147.5°	1433.5	1429.9	1450.2	1456.1	1451.5
150°	1471.8	1463.4	1482.5	1489.6	1483.7
152.5°	1504.0	1494.4	1512.3	1519.6	1511.2
155°	1535.0	1524.4	1538.7	1545.8	1536.3
157.5°	1560.2	1550.6	1561.4	1569.8	1560.2
160°	1581.7	1574.4	1581.7	1588.8	1580.5
162.5°	1600.7	1593.6	1599.5	1607.9	1597.2
165°	1617.5	1610.4	1613.9	1622.3	1613.9
167.5°	1630.6	1623.4	1627.1	1635.5	1624.6
170°	1641.4	1634.2	1636.6	1644.9	1634.2
172.5°	1648.5	1641.4	1643.8	1652.2	1641.4
175°	1654.5	1646.1	1648.5	1656.8	1644.9
177.5°	1656.8	1648.5	1649.8	1658.2	1647.4
180°	1650.9	1650.9	1650.9	1650.9	1650.9

TEST NUMBER: P917335

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.67	10.47	10.66	11.47	12.80	5.63	6.43	6.63	7.43	8.76
	3H	11.34	12.05	12.35	13.07	14.41	6.81	7.53	7.82	8.54	9.88
	4H	11.94	12.62	12.96	13.63	14.99	7.25	7.93	8.27	8.95	10.30
	6H	12.36	12.98	13.39	14.00	15.37	7.57	8.19	8.60	9.21	10.58
	8H	12.48	13.08	13.52	14.11	15.47	7.65	8.25	8.69	9.28	10.65
	12H	12.54	13.10	13.58	14.13	15.52	7.69	8.26	8.73	9.29	10.67
4H	2H	9.68	10.36	10.71	11.37	12.73	6.22	6.90	7.24	7.91	9.27
	3H	11.50	12.06	12.54	13.11	14.48	7.56	8.12	8.59	9.17	10.53
	4H	12.19	12.70	13.23	13.74	15.13	8.10	8.62	9.14	9.65	11.04
	6H	12.70	13.14	13.75	14.20	15.59	8.51	8.95	9.56	10.01	11.40
	8H	12.87	13.28	13.92	14.33	15.74	8.64	9.05	9.69	10.10	11.50
	12H	12.96	13.33	14.03	14.40	15.81	8.70	9.07	9.76	10.13	11.54
8H	4H	12.15	12.57	13.20	13.62	15.02	8.38	8.79	9.43	9.84	11.24
	6H	12.71	13.05	13.79	14.15	15.55	8.88	9.22	9.96	10.32	11.72
	8H	12.93	13.23	14.01	14.30	15.72	9.07	9.37	10.15	10.45	11.87
	12H	13.06	13.32	14.14	14.39	15.86	9.18	9.45	10.27	10.52	11.98
12H	4H	12.10	12.48	13.17	13.54	14.95	8.38	8.75	9.45	9.82	11.22
	6H	12.69	12.99	13.77	14.06	15.48	8.93	9.23	10.01	10.31	11.73
	8H	12.90	13.17	13.99	14.24	15.70	9.14	9.40	10.22	10.47	11.93

END OF REPORT