

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917352

Luminaire Tested: DFN2DIP-SQ3F0-060D110US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917352
REPORT IS A COMBINATION OF REPORTS P899991 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D110US930-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12779.8 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 139.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917352

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US930-FLLFLL

Luminous Intensity Polar Plot

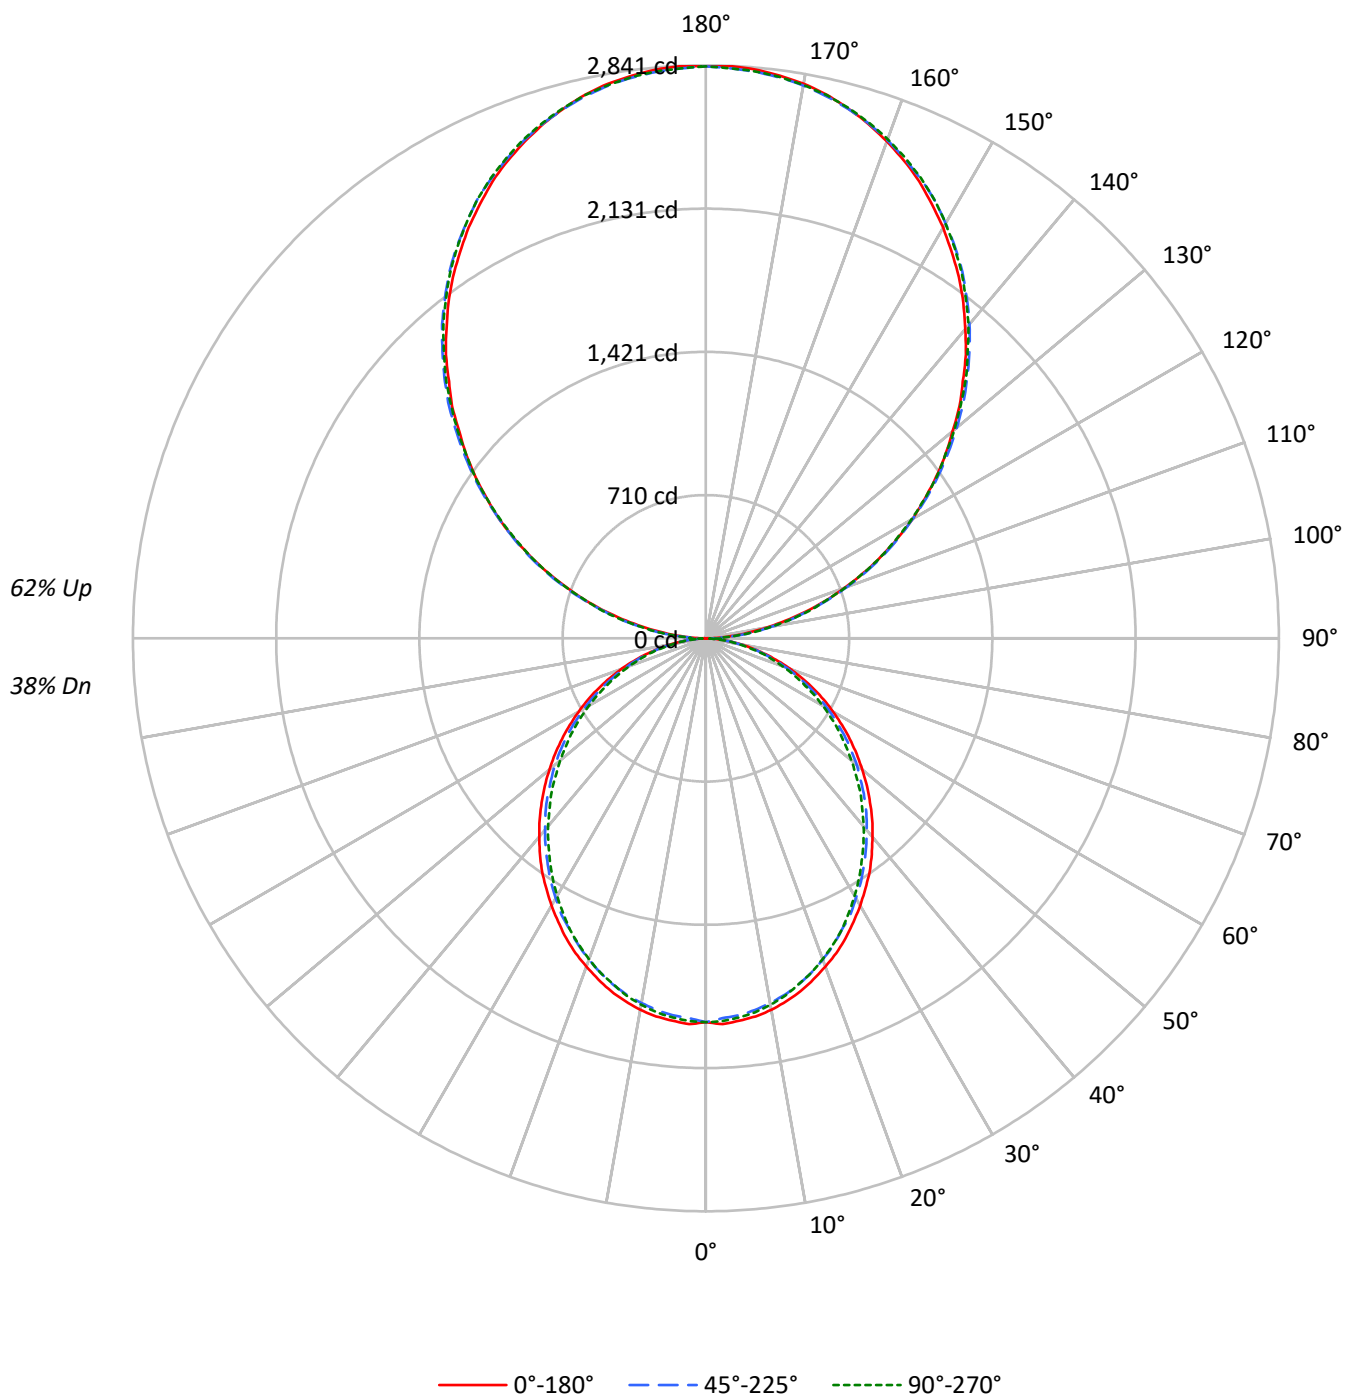

TEST NUMBER: P917352

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	60	60	60	45	45	45
1	95	91	87	84	86	83	79	76	67	65	63	53	51	50	40	39	38
2	87	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	37	33	30	28	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	36	31	51	41	34	29	33	28	24	27	23	20	21	18	16
8	52	40	32	27	47	37	30	25	30	25	22	25	21	18	19	16	14
9	48	37	29	24	44	34	27	23	28	23	19	23	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2181	2181	2181
5°	2183	2149	2164
10°	2164	2119	2134
15°	2131	2082	2088
20°	2086	2032	2040
25°	2042	1973	1985
30°	1987	1918	1916
35°	1935	1853	1842
40°	1871	1787	1772
45°	1807	1721	1700
50°	1737	1651	1617
55°	1663	1571	1541
60°	1580	1476	1453
65°	1489	1377	1350
70°	1373	1257	1238
75°	1213	1113	1134
80°	1020	928	938
85°	717	615	614

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2852 cd/sqm

TEST NUMBER: P917352

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	179.1	1.4
10°-20°	504.1	3.9
20°-30°	740.8	5.8
30°-40°	860.4	6.7
40°-50°	859.3	6.7
50°-60°	749.3	5.9
60°-70°	553.9	4.3
70°-80°	313.4	2.5
80°-90°	90.8	0.7
90°-100°	175.5	1.4
100°-110°	557.7	4.4
110°-120°	954.3	7.5
120°-130°	1255.1	9.8
130°-140°	1408.8	11.0
140°-150°	1381.5	10.8
150°-160°	1158.9	9.1
160°-170°	768.5	6.0
170°-180°	268.6	2.1
0°-30°	1424.0	11.1
0°-40°	2284.3	17.9
0°-60°	3892.9	30.5
0°-90°	4850.9	38.0
90°-120°	1687.5	13.2
90°-150°	5732.8	44.9
90°-180°	7929.0	62.0
0°-180°	12779.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1903	1903	1903	1903	1903	
5°	1903	1896	1876	1891	1887	181
15°	1812	1801	1777	1785	1776	510
25°	1640	1625	1594	1598	1594	755
35°	1415	1397	1367	1356	1347	884
45°	1151	1138	1111	1091	1084	889
55°	871	860	838	816	807	779
65°	588	577	558	542	533	581
75°	307	304	295	284	287	328
85°	75	73	71	66	64	84
90°	2	31	84	79	81	12
95°	125	149	153	153	149	139
105°	515	522	527	531	531	543
115°	958	971	967	965	958	947
125°	1393	1414	1407	1400	1397	1245
135°	1802	1828	1833	1831	1824	1393
145°	2187	2204	2218	2221	2211	1367
155°	2501	2508	2516	2528	2520	1151
165°	2721	2718	2718	2735	2723	768
175°	2831	2824	2819	2836	2822	269
180°	2836	2836	2836	2836	2836	

TEST NUMBER: P917352

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1903.4	1903.4	1903.4	1903.4	1903.4
2.5°	1914.5	1905.4	1885.1	1903.4	1899.9
5°	1903.4	1896.2	1876.0	1890.6	1887.1
7.5°	1890.6	1879.8	1859.5	1874.3	1870.6
10°	1870.6	1857.8	1835.8	1850.4	1844.9
12.5°	1843.1	1832.1	1810.2	1819.3	1815.7
15°	1811.9	1801.1	1777.2	1784.6	1775.5
17.5°	1773.5	1762.7	1738.8	1747.8	1738.8
20°	1731.4	1720.5	1694.8	1700.3	1693.1
22.5°	1689.5	1672.9	1649.0	1649.0	1645.4
25°	1639.9	1625.4	1594.2	1597.7	1594.2
27.5°	1584.9	1572.1	1548.4	1543.0	1533.9
30°	1530.2	1515.4	1488.1	1482.6	1475.2
32.5°	1471.5	1460.7	1431.3	1420.2	1412.9
35°	1414.9	1396.6	1367.3	1356.2	1347.0
37.5°	1350.8	1334.2	1305.0	1292.1	1283.0
40°	1284.9	1270.2	1240.9	1224.6	1217.2
42.5°	1220.8	1206.1	1177.0	1158.5	1147.6
45°	1151.4	1138.5	1110.9	1091.0	1083.5
47.5°	1083.5	1070.7	1041.5	1021.2	1010.3
50°	1012.1	1003.0	977.4	951.7	942.6
52.5°	942.6	929.8	906.0	885.9	873.1
55°	871.3	860.2	838.3	816.4	807.2
57.5°	799.9	790.8	766.9	744.9	737.5
60°	728.4	721.2	695.6	675.4	669.9
62.5°	658.8	646.0	627.8	609.5	602.2
65°	587.6	576.6	558.3	541.8	532.6
67.5°	514.4	505.1	488.8	476.0	468.6
70°	446.6	439.3	422.7	409.9	402.8
72.5°	377.1	369.7	360.6	347.8	342.3
75°	307.4	303.9	294.6	283.7	287.4
77.5°	245.2	237.9	234.2	228.8	223.3
80°	183.1	181.2	177.5	172.0	168.4
82.5°	124.5	124.5	122.7	115.4	115.4
85°	74.9	73.2	71.4	65.8	64.1
87.5°	33.0	29.4	25.6	20.2	18.3
90°	2.5	30.8	83.8	78.7	81.2
92.5°	53.0	71.8	74.4	77.0	77.0
95°	124.8	148.8	153.0	153.0	148.8
97.5°	207.8	230.0	239.5	239.5	239.5
100°	303.5	323.2	330.0	330.0	327.5
102.5°	404.5	419.0	428.4	431.0	428.4
105°	514.8	521.6	526.8	531.0	531.0
107.5°	624.2	634.5	634.5	636.2	624.2
110°	730.3	744.0	744.0	744.0	737.1

TEST NUMBER: P917352

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	844.8	859.3	856.8	849.9	844.8
115°	957.7	971.3	967.1	964.6	957.7
117.5°	1069.8	1088.5	1076.5	1069.8	1062.9
120°	1182.6	1201.4	1182.6	1182.6	1174.9
122.5°	1285.2	1309.1	1297.1	1290.3	1285.2
125°	1392.9	1414.3	1407.4	1399.8	1397.2
127.5°	1498.1	1524.6	1515.2	1505.0	1498.1
130°	1596.4	1627.3	1622.9	1617.8	1608.4
132.5°	1706.7	1730.7	1732.4	1720.4	1713.6
135°	1801.6	1828.1	1833.3	1830.8	1823.9
137.5°	1907.7	1929.1	1933.3	1931.6	1921.4
140°	2000.9	2022.3	2034.3	2034.3	2024.9
142.5°	2096.7	2118.1	2124.9	2127.4	2118.1
145°	2187.3	2204.4	2218.1	2220.6	2211.3
147.5°	2268.6	2289.9	2300.2	2304.4	2295.1
150°	2352.4	2366.9	2376.3	2384.0	2376.3
152.5°	2426.7	2441.2	2453.2	2462.7	2453.2
155°	2501.2	2507.9	2515.7	2527.7	2519.9
157.5°	2565.3	2570.4	2574.6	2591.8	2579.8
160°	2622.6	2627.7	2630.2	2644.8	2634.6
162.5°	2675.6	2675.6	2678.2	2694.4	2682.4
165°	2720.9	2718.3	2718.3	2735.4	2723.4
167.5°	2761.9	2754.2	2754.2	2771.4	2759.4
170°	2792.7	2785.9	2783.3	2800.4	2785.9
172.5°	2814.1	2807.2	2804.7	2821.8	2807.2
175°	2831.2	2824.4	2819.2	2836.3	2821.8
177.5°	2840.6	2833.7	2828.6	2843.2	2828.6
180°	2836.3	2836.3	2836.3	2836.3	2836.3

TEST NUMBER: P917352

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.72	9.48	9.77	10.54	11.97	8.27	9.04	9.33	10.09	11.53
	3H	10.37	11.05	11.43	12.12	13.57	9.88	10.56	10.94	11.63	13.08
	4H	10.95	11.59	12.02	12.66	14.12	10.45	11.10	11.53	12.17	13.63
	6H	11.34	11.93	12.42	13.01	14.48	10.84	11.43	11.92	12.51	13.98
	8H	11.44	12.00	12.53	13.09	14.56	10.93	11.50	12.02	12.59	14.06
	12H	11.48	12.02	12.57	13.10	14.59	10.97	11.51	12.06	12.59	14.08
4H	2H	9.16	9.81	10.24	10.88	12.34	8.81	9.46	9.89	10.52	11.98
	3H	11.01	11.55	12.10	12.65	14.12	10.61	11.15	11.69	12.24	13.71
	4H	11.72	12.22	12.81	13.30	14.80	11.30	11.79	12.39	12.88	14.37
	6H	12.22	12.65	13.33	13.76	15.25	11.79	12.22	12.89	13.33	14.81
	8H	12.37	12.77	13.47	13.87	15.37	11.93	12.33	13.03	13.43	14.93
	12H	12.44	12.80	13.56	13.91	15.42	11.99	12.35	13.11	13.46	14.97
8H	4H	11.90	12.30	13.01	13.40	14.91	11.53	11.92	12.63	13.03	14.53
	6H	12.53	12.85	13.65	14.00	15.50	12.14	12.47	13.27	13.61	15.11
	8H	12.74	13.03	13.87	14.15	15.67	12.35	12.64	13.48	13.76	15.28
	12H	12.87	13.12	14.00	14.24	15.79	12.45	12.71	13.59	13.83	15.38
12H	4H	11.88	12.24	13.00	13.36	14.87	11.52	11.88	12.64	12.99	14.50
	6H	12.55	12.84	13.68	13.97	15.48	12.18	12.47	13.31	13.59	15.11
	8H	12.79	13.04	13.92	14.16	15.72	12.41	12.66	13.54	13.78	15.33

END OF REPORT