

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917395

Luminaire Tested: DFN2DIP-SQ3F0-070D120US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917395
REPORT IS A COMBINATION OF REPORTS P901532 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D120US930-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14536.7 lumens
Efficiency: N/A
Efficacy: 91.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 159.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917395

CATALOG NUMBER: DFN2DIP-SQ3F0-070D120US930-RLLONL

Luminous Intensity Polar Plot

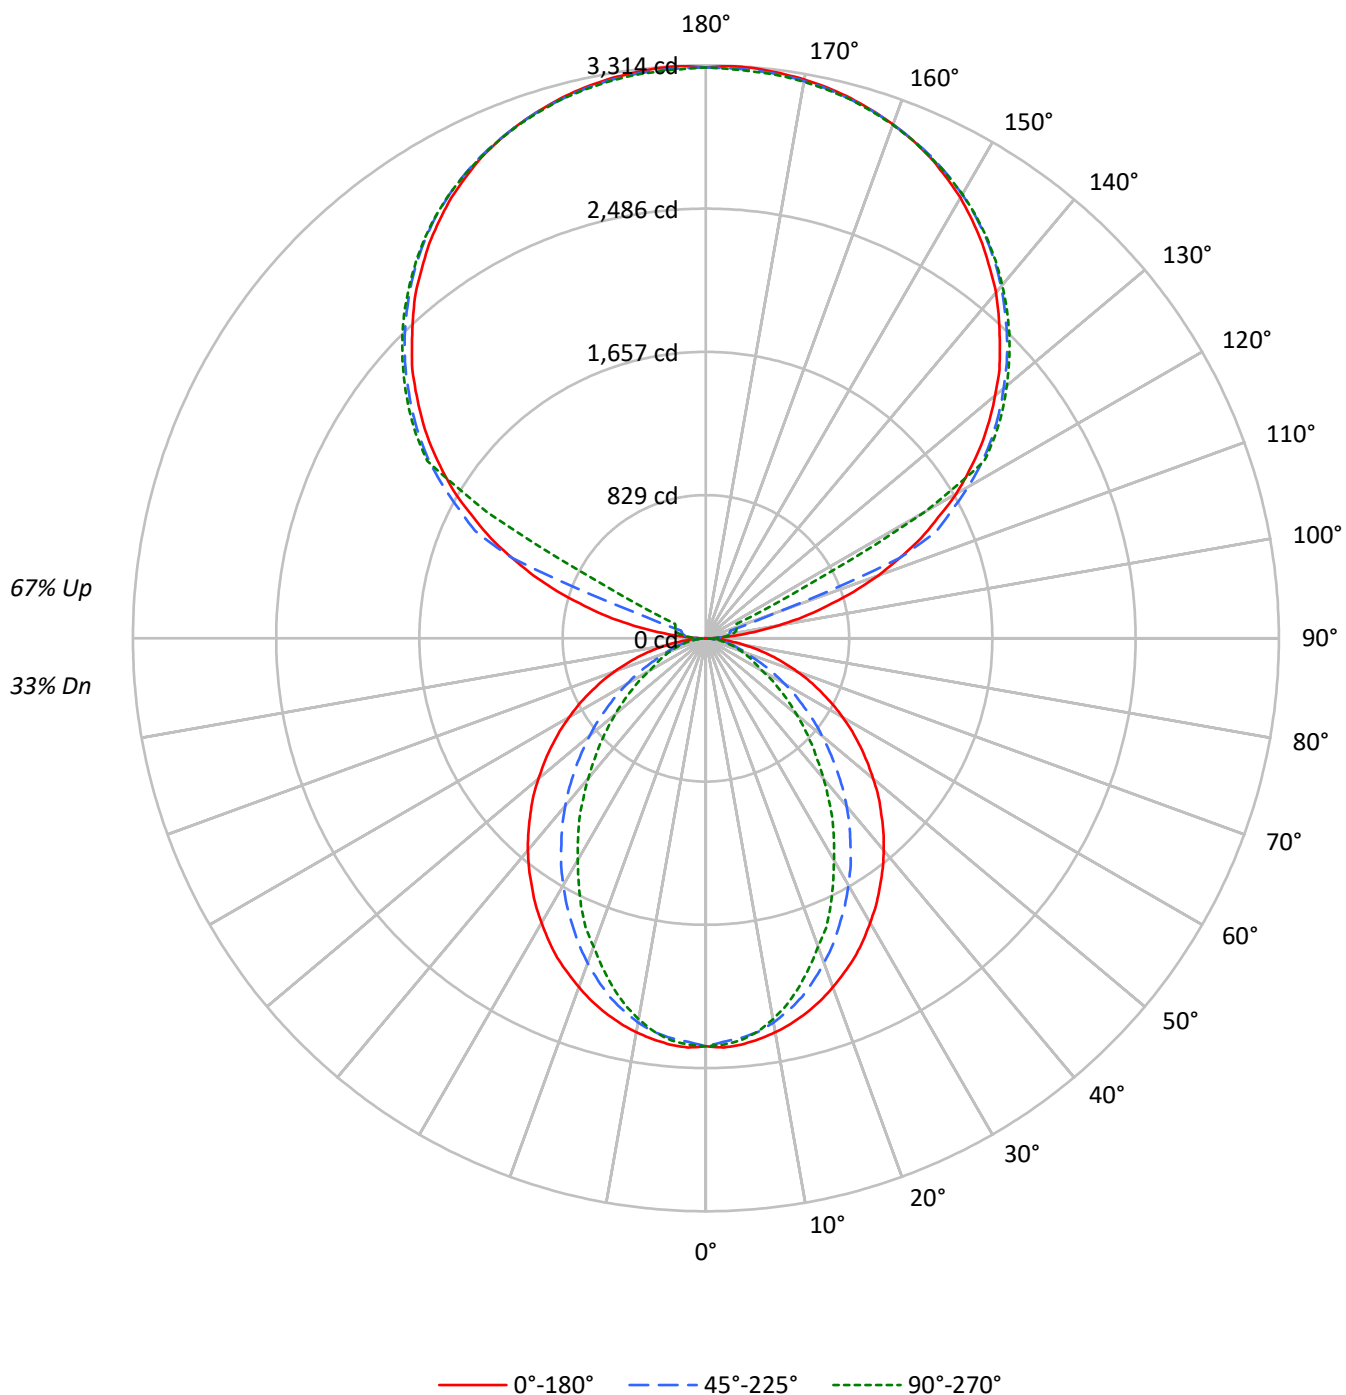

TEST NUMBER: P917395

CATALOG NUMBER: DFN2DIP-SQ3F0-070D120US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	87	83	85	82	79	76	65	63	61	50	49	48	37	36	35
2	86	79	73	69	78	72	67	63	58	54	51	45	42	40	33	31	30
3	79	70	63	57	71	63	57	53	51	47	43	40	37	35	29	27	26
4	72	62	54	49	65	56	50	45	45	41	37	36	32	30	26	24	23
5	66	55	48	42	60	50	44	39	41	36	32	32	29	26	24	22	20
6	61	50	42	36	55	45	38	34	37	32	28	29	25	23	22	19	18
7	56	45	37	32	51	41	34	29	33	28	25	26	23	20	20	18	16
8	52	41	33	28	47	37	31	26	30	26	22	24	21	18	18	16	14
9	49	37	30	25	44	34	28	23	28	23	20	22	19	16	17	15	13
10	45	34	27	22	41	31	25	21	26	21	18	21	17	15	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2703	2703	2703
5°	2705	2658	2676
10°	2677	2604	2588
15°	2638	2516	2453
20°	2588	2396	2287
25°	2536	2261	2126
30°	2467	2124	1924
35°	2400	1976	1746
40°	2331	1823	1541
45°	2251	1653	1357
50°	2168	1482	1176
55°	2082	1300	1002
60°	1982	1110	824
65°	1866	916	741
70°	1726	736	669
75°	1550	645	607
80°	1295	536	523
85°	878	349	388

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2262 cd/sqm

TEST NUMBER: P917395

CATALOG NUMBER: DFN2DIP-SQ3F0-070D120US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.1	1.5
10°-20°	606.9	4.2
20°-30°	852.0	5.9
30°-40°	928.8	6.4
40°-50°	853.6	5.9
50°-60°	670.4	4.6
60°-70°	436.4	3.0
70°-80°	224.6	1.5
80°-90°	63.1	0.4
90°-100°	108.9	0.7
100°-110°	405.9	2.8
110°-120°	1076.4	7.4
120°-130°	1785.3	12.3
130°-140°	1896.5	13.0
140°-150°	1762.5	12.1
150°-160°	1417.0	9.7
160°-170°	913.1	6.3
170°-180°	314.3	2.2
0°-30°	1679.9	11.6
0°-40°	2608.7	17.9
0°-60°	4132.7	28.4
0°-90°	4856.8	33.4
90°-120°	1591.2	10.9
90°-150°	7035.5	48.4
90°-180°	9680.0	66.6
0°-180°	14536.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2359	2359	2359	2359	2359	
5°	2359	2348	2320	2340	2333	224
15°	2244	2220	2147	2107	2086	632
25°	2036	1968	1827	1740	1708	937
35°	1755	1646	1458	1324	1276	1098
45°	1434	1291	1067	916	864	1108
55°	1091	924	694	566	525	975
65°	736	564	371	299	292	730
75°	393	243	171	156	154	415
85°	92	47	40	40	40	105
90°	2	29	48	60	64	14
95°	155	76	93	105	103	184
105°	726	798	146	172	182	776
115°	1374	1414	1474	368	196	1352
125°	1942	1974	2019	2036	2043	1732
135°	2404	2442	2463	2487	2482	1857
145°	2788	2786	2826	2843	2831	1744
155°	3070	3049	3077	3092	3073	1415
165°	3235	3221	3228	3245	3228	914
175°	3309	3292	3297	3314	3290	315
180°	3302	3302	3302	3302	3302	

TEST NUMBER: P917395

CATALOG NUMBER: DFN2DIP-SQ3F0-070D120US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2358.7	2358.7	2358.7	2358.7	2358.7
2.5°	2369.3	2358.7	2335.2	2356.7	2352.4
5°	2358.7	2348.1	2320.3	2339.5	2333.1
7.5°	2339.5	2326.8	2296.9	2305.3	2294.7
10°	2313.9	2299.0	2256.3	2249.8	2237.1
12.5°	2281.9	2262.7	2205.0	2192.3	2168.7
15°	2243.5	2219.9	2147.4	2106.9	2085.6
17.5°	2198.6	2164.5	2074.8	2027.8	1993.6
20°	2147.4	2104.6	1998.0	1944.7	1897.6
22.5°	2092.0	2042.8	1918.9	1846.4	1814.5
25°	2036.5	1968.0	1827.2	1739.8	1707.6
27.5°	1970.3	1897.6	1741.8	1641.5	1592.4
30°	1899.9	1818.6	1647.8	1539.1	1481.4
32.5°	1831.5	1733.2	1558.4	1430.2	1376.7
35°	1754.7	1645.8	1458.1	1323.6	1276.4
37.5°	1680.0	1562.4	1364.1	1216.6	1163.4
40°	1600.9	1473.0	1265.8	1114.3	1058.7
42.5°	1519.9	1383.3	1167.7	1009.6	956.4
45°	1434.5	1291.4	1067.4	915.7	864.5
47.5°	1353.4	1201.9	971.3	819.6	772.7
50°	1263.7	1112.2	877.3	729.9	685.3
52.5°	1176.1	1015.9	787.7	646.8	606.3
55°	1090.7	924.2	693.7	565.7	525.2
57.5°	1003.3	832.5	610.6	491.0	456.8
60°	913.6	742.8	522.9	414.3	380.0
62.5°	826.1	655.4	448.2	345.8	328.8
65°	736.5	563.5	371.4	299.0	292.4
67.5°	651.1	478.1	299.0	262.4	256.2
70°	561.4	394.9	247.5	226.2	217.6
72.5°	476.1	318.0	207.0	190.0	185.7
75°	392.7	243.2	170.7	155.8	153.8
77.5°	309.6	172.8	134.5	125.9	121.6
80°	232.6	123.8	102.4	94.0	94.0
82.5°	162.2	83.3	70.4	66.1	66.1
85°	91.7	46.9	40.5	40.5	40.5
87.5°	34.2	17.0	17.0	14.9	14.9
90°	2.3	28.6	47.7	59.8	64.4
92.5°	59.8	50.2	57.3	62.1	64.4
95°	155.2	76.3	93.0	105.3	102.7
97.5°	279.5	83.7	121.7	129.1	131.3
100°	423.0	95.6	136.2	155.2	160.0
102.5°	580.5	575.9	141.0	167.1	174.5
105°	726.3	798.1	145.9	171.9	181.6
107.5°	895.9	955.5	150.7	176.8	186.4
110°	1058.5	1108.5	418.2	179.3	188.7

TEST NUMBER: P917395

CATALOG NUMBER: DFN2DIP-SQ3F0-070D120US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1211.5	1254.3	1213.7	183.8	191.2
115°	1373.7	1414.3	1474.1	367.9	196.1
117.5°	1514.7	1562.4	1603.3	1261.3	635.5
120°	1672.5	1708.2	1751.3	1780.0	1457.4
122.5°	1806.1	1844.4	1892.4	1906.6	1909.1
125°	1942.3	1973.5	2018.9	2035.6	2042.7
127.5°	2066.5	2100.0	2136.1	2159.9	2162.2
130°	2183.7	2222.0	2248.1	2274.5	2272.2
132.5°	2303.1	2334.4	2360.5	2382.1	2379.8
135°	2403.6	2441.9	2463.2	2487.3	2482.5
137.5°	2508.6	2537.2	2561.3	2585.1	2578.1
140°	2611.3	2630.6	2656.6	2678.3	2666.4
142.5°	2697.5	2714.3	2745.2	2764.2	2752.3
145°	2788.3	2785.8	2826.3	2843.1	2831.1
147.5°	2866.9	2859.8	2900.4	2912.3	2903.0
150°	2943.5	2926.8	2965.1	2979.3	2967.4
152.5°	3007.9	2988.9	3024.7	3039.1	3022.4
155°	3070.0	3048.7	3077.4	3091.6	3072.6
157.5°	3120.2	3101.2	3122.8	3139.6	3120.2
160°	3163.4	3148.9	3163.4	3177.5	3160.8
162.5°	3201.4	3187.2	3199.1	3215.9	3194.3
165°	3234.9	3220.7	3227.8	3244.6	3227.8
167.5°	3261.3	3246.8	3254.2	3270.9	3249.4
170°	3282.8	3268.4	3273.2	3289.9	3268.4
172.5°	3297.0	3282.8	3287.7	3304.4	3282.8
175°	3308.9	3292.2	3297.0	3313.8	3289.9
177.5°	3313.8	3297.0	3299.6	3316.3	3294.8
180°	3301.9	3301.9	3301.9	3301.9	3301.9

TEST NUMBER: P917395

CATALOG NUMBER: DFN2DIP-SQ3F0-070D120US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.78	9.49	9.88	10.58	12.07	4.74	5.46	5.84	6.54	8.04
	3H	10.45	11.08	11.55	12.18	13.69	5.92	6.55	7.02	7.65	9.16
	4H	11.05	11.65	12.16	12.75	14.26	6.36	6.96	7.47	8.06	9.57
	6H	11.46	12.01	12.58	13.11	14.64	6.67	7.22	7.79	8.32	9.85
	8H	11.58	12.11	12.70	13.22	14.74	6.75	7.28	7.87	8.39	9.91
	12H	11.64	12.14	12.76	13.25	14.79	6.79	7.29	7.92	8.40	9.94
4H	2H	8.79	9.39	9.90	10.49	12.00	5.32	5.93	6.44	7.02	8.54
	3H	10.60	11.10	11.72	12.22	13.75	6.65	7.16	7.78	8.28	9.81
	4H	11.28	11.74	12.41	12.86	14.40	7.19	7.65	8.32	8.77	10.31
	6H	11.79	12.18	12.92	13.32	14.86	7.60	7.99	8.73	9.13	10.67
	8H	11.96	12.32	13.09	13.45	15.01	7.72	8.09	8.86	9.22	10.77
	12H	12.04	12.38	13.19	13.52	15.08	7.78	8.11	8.93	9.25	10.81
8H	4H	11.24	11.61	12.37	12.73	14.29	7.46	7.83	8.60	8.96	10.51
	6H	11.80	12.10	12.95	13.27	14.82	7.97	8.27	9.12	9.44	10.99
	8H	12.01	12.27	13.17	13.42	15.00	8.15	8.42	9.31	9.57	11.14
	12H	12.14	12.37	13.30	13.52	15.13	8.26	8.49	9.42	9.64	11.25
12H	4H	11.19	11.52	12.34	12.66	14.22	7.46	7.79	8.61	8.93	10.49
	6H	11.77	12.03	12.93	13.18	14.76	8.01	8.28	9.17	9.43	11.00
	8H	11.98	12.21	13.15	13.36	14.97	8.21	8.45	9.38	9.59	11.20