

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917458

Luminaire Tested: DFN2DIP-SQ3F0-090D100US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917458
REPORT IS A COMBINATION OF REPORTS P899980 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D100US930-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13452.5 lumens
Efficiency: N/A
Efficacy: 81.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 165.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917458

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US930-RLLFLL

Luminous Intensity Polar Plot

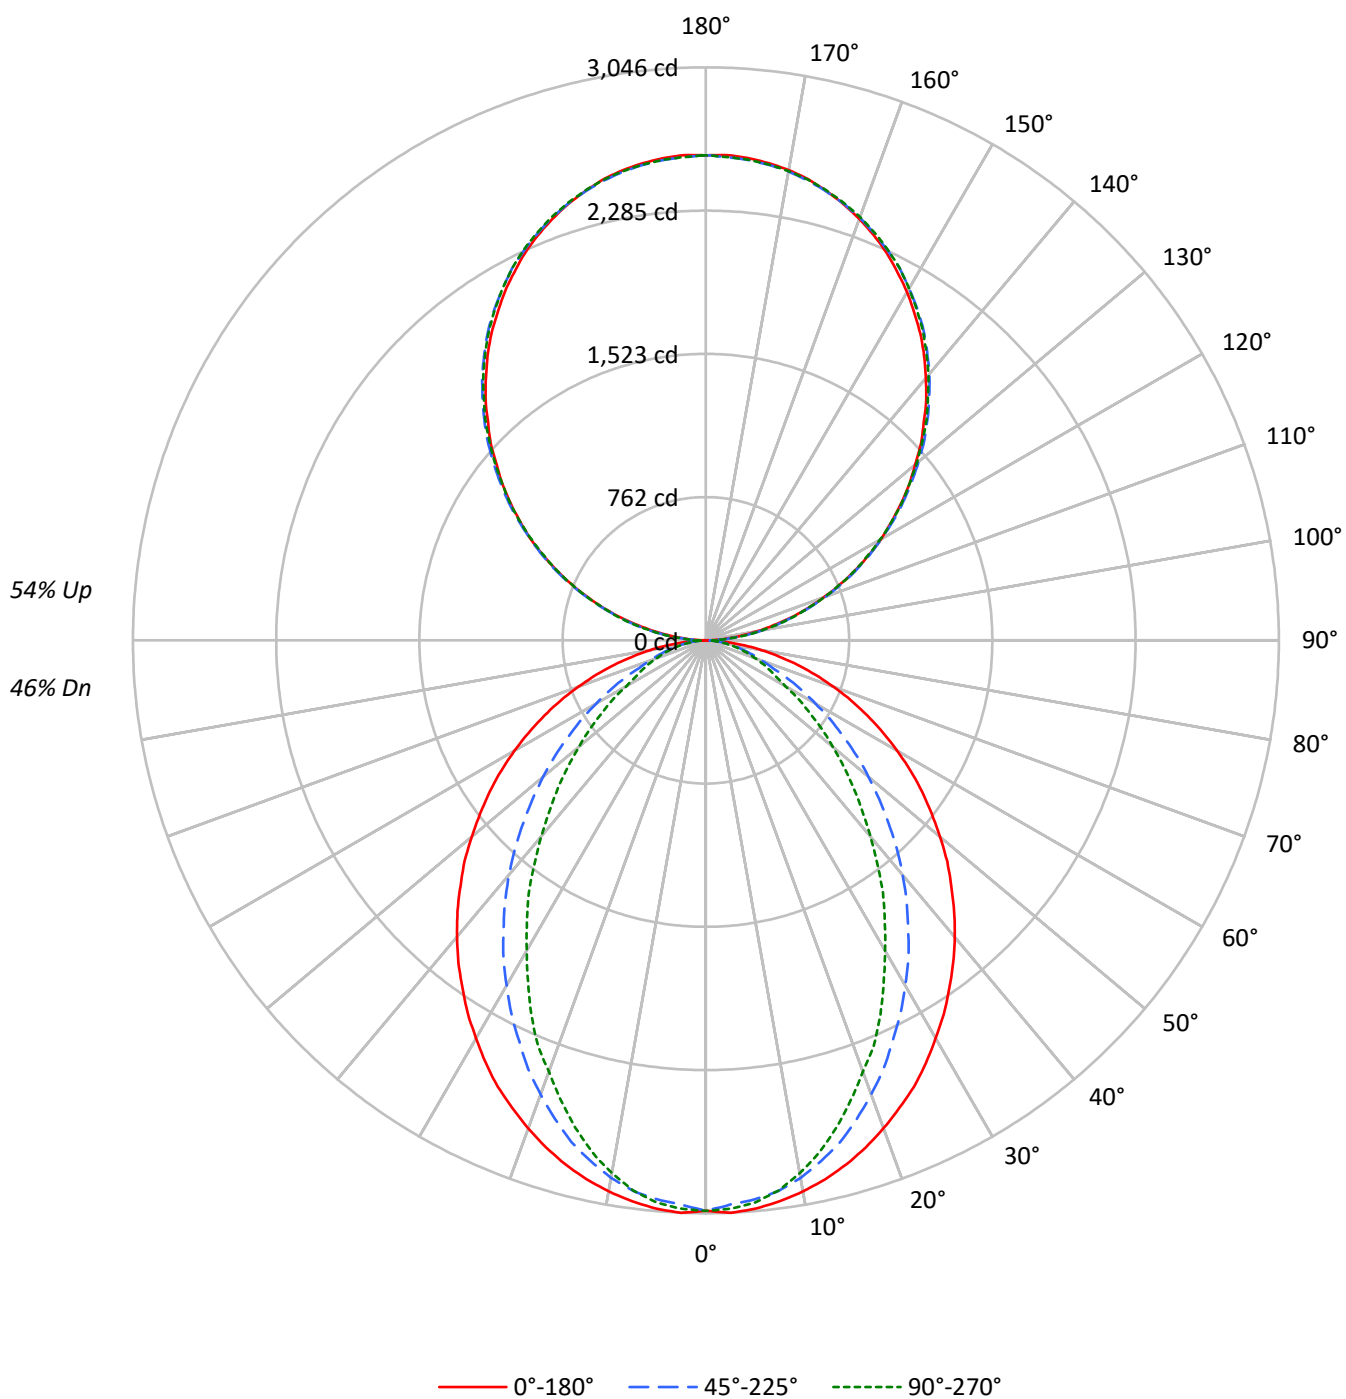

TEST NUMBER: P917458

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US930-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	71	66	64	60	57	52	50	48	42	41	39
3	82	72	65	60	75	67	61	56	56	52	48	47	44	41	38	36	34
4	75	64	57	51	69	60	53	48	50	45	41	42	38	35	34	32	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	23	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3475	3475	3475
5°	3478	3417	3440
10°	3442	3348	3327
15°	3392	3235	3153
20°	3327	3080	2940
25°	3261	2908	2734
30°	3172	2730	2473
35°	3085	2540	2244
40°	2997	2343	1982
45°	2894	2126	1744
50°	2788	1906	1512
55°	2677	1672	1289
60°	2548	1427	1060
65°	2399	1178	952
70°	2219	946	860
75°	1993	829	780
80°	1665	688	673
85°	1129	448	499

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2894 cd/sqm

TEST NUMBER: P917458

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.2	2.1
10°-20°	780.3	5.8
20°-30°	1095.5	8.1
30°-40°	1194.1	8.9
40°-50°	1097.5	8.2
50°-60°	861.9	6.4
60°-70°	561.0	4.2
70°-80°	288.8	2.1
80°-90°	81.0	0.6
90°-100°	159.6	1.2
100°-110°	507.0	3.8
110°-120°	867.6	6.4
120°-130°	1141.0	8.5
130°-140°	1280.7	9.5
140°-150°	1255.9	9.3
150°-160°	1053.5	7.8
160°-170°	698.7	5.2
170°-180°	244.2	1.8
0°-30°	2159.9	16.1
0°-40°	3354.0	24.9
0°-60°	5313.5	39.5
0°-90°	6244.4	46.4
90°-120°	1534.1	11.4
90°-150°	5211.7	38.7
90°-180°	7208.0	53.6
0°-180°	13452.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3033	3033	3033	3033	3033	
5°	3033	3019	2983	3008	3000	288
15°	2884	2854	2761	2709	2682	813
25°	2618	2530	2349	2237	2196	1204
35°	2256	2116	1875	1702	1641	1412
45°	1844	1660	1372	1177	1111	1424
55°	1402	1188	892	727	675	1253
65°	947	724	478	384	376	939
75°	505	313	220	200	198	534
85°	118	60	52	52	52	135
90°	2	28	76	72	74	13
95°	114	135	139	139	135	126
105°	468	474	479	483	483	494
115°	871	883	879	877	871	861
125°	1266	1286	1280	1272	1270	1132
135°	1638	1662	1667	1664	1658	1266
145°	1988	2004	2016	2019	2010	1242
155°	2274	2280	2287	2298	2291	1047
165°	2474	2471	2471	2487	2476	698
175°	2574	2568	2563	2578	2565	245
180°	2578	2578	2578	2578	2578	

TEST NUMBER: P917458

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US930-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3032.7	3032.7	3032.7	3032.7	3032.7
2.5°	3046.4	3032.7	3002.3	3030.1	3024.5
5°	3032.7	3019.0	2983.2	3007.9	2999.7
7.5°	3007.9	2991.6	2953.2	2963.9	2950.2
10°	2975.0	2955.8	2901.1	2892.6	2876.3
12.5°	2933.9	2909.2	2835.0	2818.6	2788.3
15°	2884.4	2854.2	2761.0	2708.8	2681.5
17.5°	2826.8	2782.9	2667.5	2607.2	2563.3
20°	2761.0	2706.0	2568.8	2500.4	2439.8
22.5°	2689.7	2626.5	2467.2	2374.0	2333.0
25°	2618.3	2530.4	2349.3	2236.9	2195.5
27.5°	2533.3	2439.8	2239.5	2110.5	2047.3
30°	2442.7	2338.2	2118.6	1978.9	1904.6
32.5°	2354.7	2228.4	2003.6	1838.8	1770.1
35°	2256.1	2116.0	1874.6	1701.7	1641.1
37.5°	2160.0	2008.9	1753.8	1564.2	1495.8
40°	2058.4	1893.9	1627.4	1432.6	1361.3
42.5°	1954.1	1778.6	1501.3	1298.1	1229.6
45°	1844.4	1660.4	1372.3	1177.2	1111.4
47.5°	1740.1	1545.3	1248.9	1053.8	993.5
50°	1624.8	1430.0	1128.0	938.5	881.1
52.5°	1512.1	1306.3	1012.8	831.6	779.5
55°	1402.3	1188.3	891.9	727.4	675.2
57.5°	1290.0	1070.4	785.1	631.3	587.3
60°	1174.6	955.0	672.4	532.6	488.6
62.5°	1062.3	842.7	576.3	444.7	422.8
65°	946.9	724.5	477.5	384.3	375.9
67.5°	837.1	614.7	384.3	337.5	329.3
70°	721.9	507.8	318.3	290.9	279.8
72.5°	612.0	408.8	266.1	244.3	238.8
75°	504.9	312.7	219.6	200.3	197.7
77.5°	398.0	222.2	172.9	161.9	156.4
80°	299.1	159.3	131.6	120.8	120.8
82.5°	208.5	107.1	90.6	85.0	85.0
85°	117.9	60.3	52.1	52.1	52.1
87.5°	43.9	21.8	21.8	19.2	19.2
90°	2.4	28.0	76.1	71.5	73.9
92.5°	48.2	65.3	67.7	70.0	70.0
95°	113.5	135.3	139.2	139.2	135.3
97.5°	188.9	209.1	217.7	217.7	217.7
100°	276.0	293.8	300.0	300.0	297.7
102.5°	367.7	380.9	389.5	391.8	389.5
105°	468.0	474.2	478.8	482.7	482.7
107.5°	567.4	576.8	576.8	578.4	567.4
110°	663.9	676.3	676.3	676.3	670.1

TEST NUMBER: P917458

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US930-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	768.0	781.2	778.9	772.7	768.0
115°	870.7	883.0	879.2	876.9	870.7
117.5°	972.5	989.6	978.7	972.5	966.2
120°	1075.1	1092.2	1075.1	1075.1	1068.1
122.5°	1168.3	1190.1	1179.2	1173.1	1168.3
125°	1266.3	1285.7	1279.5	1272.5	1270.2
127.5°	1362.0	1386.0	1377.4	1368.2	1362.0
130°	1451.3	1479.3	1475.4	1470.7	1462.2
132.5°	1551.6	1573.4	1574.9	1564.1	1557.8
135°	1637.9	1662.0	1666.6	1664.3	1658.1
137.5°	1734.3	1753.7	1757.6	1756.1	1746.7
140°	1819.0	1838.4	1849.3	1849.3	1840.8
142.5°	1906.1	1925.5	1931.7	1934.1	1925.5
145°	1988.4	2004.0	2016.5	2018.8	2010.2
147.5°	2062.3	2081.8	2091.1	2095.0	2086.4
150°	2138.5	2151.7	2160.3	2167.2	2160.3
152.5°	2206.1	2219.3	2230.2	2238.8	2230.2
155°	2273.8	2280.0	2287.0	2297.8	2290.8
157.5°	2332.1	2336.7	2340.6	2356.1	2345.3
160°	2384.2	2388.8	2391.1	2404.3	2395.0
162.5°	2432.4	2432.4	2434.6	2449.4	2438.6
165°	2473.5	2471.2	2471.2	2486.7	2475.9
167.5°	2510.9	2503.9	2503.9	2519.4	2508.5
170°	2538.8	2532.6	2530.3	2545.9	2532.6
172.5°	2558.2	2552.0	2549.7	2565.3	2552.0
175°	2573.8	2567.6	2563.0	2578.5	2565.3
177.5°	2582.4	2576.2	2571.5	2584.7	2571.5
180°	2578.5	2578.5	2578.5	2578.5	2578.5

TEST NUMBER: P917458

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US930-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.09	11.90	12.09	12.90	14.22	7.05	7.86	8.05	8.86	10.18
	3H	12.77	13.48	13.77	14.49	15.84	8.24	8.95	9.24	9.96	11.31
	4H	13.37	14.05	14.39	15.06	16.41	8.68	9.36	9.70	10.37	11.72
	6H	13.79	14.41	14.81	15.43	16.79	8.99	9.62	10.02	10.64	12.00
	8H	13.91	14.50	14.94	15.54	16.90	9.08	9.67	10.11	10.71	12.07
	12H	13.97	14.53	15.01	15.56	16.95	9.12	9.68	10.16	10.71	12.10
4H	2H	11.11	11.79	12.13	12.80	14.15	7.64	8.32	8.67	9.34	10.69
	3H	12.93	13.49	13.96	14.53	15.90	8.98	9.55	10.02	10.59	11.96
	4H	13.62	14.13	14.65	15.17	16.55	9.53	10.04	10.56	11.08	12.46
	6H	14.12	14.57	15.17	15.62	17.01	9.94	10.38	10.99	11.44	12.82
	8H	14.30	14.71	15.35	15.76	17.16	10.06	10.47	11.11	11.52	12.92
	12H	14.39	14.76	15.45	15.83	17.23	10.12	10.49	11.19	11.56	12.96
8H	4H	13.58	13.99	14.63	15.04	16.44	9.80	10.21	10.85	11.26	12.66
	6H	14.14	14.48	15.21	15.57	16.97	10.31	10.65	11.38	11.74	13.14
	8H	14.35	14.65	15.43	15.73	17.14	10.50	10.80	11.58	11.87	13.29
	12H	14.49	14.75	15.57	15.82	17.28	10.61	10.87	11.69	11.94	13.40
12H	4H	13.53	13.90	14.60	14.97	16.37	9.80	10.18	10.87	11.24	12.65
	6H	14.11	14.41	15.19	15.49	16.91	10.36	10.66	11.44	11.73	13.15
	8H	14.33	14.59	15.41	15.66	17.12	10.56	10.82	11.64	11.90	13.35

END OF REPORT