

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917481

Luminaire Tested: DFN2DIP-SQ3F0-100D070US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917481
REPORT IS A COMBINATION OF REPORTS P901447 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D070US930-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13721.5 lumens
Efficiency: N/A
Efficacy: 90.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917481

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US930-FLLONL

Luminous Intensity Polar Plot

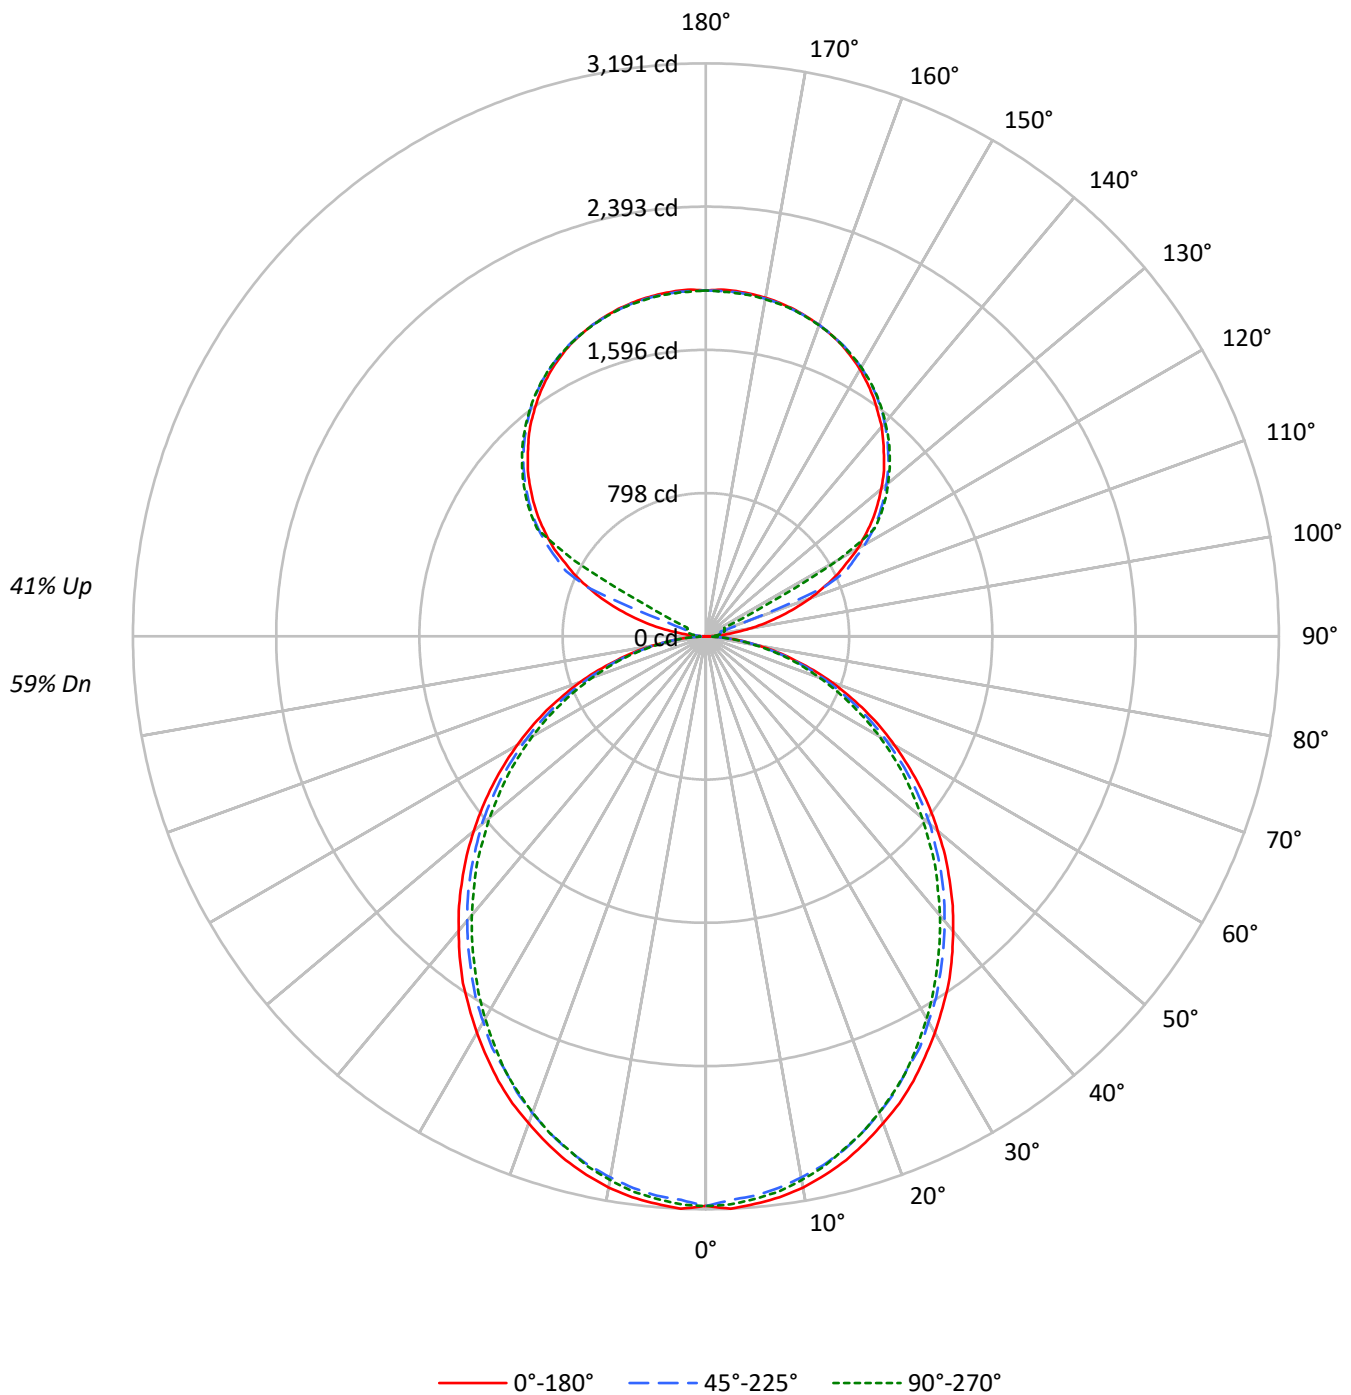

TEST NUMBER: P917481

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	77	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	72	68	68	64	60	59	55	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	41	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3635	3635	3635
5°	3638	3582	3607
10°	3607	3531	3557
15°	3551	3471	3480
20°	3477	3387	3400
25°	3404	3288	3309
30°	3312	3196	3193
35°	3225	3088	3070
40°	3118	2978	2953
45°	3011	2868	2834
50°	2894	2752	2696
55°	2772	2619	2568
60°	2633	2460	2422
65°	2481	2296	2250
70°	2289	2095	2064
75°	2022	1854	1890
80°	1699	1547	1562
85°	1196	1025	1023

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3011 cd/sqm

TEST NUMBER: P917481

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	298.6	2.2
10°-20°	840.1	6.1
20°-30°	1234.6	9.0
30°-40°	1433.9	10.5
40°-50°	1432.1	10.4
50°-60°	1248.8	9.1
60°-70°	923.1	6.7
70°-80°	522.3	3.8
80°-90°	141.2	1.0
90°-100°	63.5	0.5
100°-110°	236.8	1.7
110°-120°	627.9	4.6
120°-130°	1041.5	7.6
130°-140°	1106.3	8.1
140°-150°	1028.1	7.5
150°-160°	826.6	6.0
160°-170°	532.6	3.9
170°-180°	183.3	1.3
0°-30°	2373.3	17.3
0°-40°	3807.2	27.7
0°-60°	6488.2	47.3
0°-90°	8074.8	58.8
90°-120°	928.2	6.8
90°-150°	4104.1	29.9
90°-180°	5647.0	41.2
0°-180°	13721.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3172	3172	3172	3172	3172	
5°	3172	3160	3127	3151	3145	301
15°	3020	3002	2962	2974	2959	851
25°	2733	2709	2657	2663	2657	1258
35°	2358	2328	2279	2260	2245	1473
45°	1919	1898	1852	1818	1806	1481
55°	1452	1434	1397	1361	1345	1298
65°	979	961	930	903	888	968
75°	512	506	491	473	479	547
85°	125	122	119	110	107	139
90°	1	17	28	35	38	13
95°	90	44	54	61	60	107
105°	424	466	85	100	106	453
115°	801	825	860	215	114	789
125°	1133	1151	1178	1188	1192	1010
135°	1402	1424	1437	1451	1448	1083
145°	1626	1625	1649	1658	1652	1017
155°	1791	1778	1795	1803	1792	825
165°	1887	1879	1883	1893	1883	533
175°	1930	1920	1923	1933	1919	184
180°	1926	1926	1926	1926	1926	

TEST NUMBER: P917481

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3172.4	3172.4	3172.4	3172.4	3172.4
2.5°	3190.8	3175.6	3141.9	3172.4	3166.5
5°	3172.4	3160.4	3126.8	3151.0	3145.2
7.5°	3151.0	3132.9	3099.2	3123.8	3117.7
10°	3117.7	3096.3	3059.7	3084.0	3075.0
12.5°	3071.7	3053.6	3017.0	3032.3	3026.1
15°	3019.9	3001.8	2962.0	2974.3	2959.1
17.5°	2955.9	2937.8	2897.9	2913.1	2897.9
20°	2885.6	2867.5	2824.8	2833.8	2821.8
22.5°	2815.7	2788.2	2748.4	2748.4	2742.3
25°	2733.2	2708.9	2657.1	2662.9	2657.1
27.5°	2641.6	2620.2	2580.7	2571.7	2556.4
30°	2550.3	2525.7	2480.1	2471.0	2458.7
32.5°	2452.6	2434.5	2385.6	2367.1	2354.8
35°	2358.1	2327.7	2278.8	2260.3	2245.1
37.5°	2251.3	2223.7	2174.9	2153.5	2138.3
40°	2141.5	2116.9	2068.1	2040.9	2028.6
42.5°	2034.7	2010.1	1961.6	1930.9	1912.8
45°	1918.9	1897.5	1851.5	1818.2	1806.0
47.5°	1806.0	1784.6	1735.7	1702.0	1683.9
50°	1686.9	1671.6	1628.9	1586.2	1571.0
52.5°	1571.0	1549.6	1510.1	1476.5	1455.1
55°	1452.2	1433.8	1397.2	1360.6	1345.4
57.5°	1333.1	1317.8	1278.1	1241.5	1229.2
60°	1214.0	1202.0	1159.3	1125.6	1116.6
62.5°	1098.1	1076.8	1046.4	1015.9	1003.6
65°	979.3	960.9	930.5	902.9	887.8
67.5°	857.4	841.8	814.6	793.3	781.0
70°	744.4	732.1	704.6	683.2	671.2
72.5°	628.5	616.2	601.0	579.7	570.5
75°	512.3	506.5	491.0	472.9	479.0
77.5°	408.8	396.5	390.3	381.2	372.2
80°	305.2	302.0	295.8	286.7	280.6
82.5°	207.5	207.5	204.6	192.2	192.2
85°	124.9	122.1	119.1	109.7	106.8
87.5°	55.0	48.8	42.7	33.7	30.4
90°	1.3	16.7	27.8	34.9	37.6
92.5°	34.9	29.3	33.4	36.3	37.6
95°	90.5	44.5	54.3	61.4	59.9
97.5°	163.0	48.8	71.0	75.3	76.6
100°	246.8	55.8	79.4	90.5	93.4
102.5°	338.6	336.0	82.3	97.5	101.7
105°	423.7	465.5	85.0	100.3	105.9
107.5°	522.6	557.4	87.9	103.1	108.8
110°	617.5	646.6	243.9	104.6	110.1

TEST NUMBER: P917481

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	706.7	731.6	708.0	107.2	111.5
115°	801.4	825.0	859.9	214.7	114.4
117.5°	883.6	911.4	935.2	735.8	370.7
120°	975.6	996.5	1021.7	1038.4	850.2
122.5°	1053.5	1075.9	1103.9	1112.1	1113.6
125°	1133.0	1151.2	1177.7	1187.5	1191.6
127.5°	1205.5	1225.0	1246.0	1260.0	1261.3
130°	1273.8	1296.2	1311.4	1326.8	1325.5
132.5°	1343.5	1361.7	1377.0	1389.5	1388.2
135°	1402.1	1424.4	1436.9	1450.9	1448.1
137.5°	1463.3	1480.1	1494.1	1508.1	1503.9
140°	1523.2	1534.5	1549.7	1562.3	1555.3
142.5°	1573.5	1583.3	1601.3	1612.4	1605.5
145°	1626.5	1625.1	1648.7	1658.5	1651.5
147.5°	1672.3	1668.3	1691.9	1698.8	1693.4
150°	1717.0	1707.3	1729.7	1737.9	1731.0
152.5°	1754.6	1743.5	1764.4	1772.8	1763.1
155°	1790.9	1778.4	1795.1	1803.4	1792.4
157.5°	1820.2	1809.1	1821.6	1831.4	1820.2
160°	1845.3	1836.9	1845.3	1853.6	1843.8
162.5°	1867.5	1859.2	1866.1	1875.9	1863.4
165°	1887.0	1878.8	1882.8	1892.6	1882.8
167.5°	1902.4	1893.9	1898.3	1908.0	1895.5
170°	1915.0	1906.6	1909.3	1919.1	1906.6
172.5°	1923.3	1915.0	1917.8	1927.5	1915.0
175°	1930.2	1920.4	1923.3	1933.0	1919.1
177.5°	1933.0	1923.3	1924.8	1934.5	1921.9
180°	1926.1	1926.1	1926.1	1926.1	1926.1

TEST NUMBER: P917481

CATALOG NUMBER: DFN2DIP-SQ3F0-100D070US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.50	13.45	13.38	14.35	15.48	12.06	13.00	12.93	13.90	15.04
	3H	14.16	15.01	15.05	15.92	17.08	13.67	14.52	14.56	15.43	16.59
	4H	14.75	15.55	15.66	16.47	17.64	14.26	15.06	15.16	15.97	17.15
	6H	15.15	15.89	16.07	16.81	18.00	14.65	15.39	15.57	16.31	17.50
	8H	15.26	15.96	16.18	16.90	18.09	14.76	15.46	15.68	16.40	17.58
	12H	15.31	15.98	16.24	16.91	18.12	14.80	15.47	15.73	16.40	17.61
4H	2H	12.97	13.77	13.88	14.68	15.86	12.61	13.42	13.52	14.33	15.50
	3H	14.84	15.51	15.76	16.45	17.64	14.43	15.10	15.35	16.04	17.23
	4H	15.55	16.16	16.48	17.10	18.32	15.13	15.74	16.06	16.68	17.89
	6H	16.07	16.59	17.01	17.56	18.77	15.63	16.16	16.58	17.13	18.34
	8H	16.22	16.71	17.16	17.67	18.90	15.78	16.27	16.73	17.23	18.46
	12H	16.29	16.74	17.26	17.71	18.94	15.84	16.29	16.81	17.26	18.50
8H	4H	15.75	16.24	16.70	17.20	18.43	15.37	15.87	16.32	16.82	18.05
	6H	16.38	16.79	17.35	17.79	19.01	15.99	16.40	16.97	17.40	18.63
	8H	16.60	16.96	17.58	17.95	19.19	16.20	16.56	17.19	17.55	18.80
	12H	16.73	17.05	17.72	18.03	19.32	16.32	16.64	17.30	17.62	18.91
12H	4H	15.74	16.18	16.71	17.16	18.39	15.37	15.82	16.34	16.79	18.02
	6H	16.41	16.77	17.39	17.76	19.00	16.03	16.40	17.02	17.38	18.63
	8H	16.65	16.97	17.64	17.95	19.24	16.27	16.59	17.25	17.57	18.86

END OF REPORT