

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917501

Luminaire Tested: DFN2DIP-SQ3F0-100D120US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917501
REPORT IS A COMBINATION OF REPORTS P901537 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D120US930-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17757.2 lumens
Efficiency: N/A
Efficacy: 92.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 192.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917501

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US930-FLLONL

Luminous Intensity Polar Plot

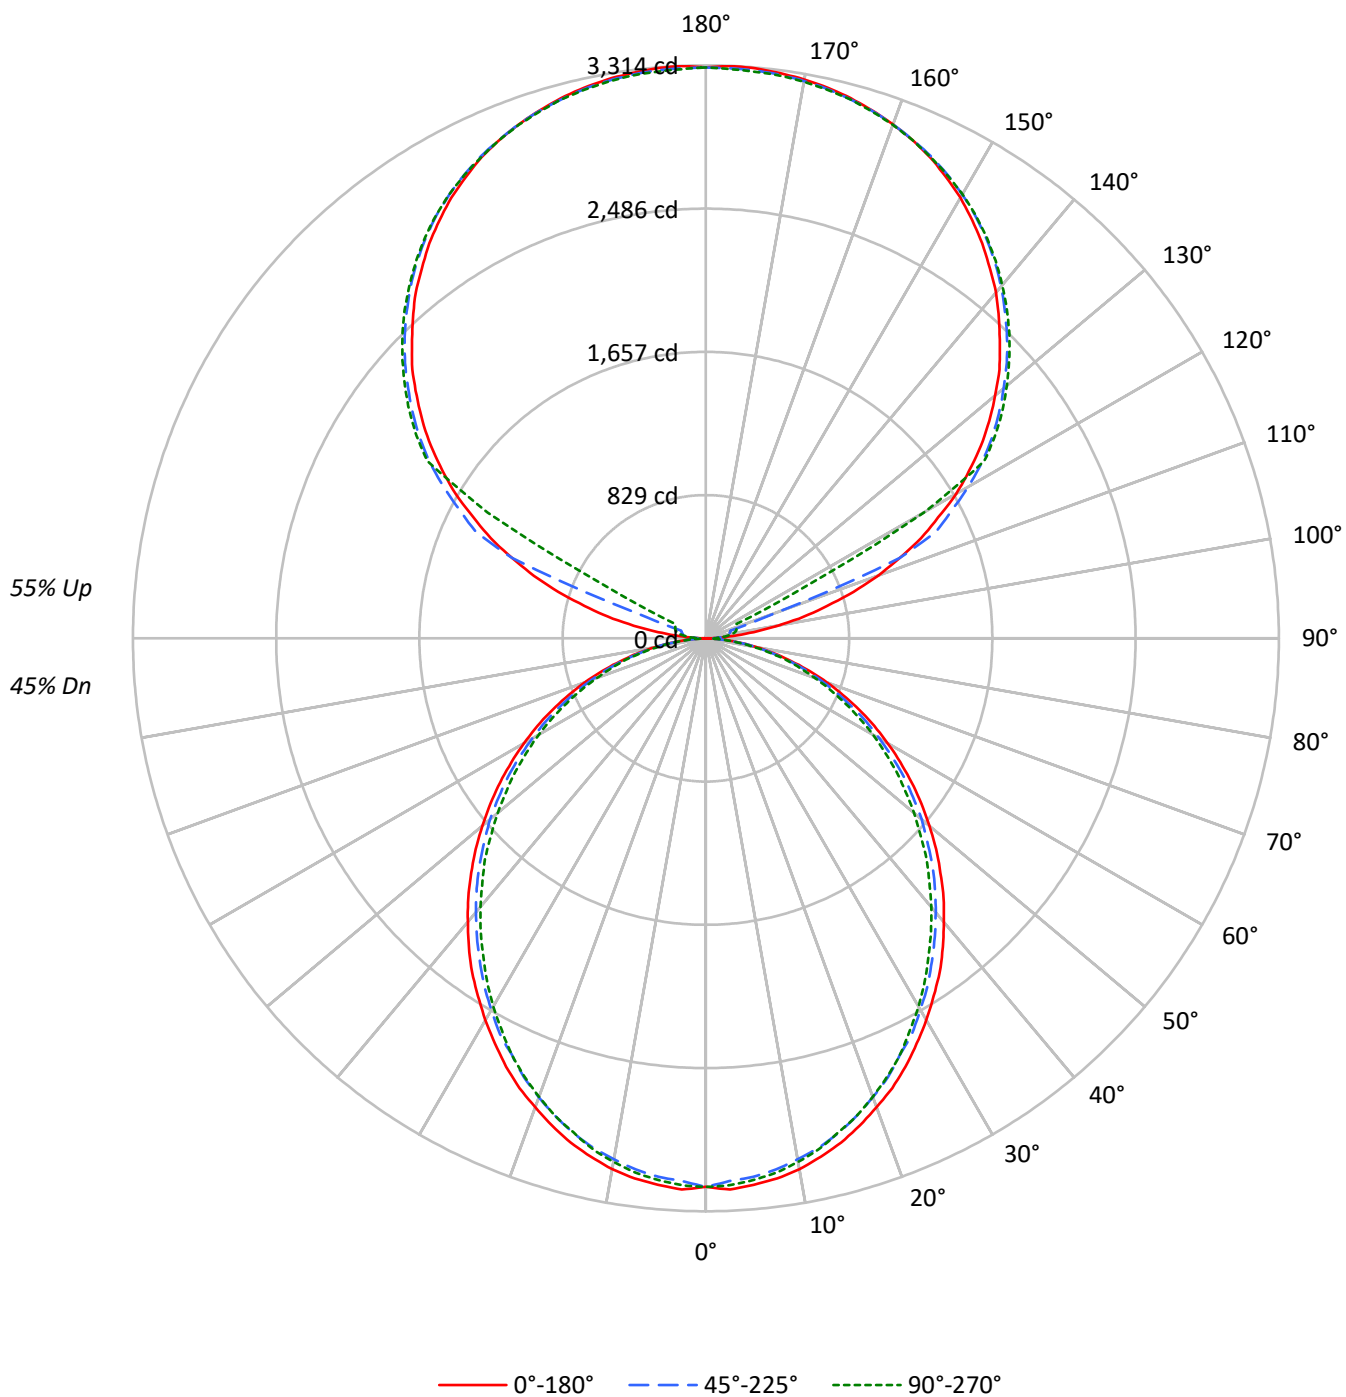

TEST NUMBER: P917501

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3635	3635	3635
5°	3638	3582	3607
10°	3607	3531	3557
15°	3551	3471	3480
20°	3477	3387	3400
25°	3404	3288	3309
30°	3312	3196	3193
35°	3225	3088	3070
40°	3118	2978	2953
45°	3011	2868	2834
50°	2894	2752	2696
55°	2772	2619	2568
60°	2633	2460	2422
65°	2481	2296	2250
70°	2289	2095	2064
75°	2022	1854	1890
80°	1699	1547	1562
85°	1196	1025	1023

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3011 cd/sqm

TEST NUMBER: P917501

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	298.6	1.7
10°-20°	840.1	4.7
20°-30°	1234.6	7.0
30°-40°	1433.9	8.1
40°-50°	1432.1	8.1
50°-60°	1248.8	7.0
60°-70°	923.1	5.2
70°-80°	522.3	2.9
80°-90°	143.7	0.8
90°-100°	108.9	0.6
100°-110°	405.9	2.3
110°-120°	1076.4	6.1
120°-130°	1785.3	10.1
130°-140°	1896.5	10.7
140°-150°	1762.5	9.9
150°-160°	1417.0	8.0
160°-170°	913.1	5.1
170°-180°	314.3	1.8
0°-30°	2373.3	13.4
0°-40°	3807.2	21.4
0°-60°	6488.2	36.5
0°-90°	8077.2	45.5
90°-120°	1591.2	9.0
90°-150°	7035.5	39.6
90°-180°	9680.0	54.5
0°-180°	17757.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3172	3172	3172	3172	3172	
5°	3172	3160	3127	3151	3145	301
15°	3020	3002	2962	2974	2959	851
25°	2733	2709	2657	2663	2657	1258
35°	2358	2328	2279	2260	2245	1473
45°	1919	1898	1852	1818	1806	1481
55°	1452	1434	1397	1361	1345	1298
65°	979	961	930	903	888	968
75°	512	506	491	473	479	547
85°	125	122	119	110	107	139
90°	2	29	48	60	64	16
95°	155	76	93	105	103	184
105°	726	798	146	172	182	776
115°	1374	1414	1474	368	196	1352
125°	1942	1974	2019	2036	2043	1732
135°	2404	2442	2463	2487	2482	1857
145°	2788	2786	2826	2843	2831	1744
155°	3070	3049	3077	3092	3073	1415
165°	3235	3221	3228	3245	3228	914
175°	3309	3292	3297	3314	3290	315
180°	3302	3302	3302	3302	3302	

TEST NUMBER: P917501

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3172.4	3172.4	3172.4	3172.4	3172.4
2.5°	3190.8	3175.6	3141.9	3172.4	3166.5
5°	3172.4	3160.4	3126.8	3151.0	3145.2
7.5°	3151.0	3132.9	3099.2	3123.8	3117.7
10°	3117.7	3096.3	3059.7	3084.0	3075.0
12.5°	3071.7	3053.6	3017.0	3032.3	3026.1
15°	3019.9	3001.8	2962.0	2974.3	2959.1
17.5°	2955.9	2937.8	2897.9	2913.1	2897.9
20°	2885.6	2867.5	2824.8	2833.8	2821.8
22.5°	2815.7	2788.2	2748.4	2748.4	2742.3
25°	2733.2	2708.9	2657.1	2662.9	2657.1
27.5°	2641.6	2620.2	2580.7	2571.7	2556.4
30°	2550.3	2525.7	2480.1	2471.0	2458.7
32.5°	2452.6	2434.5	2385.6	2367.1	2354.8
35°	2358.1	2327.7	2278.8	2260.3	2245.1
37.5°	2251.3	2223.7	2174.9	2153.5	2138.3
40°	2141.5	2116.9	2068.1	2040.9	2028.6
42.5°	2034.7	2010.1	1961.6	1930.9	1912.8
45°	1918.9	1897.5	1851.5	1818.2	1806.0
47.5°	1806.0	1784.6	1735.7	1702.0	1683.9
50°	1686.9	1671.6	1628.9	1586.2	1571.0
52.5°	1571.0	1549.6	1510.1	1476.5	1455.1
55°	1452.2	1433.8	1397.2	1360.6	1345.4
57.5°	1333.1	1317.8	1278.1	1241.5	1229.2
60°	1214.0	1202.0	1159.3	1125.6	1116.6
62.5°	1098.1	1076.8	1046.4	1015.9	1003.6
65°	979.3	960.9	930.5	902.9	887.8
67.5°	857.4	841.8	814.6	793.3	781.0
70°	744.4	732.1	704.6	683.2	671.2
72.5°	628.5	616.2	601.0	579.7	570.5
75°	512.3	506.5	491.0	472.9	479.0
77.5°	408.8	396.5	390.3	381.2	372.2
80°	305.2	302.0	295.8	286.7	280.6
82.5°	207.5	207.5	204.6	192.2	192.2
85°	124.9	122.1	119.1	109.7	106.8
87.5°	55.0	48.8	42.7	33.7	30.4
90°	2.3	28.6	47.7	59.8	64.4
92.5°	59.8	50.2	57.3	62.1	64.4
95°	155.2	76.3	93.0	105.3	102.7
97.5°	279.5	83.7	121.7	129.1	131.3
100°	423.0	95.6	136.2	155.2	160.0
102.5°	580.5	575.9	141.0	167.1	174.5
105°	726.3	798.1	145.9	171.9	181.6
107.5°	895.9	955.5	150.7	176.8	186.4
110°	1058.5	1108.5	418.2	179.3	188.7

TEST NUMBER: P917501

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1211.5	1254.3	1213.7	183.8	191.2
115°	1373.7	1414.3	1474.1	367.9	196.1
117.5°	1514.7	1562.4	1603.3	1261.3	635.5
120°	1672.5	1708.2	1751.3	1780.0	1457.4
122.5°	1806.1	1844.4	1892.4	1906.6	1909.1
125°	1942.3	1973.5	2018.9	2035.6	2042.7
127.5°	2066.5	2100.0	2136.1	2159.9	2162.2
130°	2183.7	2222.0	2248.1	2274.5	2272.2
132.5°	2303.1	2334.4	2360.5	2382.1	2379.8
135°	2403.6	2441.9	2463.2	2487.3	2482.5
137.5°	2508.6	2537.2	2561.3	2585.1	2578.1
140°	2611.3	2630.6	2656.6	2678.3	2666.4
142.5°	2697.5	2714.3	2745.2	2764.2	2752.3
145°	2788.3	2785.8	2826.3	2843.1	2831.1
147.5°	2866.9	2859.8	2900.4	2912.3	2903.0
150°	2943.5	2926.8	2965.1	2979.3	2967.4
152.5°	3007.9	2988.9	3024.7	3039.1	3022.4
155°	3070.0	3048.7	3077.4	3091.6	3072.6
157.5°	3120.2	3101.2	3122.8	3139.6	3120.2
160°	3163.4	3148.9	3163.4	3177.5	3160.8
162.5°	3201.4	3187.2	3199.1	3215.9	3194.3
165°	3234.9	3220.7	3227.8	3244.6	3227.8
167.5°	3261.3	3246.8	3254.2	3270.9	3249.4
170°	3282.8	3268.4	3273.2	3289.9	3268.4
172.5°	3297.0	3282.8	3287.7	3304.4	3282.8
175°	3308.9	3292.2	3297.0	3313.8	3289.9
177.5°	3313.8	3297.0	3299.6	3316.3	3294.8
180°	3301.9	3301.9	3301.9	3301.9	3301.9

TEST NUMBER: P917501

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.29	12.11	12.28	13.12	14.45	10.85	11.67	11.84	12.67	14.01
	3H	12.94	13.68	13.95	14.69	16.05	12.45	13.19	13.46	14.20	15.56
	4H	13.53	14.22	14.54	15.24	16.60	13.03	13.73	14.05	14.75	16.11
	6H	13.92	14.56	14.95	15.59	16.96	13.42	14.06	14.45	15.09	16.46
	8H	14.02	14.63	15.06	15.67	17.04	13.52	14.13	14.55	15.17	16.54
	12H	14.07	14.65	15.11	15.68	17.08	13.56	14.14	14.60	15.17	16.57
4H	2H	11.74	12.44	12.77	13.46	14.82	11.39	12.09	12.41	13.10	14.47
	3H	13.60	14.18	14.63	15.23	16.60	13.19	13.77	14.22	14.82	16.20
	4H	14.31	14.84	15.35	15.88	17.28	13.88	14.42	14.92	15.46	16.86
	6H	14.82	15.28	15.87	16.34	17.73	14.38	14.84	15.43	15.91	17.30
	8H	14.96	15.39	16.01	16.45	17.86	14.53	14.95	15.58	16.01	17.42
	12H	15.03	15.42	16.10	16.49	17.90	14.58	14.97	15.65	16.04	17.45
8H	4H	14.50	14.93	15.55	15.98	17.39	14.12	14.55	15.17	15.60	17.01
	6H	15.12	15.48	16.20	16.57	17.98	14.74	15.09	15.81	16.19	17.59
	8H	15.34	15.65	16.42	16.73	18.16	14.94	15.26	16.03	16.34	17.76
	12H	15.46	15.74	16.55	16.81	18.28	15.05	15.33	16.14	16.40	17.87
12H	4H	14.48	14.87	15.55	15.94	17.35	14.11	14.50	15.18	15.57	16.98
	6H	15.15	15.46	16.23	16.54	17.97	14.78	15.09	15.86	16.17	17.59
	8H	15.38	15.66	16.47	16.73	18.20	15.00	15.28	16.09	16.35	17.82