

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917551

Luminaire Tested: DFN2DIP-SQ3F0-120D060US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917551
REPORT IS A COMBINATION OF REPORTS P901434 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D060US930-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13158.9 lumens
Efficiency: N/A
Efficacy: 77.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917551

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US930-RLLONL

Luminous Intensity Polar Plot

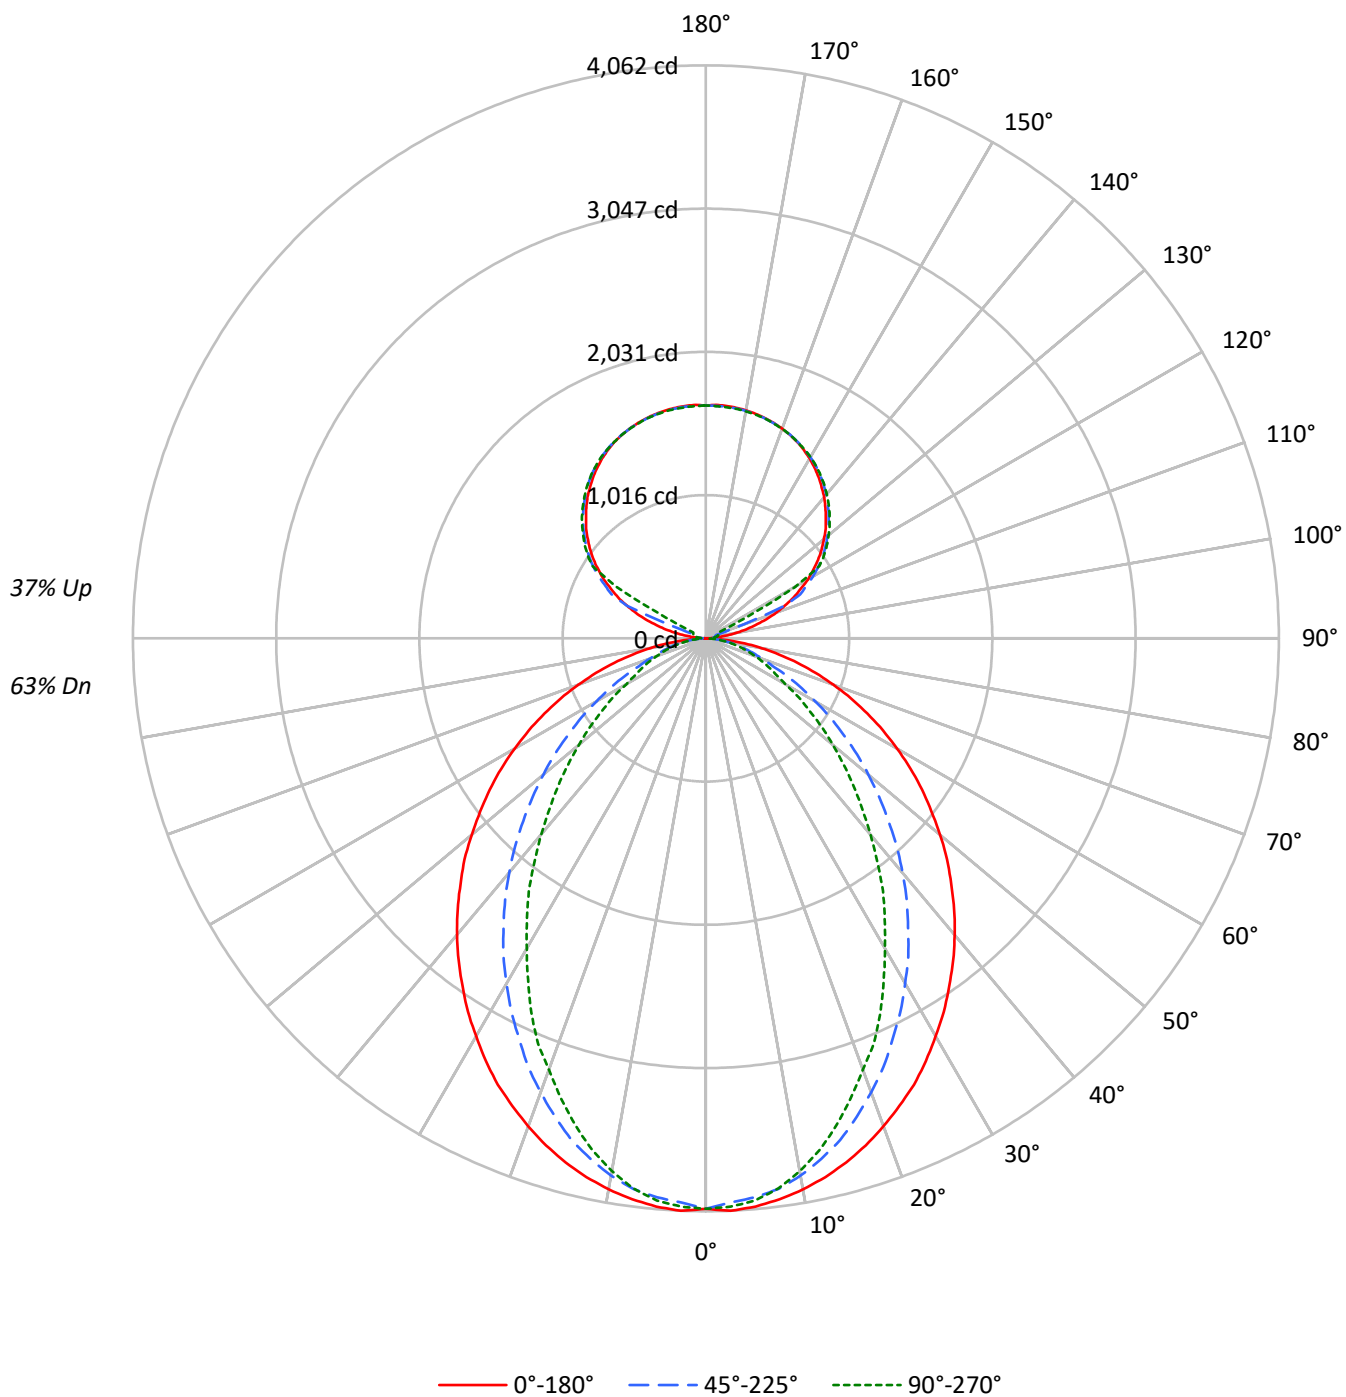

TEST NUMBER: P917551

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4633	4633	4633
5°	4638	4556	4587
10°	4589	4464	4437
15°	4523	4314	4204
20°	4436	4107	3920
25°	4347	3877	3645
30°	4230	3640	3298
35°	4114	3387	2992
40°	3996	3125	2642
45°	3859	2834	2325
50°	3717	2541	2016
55°	3569	2229	1718
60°	3397	1902	1413
65°	3199	1571	1270
70°	2959	1262	1147
75°	2657	1106	1040
80°	2221	918	897
85°	1506	598	666

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3859 cd/sqm

TEST NUMBER: P917551

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	379.0	2.9
10°-20°	1040.3	7.9
20°-30°	1460.6	11.1
30°-40°	1592.1	12.1
40°-50°	1463.4	11.1
50°-60°	1149.2	8.7
60°-70°	748.0	5.7
70°-80°	385.1	2.9
80°-90°	101.2	0.8
90°-100°	54.4	0.4
100°-110°	202.9	1.5
110°-120°	538.2	4.1
120°-130°	892.7	6.8
130°-140°	948.2	7.2
140°-150°	881.3	6.7
150°-160°	708.5	5.4
160°-170°	456.5	3.5
170°-180°	157.1	1.2
0°-30°	2879.9	21.9
0°-40°	4472.0	34.0
0°-60°	7084.6	53.8
0°-90°	8318.9	63.2
90°-120°	795.6	6.0
90°-150°	3517.8	26.7
90°-180°	4840.0	36.8
0°-180°	13158.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4044	4044	4044	4044	4044	
5°	4044	4025	3978	4010	4000	383
15°	3846	3806	3681	3612	3575	1084
25°	3491	3374	3132	2982	2927	1606
35°	3008	2821	2500	2269	2188	1883
45°	2459	2214	1830	1570	1482	1899
55°	1870	1584	1189	970	900	1671
65°	1263	966	637	512	501	1252
75°	673	417	293	267	264	712
85°	157	80	70	70	70	181
90°	1	14	24	30	32	12
95°	78	38	47	53	51	92
105°	363	399	73	86	91	388
115°	687	707	737	184	98	676
125°	971	987	1009	1018	1021	866
135°	1202	1221	1232	1244	1241	928
145°	1394	1393	1413	1422	1416	872
155°	1535	1524	1539	1546	1536	707
165°	1618	1610	1614	1622	1614	457
175°	1654	1646	1648	1657	1645	157
180°	1651	1651	1651	1651	1651	

TEST NUMBER: P917551

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4043.6	4043.6	4043.6	4043.6	4043.6
2.5°	4061.8	4043.6	4003.2	4040.0	4032.6
5°	4043.6	4025.3	3977.5	4010.5	3999.7
7.5°	4010.5	3988.8	3937.6	3951.9	3933.7
10°	3966.7	3941.1	3868.0	3856.8	3835.1
12.5°	3911.9	3878.9	3779.9	3758.2	3717.8
15°	3845.9	3805.6	3681.3	3611.8	3575.3
17.5°	3769.0	3710.4	3556.7	3476.4	3417.7
20°	3681.3	3607.9	3425.1	3333.8	3253.0
22.5°	3586.2	3502.0	3289.6	3165.3	3110.6
25°	3491.1	3373.8	3132.3	2982.4	2927.3
27.5°	3377.7	3253.0	2985.9	2814.0	2729.7
30°	3257.0	3117.6	2824.8	2638.5	2539.5
32.5°	3139.7	2971.2	2671.5	2451.8	2360.1
35°	3008.1	2821.3	2499.5	2268.9	2188.1
37.5°	2880.0	2678.5	2338.4	2085.6	1994.4
40°	2744.5	2525.1	2169.9	1910.2	1815.0
42.5°	2605.4	2371.4	2001.8	1730.8	1639.6
45°	2459.1	2213.8	1829.8	1569.7	1481.9
47.5°	2320.1	2060.4	1665.2	1405.1	1324.7
50°	2166.4	1906.7	1504.1	1251.3	1174.8
52.5°	2016.2	1741.6	1350.3	1108.8	1039.3
55°	1869.8	1584.5	1189.2	969.8	900.3
57.5°	1719.9	1427.2	1046.7	841.7	783.1
60°	1566.2	1273.4	896.4	710.1	651.5
62.5°	1416.3	1123.6	768.3	592.9	563.7
65°	1262.6	966.0	636.7	512.5	501.2
67.5°	1116.2	819.5	512.5	450.0	439.1
70°	962.5	677.1	424.4	387.8	373.1
72.5°	816.1	545.1	354.8	325.7	318.4
75°	673.2	416.9	292.8	267.1	263.6
77.5°	530.8	296.2	230.6	215.9	208.5
80°	398.8	212.4	175.5	161.1	161.1
82.5°	278.0	142.8	120.7	113.3	113.3
85°	157.3	80.4	69.5	69.5	69.5
87.5°	58.6	29.1	29.1	25.6	25.6
90°	1.1	14.3	23.8	29.9	32.2
92.5°	29.9	25.1	28.6	31.1	32.2
95°	77.6	38.2	46.6	52.7	51.4
97.5°	139.7	41.8	60.8	64.6	65.7
100°	211.5	47.8	68.1	77.6	80.0
102.5°	290.2	288.0	70.5	83.6	87.2
105°	363.1	399.0	72.9	85.9	90.8
107.5°	448.0	477.8	75.3	88.4	93.2
110°	529.3	554.2	209.1	89.7	94.3

TEST NUMBER: P917551

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	605.7	627.1	606.8	91.9	95.6
115°	686.9	707.2	737.1	184.0	98.0
117.5°	757.3	781.2	801.6	630.7	317.7
120°	836.3	854.1	875.7	890.0	728.7
122.5°	903.0	922.2	946.2	953.2	954.6
125°	971.2	986.8	1009.4	1017.8	1021.3
127.5°	1033.3	1050.0	1068.0	1079.9	1081.1
130°	1091.8	1111.0	1124.1	1137.3	1136.1
132.5°	1151.6	1167.2	1180.2	1191.0	1189.8
135°	1201.8	1221.0	1231.6	1243.7	1241.2
137.5°	1254.3	1268.6	1280.7	1292.6	1289.1
140°	1305.6	1315.3	1328.4	1339.1	1333.2
142.5°	1348.7	1357.1	1372.6	1382.1	1376.1
145°	1394.2	1392.9	1413.2	1421.6	1415.6
147.5°	1433.5	1429.9	1450.2	1456.1	1451.5
150°	1471.8	1463.4	1482.5	1489.6	1483.7
152.5°	1504.0	1494.4	1512.3	1519.6	1511.2
155°	1535.0	1524.4	1538.7	1545.8	1536.3
157.5°	1560.2	1550.6	1561.4	1569.8	1560.2
160°	1581.7	1574.4	1581.7	1588.8	1580.5
162.5°	1600.7	1593.6	1599.5	1607.9	1597.2
165°	1617.5	1610.4	1613.9	1622.3	1613.9
167.5°	1630.6	1623.4	1627.1	1635.5	1624.6
170°	1641.4	1634.2	1636.6	1644.9	1634.2
172.5°	1648.5	1641.4	1643.8	1652.2	1641.4
175°	1654.5	1646.1	1648.5	1656.8	1644.9
177.5°	1656.8	1648.5	1649.8	1658.2	1647.4
180°	1650.9	1650.9	1650.9	1650.9	1650.9

TEST NUMBER: P917551

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.59	14.54	14.43	15.40	16.47	9.55	10.50	10.40	11.36	12.43
	3H	15.27	16.13	16.13	16.99	18.09	10.74	11.60	11.60	12.46	13.56
	4H	15.89	16.69	16.76	17.56	18.67	11.20	12.00	12.07	12.87	13.98
	6H	16.31	17.05	17.19	17.93	19.05	11.52	12.26	12.40	13.14	14.26
	8H	16.44	17.14	17.33	18.04	19.16	11.61	12.31	12.50	13.21	14.33
	12H	16.50	17.17	17.40	18.06	19.21	11.65	12.32	12.55	13.21	14.36
4H	2H	13.62	14.43	14.50	15.30	16.41	10.16	10.96	11.04	11.84	12.95
	3H	15.46	16.12	16.35	17.03	18.16	11.51	12.18	12.40	13.09	14.21
	4H	16.15	16.76	17.05	17.66	18.81	12.06	12.67	12.96	13.57	14.72
	6H	16.67	17.19	17.58	18.12	19.27	12.48	13.00	13.39	13.93	15.08
	8H	16.84	17.33	17.76	18.25	19.42	12.61	13.10	13.52	14.02	15.18
	12H	16.94	17.38	17.88	18.32	19.49	12.67	13.11	13.61	14.05	15.23
8H	4H	16.13	16.61	17.04	17.54	18.70	12.35	12.84	13.26	13.76	14.92
	6H	16.69	17.09	17.63	18.06	19.22	12.86	13.27	13.80	14.23	15.39
	8H	16.91	17.26	17.86	18.22	19.40	13.05	13.41	14.00	14.36	15.54
	12H	17.05	17.36	18.00	18.31	19.54	13.17	13.48	14.12	14.43	15.66
12H	4H	16.08	16.52	17.02	17.46	18.63	12.36	12.80	13.29	13.74	14.91
	6H	16.67	17.02	17.62	17.98	19.16	12.91	13.27	13.86	14.22	15.41
	8H	16.89	17.20	17.84	18.15	19.38	13.12	13.43	14.07	14.38	15.62

END OF REPORT