

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917556

Luminaire Tested: DFN2DIP-SQ3F0-120D080US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917556
REPORT IS A COMBINATION OF REPORTS P899949 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D080US930-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15458.1 lumens
Efficiency: N/A
Efficacy: 83.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 186.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917556

CATALOG NUMBER: DFN2DIP-SQ3F0-120D080US930-FLLFLL

Luminous Intensity Polar Plot

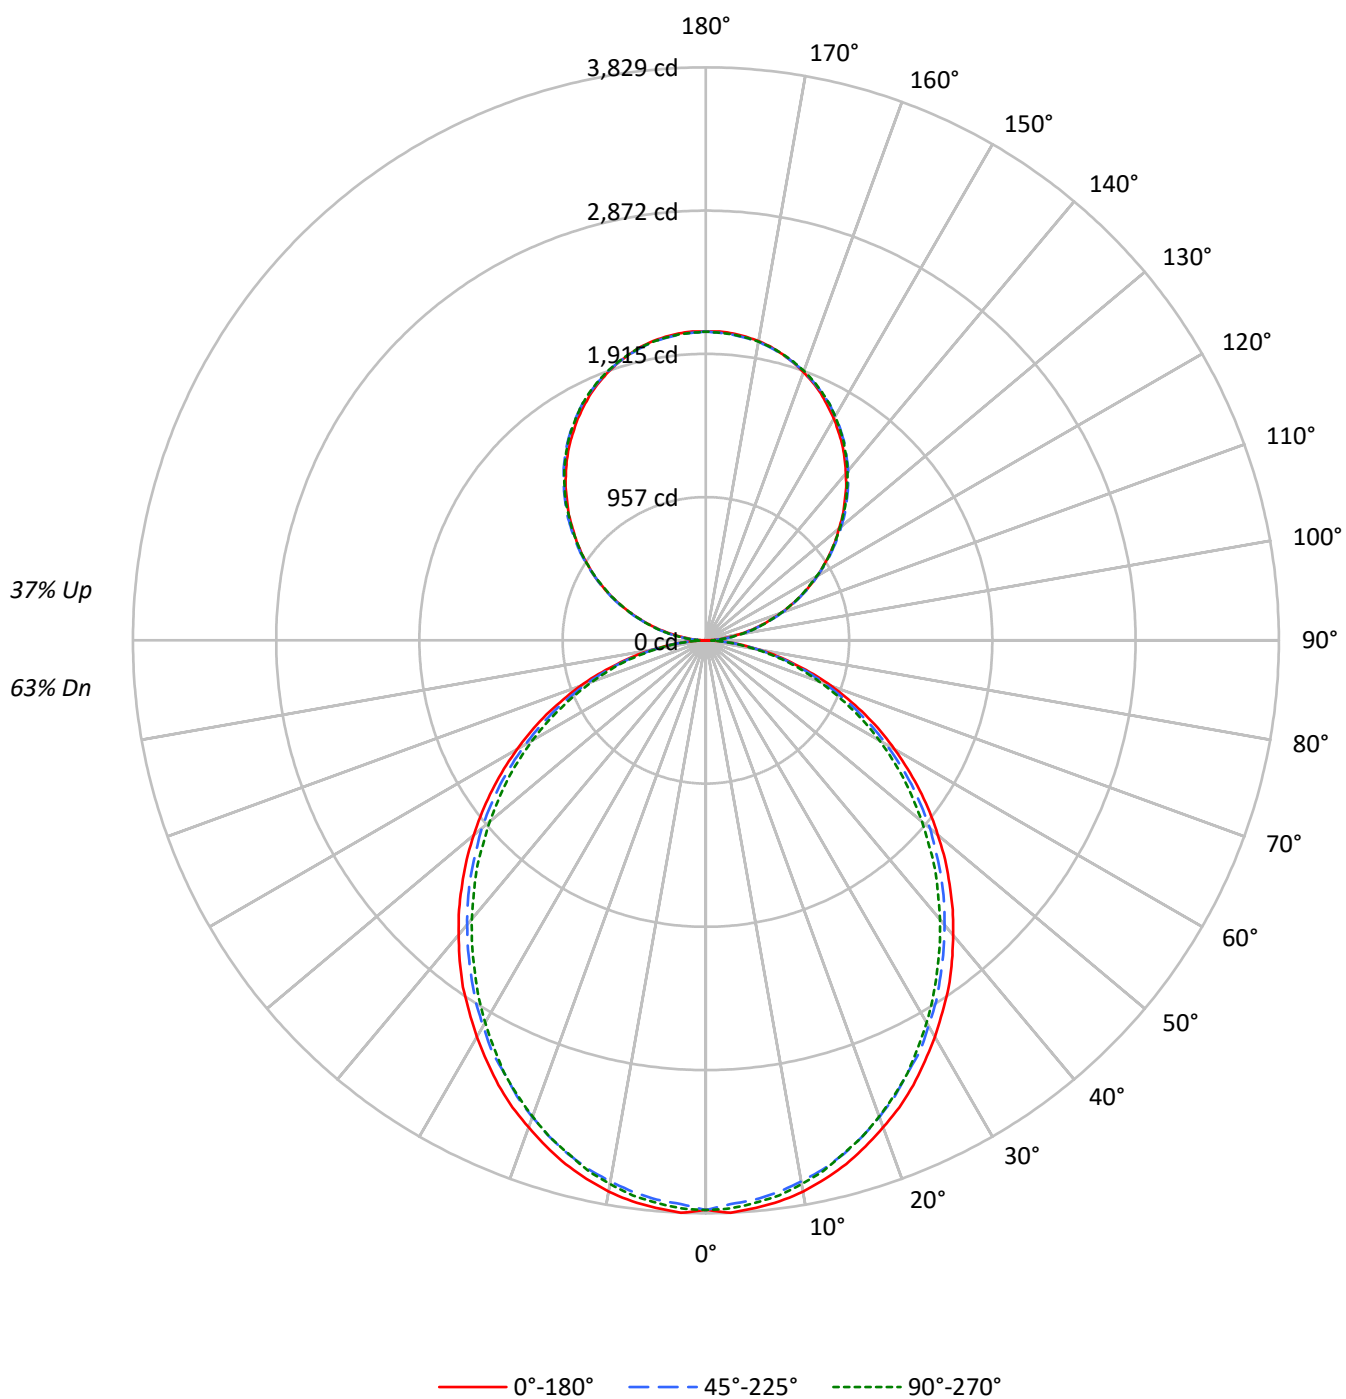

TEST NUMBER: P917556

CATALOG NUMBER: DFN2DIP-SQ3F0-120D080US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4362	4362	4362
5°	4366	4298	4329
10°	4328	4237	4269
15°	4261	4165	4176
20°	4173	4065	4081
25°	4084	3946	3971
30°	3974	3835	3832
35°	3870	3705	3684
40°	3741	3574	3544
45°	3613	3442	3401
50°	3473	3303	3235
55°	3326	3142	3082
60°	3160	2952	2906
65°	2978	2755	2700
70°	2746	2514	2477
75°	2426	2225	2268
80°	2039	1857	1875
85°	1435	1230	1228

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3613 cd/sqm

TEST NUMBER: P917556

CATALOG NUMBER: DFN2DIP-SQ3F0-120D080US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	358.3	2.3
10°-20°	1008.1	6.5
20°-30°	1481.5	9.6
30°-40°	1720.7	11.1
40°-50°	1718.6	11.1
50°-60°	1498.5	9.7
60°-70°	1107.8	7.2
70°-80°	626.7	4.1
80°-90°	171.3	1.1
90°-100°	127.6	0.8
100°-110°	405.6	2.6
110°-120°	694.1	4.5
120°-130°	912.8	5.9
130°-140°	1024.6	6.6
140°-150°	1004.7	6.5
150°-160°	842.8	5.5
160°-170°	558.9	3.6
170°-180°	195.4	1.3
0°-30°	2848.0	18.4
0°-40°	4568.7	29.6
0°-60°	7785.8	50.4
0°-90°	9691.6	62.7
90°-120°	1227.3	7.9
90°-150°	4169.4	27.0
90°-180°	5766.0	37.3
0°-180°	15458.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3807	3807	3807	3807	3807	
5°	3807	3792	3752	3781	3774	361
15°	3624	3602	3554	3569	3551	1021
25°	3280	3251	3188	3196	3188	1509
35°	2830	2793	2734	2712	2694	1767
45°	2303	2277	2222	2182	2167	1777
55°	1743	1720	1677	1633	1614	1558
65°	1175	1153	1117	1084	1065	1162
75°	615	608	589	567	575	656
85°	150	146	143	132	128	167
90°	2	22	61	57	59	15
95°	91	108	111	111	108	101
105°	374	379	383	386	386	395
115°	696	706	703	702	696	689
125°	1013	1029	1024	1018	1016	905
135°	1310	1330	1333	1332	1326	1013
145°	1591	1603	1613	1615	1608	994
155°	1819	1824	1830	1838	1833	837
165°	1979	1977	1977	1989	1981	558
175°	2059	2054	2050	2063	2052	196
180°	2063	2063	2063	2063	2063	

TEST NUMBER: P917556

CATALOG NUMBER: DFN2DIP-SQ3F0-120D080US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3806.9	3806.9	3806.9	3806.9	3806.9
2.5°	3829.0	3810.7	3770.3	3806.9	3799.9
5°	3806.9	3792.4	3752.1	3781.2	3774.2
7.5°	3781.2	3759.4	3719.1	3748.6	3741.2
10°	3741.2	3715.6	3671.7	3700.8	3690.0
12.5°	3686.0	3664.3	3620.4	3638.7	3631.3
15°	3623.9	3602.2	3554.4	3569.1	3550.9
17.5°	3547.0	3525.3	3477.5	3495.8	3477.5
20°	3462.7	3441.0	3389.8	3400.6	3386.3
22.5°	3378.8	3345.8	3298.0	3298.0	3290.7
25°	3279.8	3250.7	3188.5	3195.6	3188.5
27.5°	3169.9	3144.3	3096.9	3086.0	3067.8
30°	3060.4	3030.9	2976.1	2965.2	2950.5
32.5°	2943.1	2921.4	2862.7	2840.6	2825.8
35°	2829.7	2793.2	2734.5	2712.4	2694.2
37.5°	2701.5	2668.6	2609.9	2584.3	2566.0
40°	2569.9	2540.4	2481.7	2449.1	2434.3
42.5°	2441.7	2412.2	2353.9	2317.1	2295.3
45°	2302.6	2277.0	2221.9	2181.9	2167.1
47.5°	2167.1	2141.5	2082.8	2042.5	2020.7
50°	2024.2	2006.0	1954.7	1903.4	1885.1
52.5°	1885.1	1859.5	1812.2	1771.7	1746.1
55°	1742.6	1720.5	1676.6	1632.7	1614.5
57.5°	1599.7	1581.4	1533.7	1489.8	1475.0
60°	1456.8	1442.4	1391.1	1350.8	1339.9
62.5°	1317.8	1292.1	1255.6	1219.1	1204.4
65°	1175.3	1153.1	1116.6	1083.5	1065.4
67.5°	1028.8	1010.2	977.5	951.9	937.2
70°	893.2	878.5	845.5	819.9	805.5
72.5°	754.2	739.5	721.2	695.6	684.7
75°	614.8	607.8	589.1	567.4	574.8
77.5°	490.5	475.7	468.4	457.5	446.6
80°	366.2	362.3	355.0	344.1	336.7
82.5°	248.9	248.9	245.5	230.7	230.7
85°	149.9	146.4	142.9	131.7	128.2
87.5°	66.0	58.6	51.3	40.4	36.5
90°	1.9	22.4	61.0	57.2	59.1
92.5°	38.6	52.3	54.1	55.9	55.9
95°	90.8	108.2	111.3	111.3	108.2
97.5°	151.2	167.3	174.1	174.1	174.1
100°	220.8	235.1	240.0	240.0	238.1
102.5°	294.2	304.8	311.5	313.4	311.5
105°	374.4	379.4	383.1	386.2	386.2
107.5°	454.0	461.5	461.5	462.7	454.0
110°	531.1	541.0	541.0	541.0	536.1

TEST NUMBER: P917556

CATALOG NUMBER: DFN2DIP-SQ3F0-120D080US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	614.4	625.0	623.1	618.2	614.4
115°	696.5	706.5	703.4	701.5	696.5
117.5°	778.0	791.7	782.9	778.0	773.0
120°	860.1	873.8	860.1	860.1	854.4
122.5°	934.7	952.1	943.4	938.4	934.7
125°	1013.0	1028.6	1023.6	1018.0	1016.2
127.5°	1089.6	1108.8	1102.0	1094.5	1089.6
130°	1161.1	1183.4	1180.3	1176.6	1169.8
132.5°	1241.3	1258.7	1260.0	1251.2	1246.3
135°	1310.3	1329.6	1333.3	1331.5	1326.5
137.5°	1387.4	1403.0	1406.1	1404.8	1397.3
140°	1455.2	1470.7	1479.4	1479.4	1472.6
142.5°	1524.9	1540.4	1545.4	1547.3	1540.4
145°	1590.8	1603.2	1613.1	1615.0	1608.2
147.5°	1649.8	1665.4	1672.8	1676.0	1669.2
150°	1710.8	1721.3	1728.2	1733.8	1728.2
152.5°	1764.9	1775.5	1784.2	1791.0	1784.2
155°	1819.0	1824.0	1829.6	1838.3	1832.7
157.5°	1865.6	1869.4	1872.5	1884.9	1876.2
160°	1907.3	1911.1	1912.9	1923.5	1916.0
162.5°	1945.9	1945.9	1947.7	1959.6	1950.8
165°	1978.8	1976.9	1976.9	1989.4	1980.7
167.5°	2008.7	2003.1	2003.1	2015.5	2006.8
170°	2031.1	2026.1	2024.2	2036.7	2026.1
172.5°	2046.6	2041.7	2039.8	2052.2	2041.7
175°	2059.0	2054.1	2050.3	2062.8	2052.2
177.5°	2065.9	2060.9	2057.2	2067.8	2057.2
180°	2062.8	2062.8	2062.8	2062.8	2062.8

TEST NUMBER: P917556

CATALOG NUMBER: DFN2DIP-SQ3F0-120D080US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.45	14.44	14.29	15.30	16.38	13.01	13.99	13.85	14.86	15.93
	3H	15.11	16.00	15.97	16.87	17.98	14.62	15.51	15.48	16.38	17.49
	4H	15.71	16.54	16.57	17.42	18.54	15.21	16.05	16.08	16.93	18.04
	6H	16.11	16.88	16.99	17.77	18.90	15.61	16.38	16.49	17.27	18.40
	8H	16.21	16.95	17.10	17.85	18.98	15.71	16.45	16.60	17.35	18.48
	12H	16.27	16.97	17.16	17.86	19.02	15.76	16.46	16.65	17.36	18.51
4H	2H	13.92	14.76	14.80	15.64	16.75	13.57	14.41	14.44	15.28	16.40
	3H	15.79	16.49	16.68	17.40	18.53	15.39	16.09	16.27	17.00	18.13
	4H	16.51	17.15	17.41	18.05	19.21	16.09	16.72	16.98	17.63	18.79
	6H	17.03	17.58	17.94	18.51	19.67	16.60	17.15	17.51	18.08	19.24
	8H	17.18	17.69	18.09	18.62	19.79	16.74	17.26	17.65	18.18	19.35
	12H	17.25	17.72	18.19	18.66	19.84	16.81	17.27	17.74	18.21	19.39
8H	4H	16.71	17.23	17.63	18.15	19.32	16.34	16.85	17.25	17.78	18.95
	6H	17.34	17.77	18.28	18.74	19.91	16.96	17.39	17.90	18.35	19.52
	8H	17.56	17.94	18.51	18.90	20.09	17.17	17.55	18.12	18.50	19.69
	12H	17.70	18.03	18.65	18.98	20.22	17.28	17.62	18.24	18.57	19.81
12H	4H	16.70	17.17	17.64	18.11	19.29	16.33	16.80	17.27	17.74	18.92
	6H	17.37	17.75	18.32	18.71	19.90	17.00	17.38	17.95	18.34	19.52
	8H	17.62	17.95	18.57	18.90	20.14	17.24	17.57	18.19	18.52	19.76

END OF REPORT