

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917568

Luminaire Tested: DFN2DIP-SQ3F0-120D110US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917568
REPORT IS A COMBINATION OF REPORTS P900003 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D110US930-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17622.7 lumens
Efficiency: N/A
Efficacy: 83.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 211.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917568

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US930-FLLFLL

Luminous Intensity Polar Plot

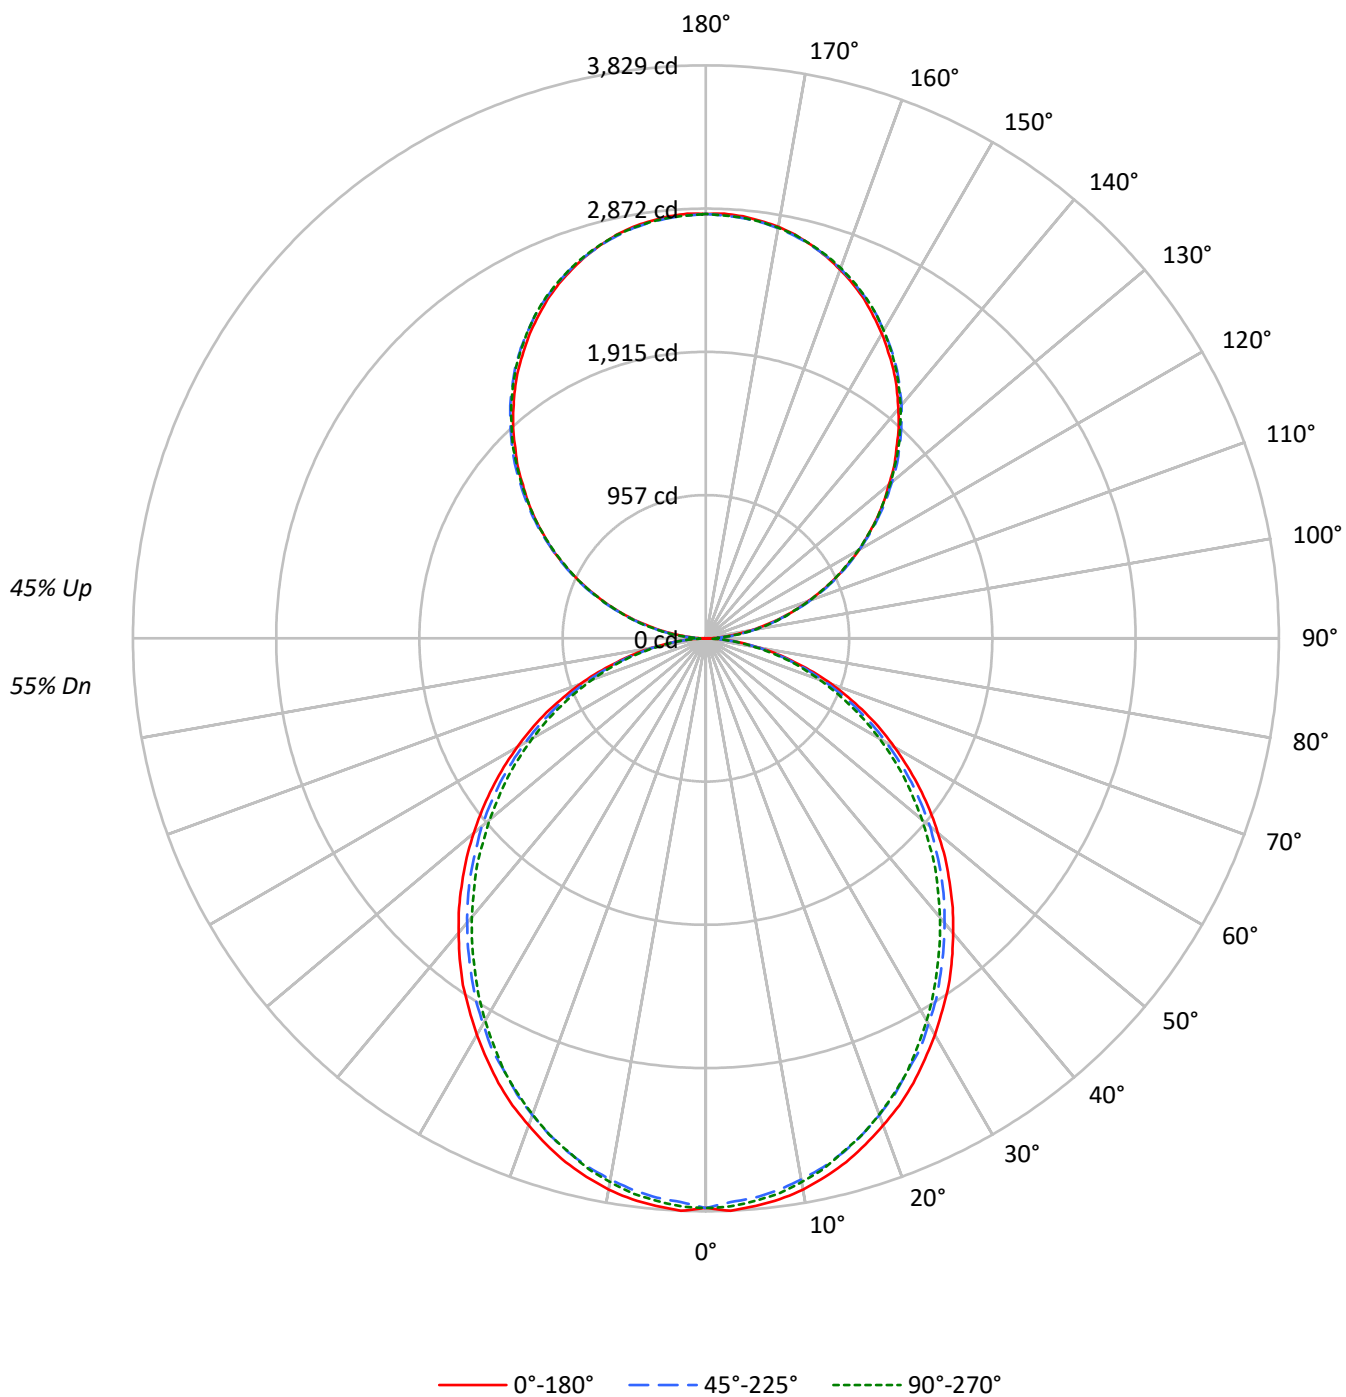

TEST NUMBER: P917568

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	91	87	92	88	85	81	76	73	71	64	62	61	54	52	51
2	90	83	76	71	83	77	71	67	66	62	59	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	70	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	54	46	41	46	41	36	40	35	32	34	30	28
6	64	51	43	37	59	48	41	35	42	36	32	36	32	28	31	27	24
7	59	46	38	33	55	44	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	18
10	48	35	28	23	44	33	27	22	29	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4362	4362	4362
5°	4366	4298	4329
10°	4328	4237	4269
15°	4261	4165	4176
20°	4173	4065	4081
25°	4084	3946	3971
30°	3974	3835	3832
35°	3870	3705	3684
40°	3741	3574	3544
45°	3613	3442	3401
50°	3473	3303	3235
55°	3326	3142	3082
60°	3160	2952	2906
65°	2978	2755	2700
70°	2746	2514	2477
75°	2426	2225	2268
80°	2039	1857	1875
85°	1435	1230	1228

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3613 cd/sqm

TEST NUMBER: P917568

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	358.3	2.0
10°-20°	1008.1	5.7
20°-30°	1481.5	8.4
30°-40°	1720.7	9.8
40°-50°	1718.6	9.8
50°-60°	1498.5	8.5
60°-70°	1107.8	6.3
70°-80°	626.7	3.6
80°-90°	173.5	1.0
90°-100°	175.5	1.0
100°-110°	557.7	3.2
110°-120°	954.3	5.4
120°-130°	1255.1	7.1
130°-140°	1408.8	8.0
140°-150°	1381.5	7.8
150°-160°	1158.9	6.6
160°-170°	768.5	4.4
170°-180°	268.6	1.5
0°-30°	2848.0	16.2
0°-40°	4568.7	25.9
0°-60°	7785.8	44.2
0°-90°	9693.8	55.0
90°-120°	1687.5	9.6
90°-150°	5732.8	32.5
90°-180°	7929.0	45.0
0°-180°	17622.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3807	3807	3807	3807	3807	
5°	3807	3792	3752	3781	3774	361
15°	3624	3602	3554	3569	3551	1021
25°	3280	3251	3188	3196	3188	1509
35°	2830	2793	2734	2712	2694	1767
45°	2303	2277	2222	2182	2167	1777
55°	1743	1720	1677	1633	1614	1558
65°	1175	1153	1117	1084	1065	1162
75°	615	608	589	567	575	656
85°	150	146	143	132	128	167
90°	2	31	84	79	81	17
95°	125	149	153	153	149	139
105°	515	522	527	531	531	543
115°	958	971	967	965	958	947
125°	1393	1414	1407	1400	1397	1245
135°	1802	1828	1833	1831	1824	1393
145°	2187	2204	2218	2221	2211	1367
155°	2501	2508	2516	2528	2520	1151
165°	2721	2718	2718	2735	2723	768
175°	2831	2824	2819	2836	2822	269
180°	2836	2836	2836	2836	2836	

TEST NUMBER: P917568

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3806.9	3806.9	3806.9	3806.9	3806.9
2.5°	3829.0	3810.7	3770.3	3806.9	3799.9
5°	3806.9	3792.4	3752.1	3781.2	3774.2
7.5°	3781.2	3759.4	3719.1	3748.6	3741.2
10°	3741.2	3715.6	3671.7	3700.8	3690.0
12.5°	3686.0	3664.3	3620.4	3638.7	3631.3
15°	3623.9	3602.2	3554.4	3569.1	3550.9
17.5°	3547.0	3525.3	3477.5	3495.8	3477.5
20°	3462.7	3441.0	3389.8	3400.6	3386.3
22.5°	3378.8	3345.8	3298.0	3298.0	3290.7
25°	3279.8	3250.7	3188.5	3195.6	3188.5
27.5°	3169.9	3144.3	3096.9	3086.0	3067.8
30°	3060.4	3030.9	2976.1	2965.2	2950.5
32.5°	2943.1	2921.4	2862.7	2840.6	2825.8
35°	2829.7	2793.2	2734.5	2712.4	2694.2
37.5°	2701.5	2668.6	2609.9	2584.3	2566.0
40°	2569.9	2540.4	2481.7	2449.1	2434.3
42.5°	2441.7	2412.2	2353.9	2317.1	2295.3
45°	2302.6	2277.0	2221.9	2181.9	2167.1
47.5°	2167.1	2141.5	2082.8	2042.5	2020.7
50°	2024.2	2006.0	1954.7	1903.4	1885.1
52.5°	1885.1	1859.5	1812.2	1771.7	1746.1
55°	1742.6	1720.5	1676.6	1632.7	1614.5
57.5°	1599.7	1581.4	1533.7	1489.8	1475.0
60°	1456.8	1442.4	1391.1	1350.8	1339.9
62.5°	1317.8	1292.1	1255.6	1219.1	1204.4
65°	1175.3	1153.1	1116.6	1083.5	1065.4
67.5°	1028.8	1010.2	977.5	951.9	937.2
70°	893.2	878.5	845.5	819.9	805.5
72.5°	754.2	739.5	721.2	695.6	684.7
75°	614.8	607.8	589.1	567.4	574.8
77.5°	490.5	475.7	468.4	457.5	446.6
80°	366.2	362.3	355.0	344.1	336.7
82.5°	248.9	248.9	245.5	230.7	230.7
85°	149.9	146.4	142.9	131.7	128.2
87.5°	66.0	58.6	51.3	40.4	36.5
90°	2.5	30.8	83.8	78.7	81.2
92.5°	53.0	71.8	74.4	77.0	77.0
95°	124.8	148.8	153.0	153.0	148.8
97.5°	207.8	230.0	239.5	239.5	239.5
100°	303.5	323.2	330.0	330.0	327.5
102.5°	404.5	419.0	428.4	431.0	428.4
105°	514.8	521.6	526.8	531.0	531.0
107.5°	624.2	634.5	634.5	636.2	624.2
110°	730.3	744.0	744.0	744.0	737.1

TEST NUMBER: P917568

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	844.8	859.3	856.8	849.9	844.8
115°	957.7	971.3	967.1	964.6	957.7
117.5°	1069.8	1088.5	1076.5	1069.8	1062.9
120°	1182.6	1201.4	1182.6	1182.6	1174.9
122.5°	1285.2	1309.1	1297.1	1290.3	1285.2
125°	1392.9	1414.3	1407.4	1399.8	1397.2
127.5°	1498.1	1524.6	1515.2	1505.0	1498.1
130°	1596.4	1627.3	1622.9	1617.8	1608.4
132.5°	1706.7	1730.7	1732.4	1720.4	1713.6
135°	1801.6	1828.1	1833.3	1830.8	1823.9
137.5°	1907.7	1929.1	1933.3	1931.6	1921.4
140°	2000.9	2022.3	2034.3	2034.3	2024.9
142.5°	2096.7	2118.1	2124.9	2127.4	2118.1
145°	2187.3	2204.4	2218.1	2220.6	2211.3
147.5°	2268.6	2289.9	2300.2	2304.4	2295.1
150°	2352.4	2366.9	2376.3	2384.0	2376.3
152.5°	2426.7	2441.2	2453.2	2462.7	2453.2
155°	2501.2	2507.9	2515.7	2527.7	2519.9
157.5°	2565.3	2570.4	2574.6	2591.8	2579.8
160°	2622.6	2627.7	2630.2	2644.8	2634.6
162.5°	2675.6	2675.6	2678.2	2694.4	2682.4
165°	2720.9	2718.3	2718.3	2735.4	2723.4
167.5°	2761.9	2754.2	2754.2	2771.4	2759.4
170°	2792.7	2785.9	2783.3	2800.4	2785.9
172.5°	2814.1	2807.2	2804.7	2821.8	2807.2
175°	2831.2	2824.4	2819.2	2836.3	2821.8
177.5°	2840.6	2833.7	2828.6	2843.2	2828.6
180°	2836.3	2836.3	2836.3	2836.3	2836.3

TEST NUMBER: P917568

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.80	13.71	13.72	14.64	15.84	12.36	13.27	13.27	14.20	15.40
	3H	14.46	15.28	15.39	16.22	17.44	13.97	14.79	14.90	15.73	16.95
	4H	15.05	15.82	15.99	16.77	18.00	14.56	15.33	15.50	16.27	17.50
	6H	15.45	16.16	16.40	17.11	18.36	14.95	15.66	15.90	16.61	17.86
	8H	15.55	16.23	16.51	17.20	18.44	15.05	15.73	16.01	16.70	17.94
	12H	15.60	16.25	16.57	17.21	18.48	15.09	15.74	16.06	16.70	17.97
4H	2H	13.27	14.04	14.21	14.98	16.22	12.91	13.68	13.86	14.63	15.86
	3H	15.13	15.78	16.09	16.75	18.00	14.72	15.37	15.68	16.34	17.59
	4H	15.84	16.43	16.81	17.40	18.67	15.42	16.01	16.39	16.98	18.25
	6H	16.36	16.86	17.33	17.86	19.13	15.93	16.43	16.90	17.43	18.70
	8H	16.51	16.98	17.49	17.97	19.25	16.07	16.54	17.05	17.53	18.81
	12H	16.58	17.01	17.58	18.01	19.30	16.13	16.56	17.13	17.56	18.85
8H	4H	16.04	16.51	17.02	17.50	18.78	15.66	16.14	16.64	17.12	18.41
	6H	16.67	17.06	17.67	18.09	19.37	16.28	16.68	17.29	17.70	18.99
	8H	16.89	17.23	17.90	18.25	19.55	16.49	16.84	17.51	17.86	19.16
	12H	17.02	17.32	18.03	18.33	19.68	16.61	16.91	17.62	17.92	19.27
12H	4H	16.03	16.46	17.03	17.46	18.75	15.66	16.09	16.66	17.09	18.38
	6H	16.70	17.04	17.71	18.06	19.36	16.32	16.67	17.34	17.69	18.99
	8H	16.94	17.24	17.95	18.25	19.60	16.56	16.86	17.57	17.87	19.22

END OF REPORT