

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920041

Luminaire Tested: DFN2DIP-SQ3F0-050D100US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920041
REPORT IS A COMBINATION OF REPORTS P901491 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D100US935-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12785.9 lumens
Efficiency: N/A
Efficacy: 106.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920041

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US935-FLLONL

Luminous Intensity Polar Plot

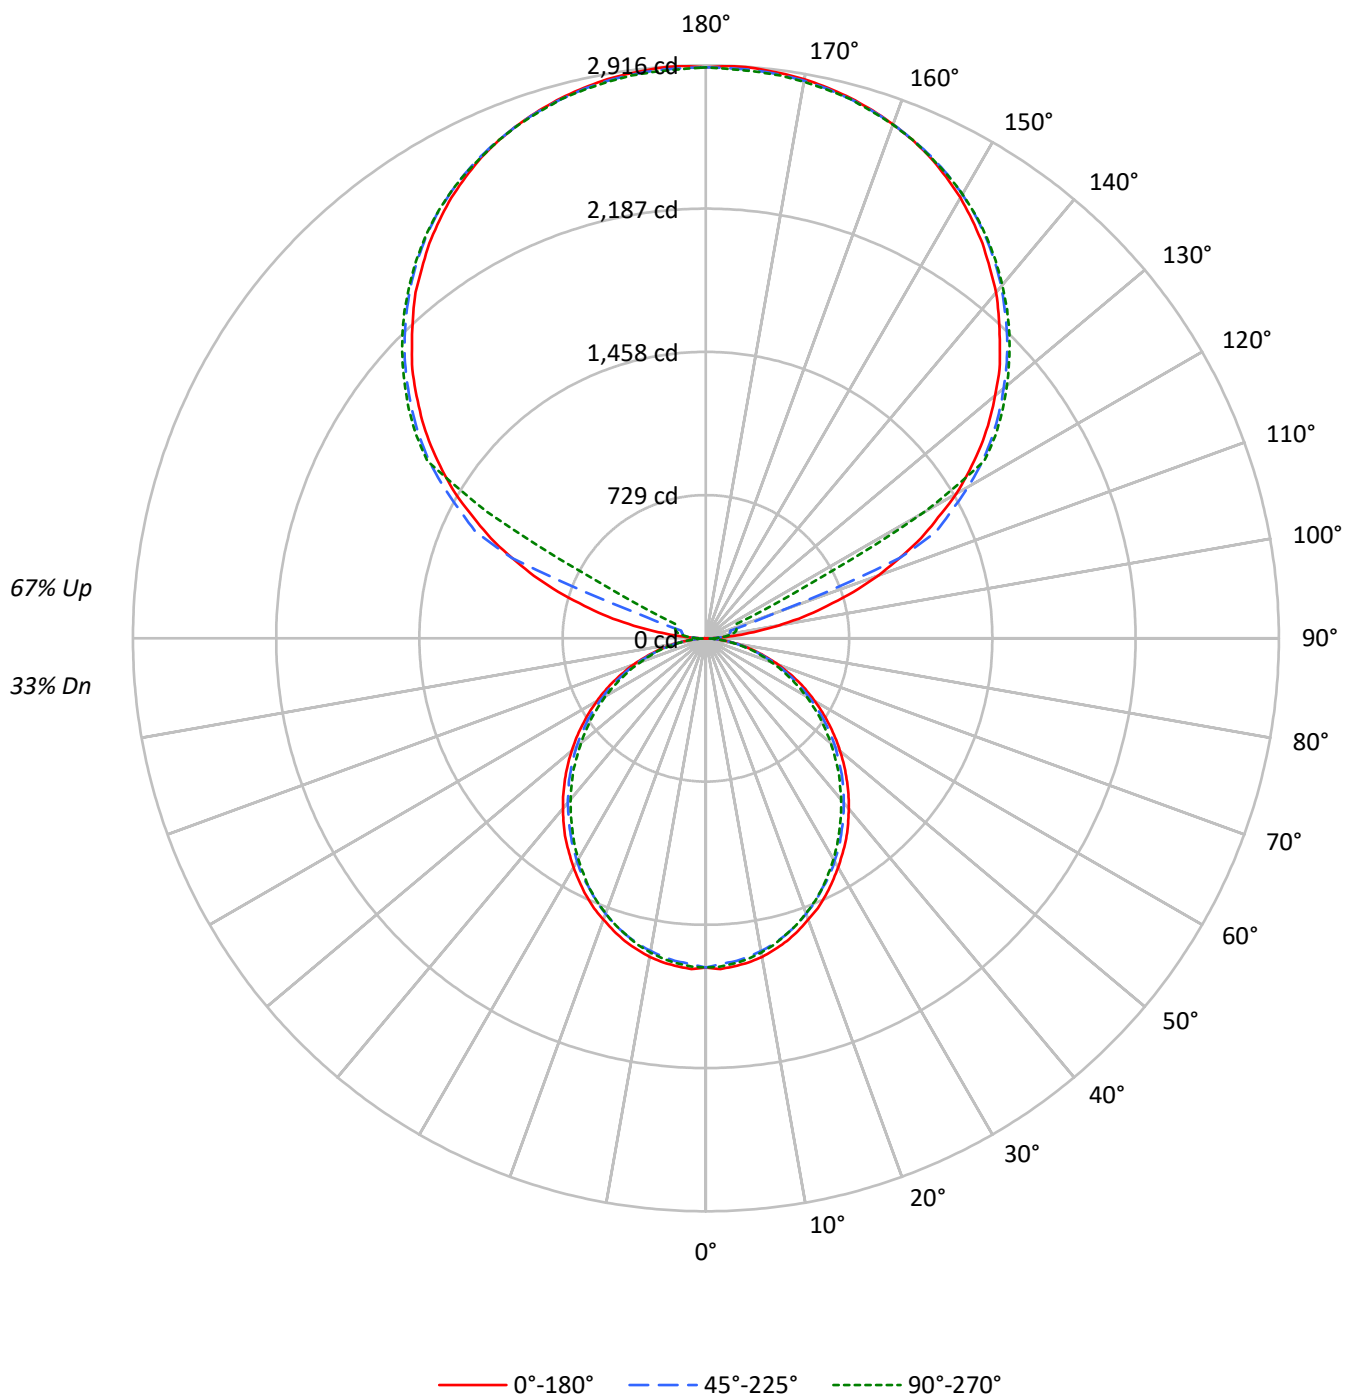

TEST NUMBER: P920041

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1919	1919	1919
5°	1921	1891	1905
10°	1904	1865	1878
15°	1875	1833	1837
20°	1836	1789	1795
25°	1797	1736	1747
30°	1749	1688	1686
35°	1703	1630	1621
40°	1646	1572	1560
45°	1590	1514	1496
50°	1528	1453	1423
55°	1464	1383	1356
60°	1390	1299	1279
65°	1310	1212	1188
70°	1208	1106	1090
75°	1068	979	998
80°	898	817	825
85°	632	541	540

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1991 cd/sqm

TEST NUMBER: P920041

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	1.2
10°-20°	443.6	3.5
20°-30°	651.9	5.1
30°-40°	757.2	5.9
40°-50°	756.2	5.9
50°-60°	659.4	5.2
60°-70°	487.4	3.8
70°-80°	275.8	2.2
80°-90°	77.9	0.6
90°-100°	95.8	0.7
100°-110°	357.2	2.8
110°-120°	947.3	7.4
120°-130°	1571.2	12.3
130°-140°	1669.0	13.1
140°-150°	1551.1	12.1
150°-160°	1247.1	9.8
160°-170°	803.6	6.3
170°-180°	276.6	2.2
0°-30°	1253.2	9.8
0°-40°	2010.3	15.7
0°-60°	3425.9	26.8
0°-90°	4267.1	33.4
90°-120°	1400.3	11.0
90°-150°	6191.6	48.4
90°-180°	8519.0	66.6
0°-180°	12785.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	2	25	42	53	57	12
95°	137	67	82	93	90	162
105°	639	702	128	151	160	683
115°	1209	1245	1297	324	172	1190
125°	1709	1737	1777	1792	1798	1524
135°	2115	2149	2168	2189	2185	1634
145°	2454	2452	2487	2502	2492	1535
155°	2702	2683	2708	2721	2704	1245
165°	2847	2834	2841	2855	2841	804
175°	2912	2897	2902	2916	2895	277
180°	2906	2906	2906	2906	2906	

TEST NUMBER: P920041

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	2.0	25.2	41.9	52.7	56.7
92.5°	52.7	44.2	50.5	54.7	56.7
95°	136.6	67.2	81.9	92.6	90.4
97.5°	245.9	73.6	107.1	113.6	115.6
100°	372.3	84.1	119.9	136.6	140.9
102.5°	510.8	506.9	124.1	147.1	153.5
105°	639.2	702.3	128.4	151.3	159.8
107.5°	788.5	840.9	132.6	155.6	164.0
110°	931.5	975.5	368.0	157.8	166.0

TEST NUMBER: P920041

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1066.1	1103.8	1068.2	161.8	168.3
115°	1208.9	1244.7	1297.4	323.8	172.5
117.5°	1333.0	1375.0	1410.9	1110.1	559.3
120°	1471.9	1503.3	1541.3	1566.5	1282.6
122.5°	1589.5	1623.2	1665.3	1677.8	1680.1
125°	1709.3	1736.8	1776.8	1791.5	1797.7
127.5°	1818.7	1848.1	1879.8	1900.8	1902.8
130°	1921.7	1955.5	1978.5	2001.6	1999.7
132.5°	2026.9	2054.3	2077.3	2096.3	2094.3
135°	2115.3	2149.0	2167.7	2188.9	2184.7
137.5°	2207.7	2232.9	2254.1	2275.1	2268.8
140°	2298.0	2315.1	2338.0	2357.0	2346.5
142.5°	2373.9	2388.7	2415.9	2432.6	2422.2
145°	2453.8	2451.6	2487.3	2502.1	2491.6
147.5°	2523.0	2516.8	2552.4	2562.9	2554.8
150°	2590.4	2575.7	2609.4	2621.9	2611.4
152.5°	2647.1	2630.3	2661.9	2674.5	2659.8
155°	2701.8	2683.0	2708.3	2720.8	2704.0
157.5°	2746.0	2729.3	2748.2	2762.9	2746.0
160°	2784.0	2771.2	2784.0	2796.4	2781.7
162.5°	2817.4	2804.9	2815.4	2830.1	2811.2
165°	2846.8	2834.3	2840.6	2855.3	2840.6
167.5°	2870.1	2857.3	2863.9	2878.6	2859.5
170°	2889.0	2876.3	2880.6	2895.3	2876.3
172.5°	2901.5	2889.0	2893.3	2908.0	2889.0
175°	2912.0	2897.3	2901.5	2916.3	2895.3
177.5°	2916.3	2901.5	2903.8	2918.5	2899.5
180°	2905.8	2905.8	2905.8	2905.8	2905.8

TEST NUMBER: P920041

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.73	8.46	8.82	9.55	11.04	7.29	8.02	8.37	9.10	10.59
	3H	9.38	10.03	10.47	11.12	12.63	8.89	9.54	9.98	10.63	12.14
	4H	9.95	10.57	11.06	11.67	13.18	9.46	10.08	10.57	11.18	12.69
	6H	10.34	10.91	11.46	12.01	13.54	9.84	10.42	10.96	11.51	13.04
	8H	10.44	10.99	11.56	12.10	13.62	9.94	10.49	11.06	11.60	13.12
	12H	10.49	11.00	11.61	12.11	13.65	9.98	10.49	11.10	11.60	13.14
4H	2H	8.17	8.79	9.29	9.89	11.40	7.82	8.44	8.93	9.53	11.05
	3H	10.02	10.54	11.14	11.66	13.19	9.61	10.13	10.73	11.25	12.78
	4H	10.72	11.20	11.85	12.31	13.86	10.30	10.78	11.43	11.89	13.44
	6H	11.23	11.64	12.36	12.77	14.31	10.80	11.20	11.93	12.34	13.88
	8H	11.37	11.75	12.50	12.88	14.43	10.94	11.32	12.07	12.44	14.00
	12H	11.44	11.78	12.58	12.92	14.48	10.99	11.33	12.14	12.47	14.03
8H	4H	10.91	11.29	12.04	12.41	13.97	10.53	10.91	11.66	12.04	13.59
	6H	11.53	11.84	12.68	13.01	14.56	11.14	11.46	12.29	12.63	14.18
	8H	11.74	12.02	12.90	13.17	14.74	11.35	11.62	12.51	12.77	14.34
	12H	11.86	12.11	13.03	13.25	14.86	11.45	11.69	12.62	12.84	14.45
12H	4H	10.88	11.23	12.03	12.37	13.93	10.52	10.86	11.66	12.00	13.56
	6H	11.55	11.83	12.71	12.98	14.55	11.18	11.46	12.34	12.60	14.18
	8H	11.78	12.03	12.95	13.17	14.78	11.40	11.65	12.57	12.79	14.40

END OF REPORT