

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920063

Luminaire Tested: DFN2DIP-SQ3F0-060D060US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920063
REPORT IS A COMBINATION OF REPORTS P901422 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D060US935-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9505.4 lumens
Efficiency: N/A
Efficacy: 96.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920063

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US935-RLLONL

Luminous Intensity Polar Plot

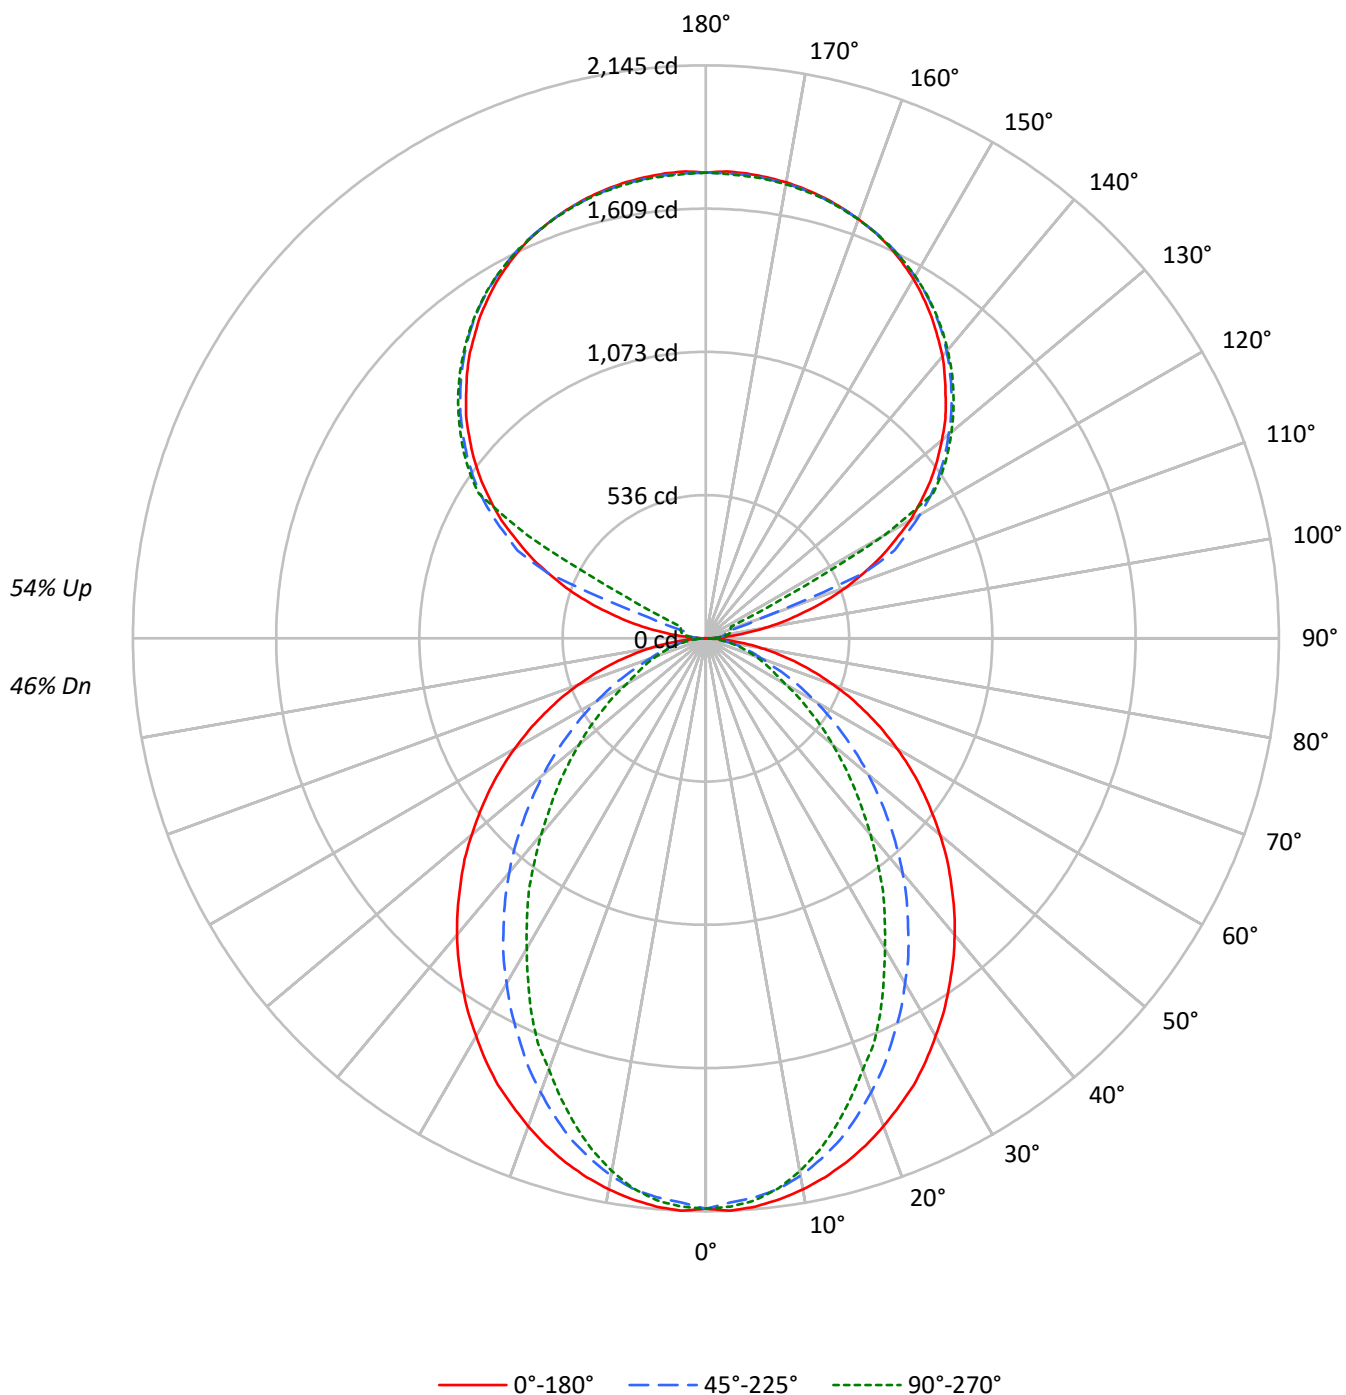

TEST NUMBER: P920063

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2446	2446	2446
5°	2449	2406	2422
10°	2423	2357	2343
15°	2388	2278	2220
20°	2342	2169	2070
25°	2296	2047	1925
30°	2233	1922	1741
35°	2172	1788	1580
40°	2110	1650	1395
45°	2038	1497	1228
50°	1963	1342	1064
55°	1884	1177	907
60°	1794	1005	746
65°	1689	829	671
70°	1562	666	606
75°	1403	583	549
80°	1172	484	474
85°	795	316	351

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2038 cd/sqm

TEST NUMBER: P920063

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	2.1
10°-20°	549.3	5.8
20°-30°	771.2	8.1
30°-40°	840.7	8.8
40°-50°	772.7	8.1
50°-60°	606.8	6.4
60°-70°	395.0	4.2
70°-80°	203.3	2.1
80°-90°	55.0	0.6
90°-100°	57.5	0.6
100°-110°	214.3	2.3
110°-120°	568.4	6.0
120°-130°	942.7	9.9
130°-140°	1001.4	10.5
140°-150°	930.7	9.8
150°-160°	748.2	7.9
160°-170°	482.1	5.1
170°-180°	165.9	1.7
0°-30°	1520.7	16.0
0°-40°	2361.4	24.8
0°-60°	3740.9	39.4
0°-90°	4394.1	46.2
90°-120°	840.2	8.8
90°-150°	3714.9	39.1
90°-180°	5111.0	53.8
0°-180°	9505.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	1	15	25	32	34	9
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P920063

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P920063

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P920063

CATALOG NUMBER: DFN2DIP-SQ3F0-060D060US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.86	10.66	10.85	11.66	12.99	5.82	6.62	6.81	7.62	8.95
	3H	11.53	12.24	12.53	13.26	14.60	7.00	7.71	8.00	8.73	10.07
	4H	12.13	12.81	13.15	13.82	15.18	7.44	8.12	8.46	9.13	10.49
	6H	12.55	13.17	13.58	14.19	15.56	7.76	8.38	8.79	9.40	10.77
	8H	12.67	13.27	13.71	14.30	15.66	7.84	8.44	8.88	9.47	10.83
	12H	12.73	13.29	13.77	14.32	15.71	7.88	8.45	8.92	9.47	10.86
4H	2H	9.87	10.55	10.90	11.56	12.92	6.41	7.08	7.43	8.10	9.46
	3H	11.69	12.25	12.72	13.30	14.67	7.75	8.31	8.78	9.35	10.72
	4H	12.38	12.89	13.42	13.93	15.32	8.29	8.80	9.33	9.84	11.23
	6H	12.89	13.33	13.94	14.39	15.78	8.70	9.14	9.75	10.20	11.59
	8H	13.06	13.47	14.11	14.52	15.93	8.82	9.24	9.88	10.29	11.69
	12H	13.15	13.52	14.22	14.59	16.00	8.88	9.26	9.95	10.32	11.73
8H	4H	12.34	12.76	13.39	13.81	15.21	8.56	8.98	9.62	10.03	11.43
	6H	12.90	13.24	13.98	14.34	15.74	9.07	9.41	10.15	10.51	11.91
	8H	13.12	13.41	14.20	14.49	15.91	9.26	9.56	10.34	10.63	12.05
	12H	13.25	13.51	14.33	14.58	16.04	9.37	9.63	10.46	10.71	12.17
12H	4H	12.29	12.67	13.36	13.73	15.14	8.57	8.94	9.64	10.00	11.41
	6H	12.88	13.18	13.96	14.25	15.67	9.12	9.42	10.20	10.50	11.92
	8H	13.09	13.36	14.18	14.43	15.89	9.32	9.59	10.41	10.66	12.12