

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920085

Luminaire Tested: DFN2DIP-SQ3F0-060D120US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920085
REPORT IS A COMBINATION OF REPORTS P901529 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D120US935-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15343.0 lumens
Efficiency: N/A
Efficacy: 104.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 147.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920085

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US935-FLLONL

Luminous Intensity Polar Plot

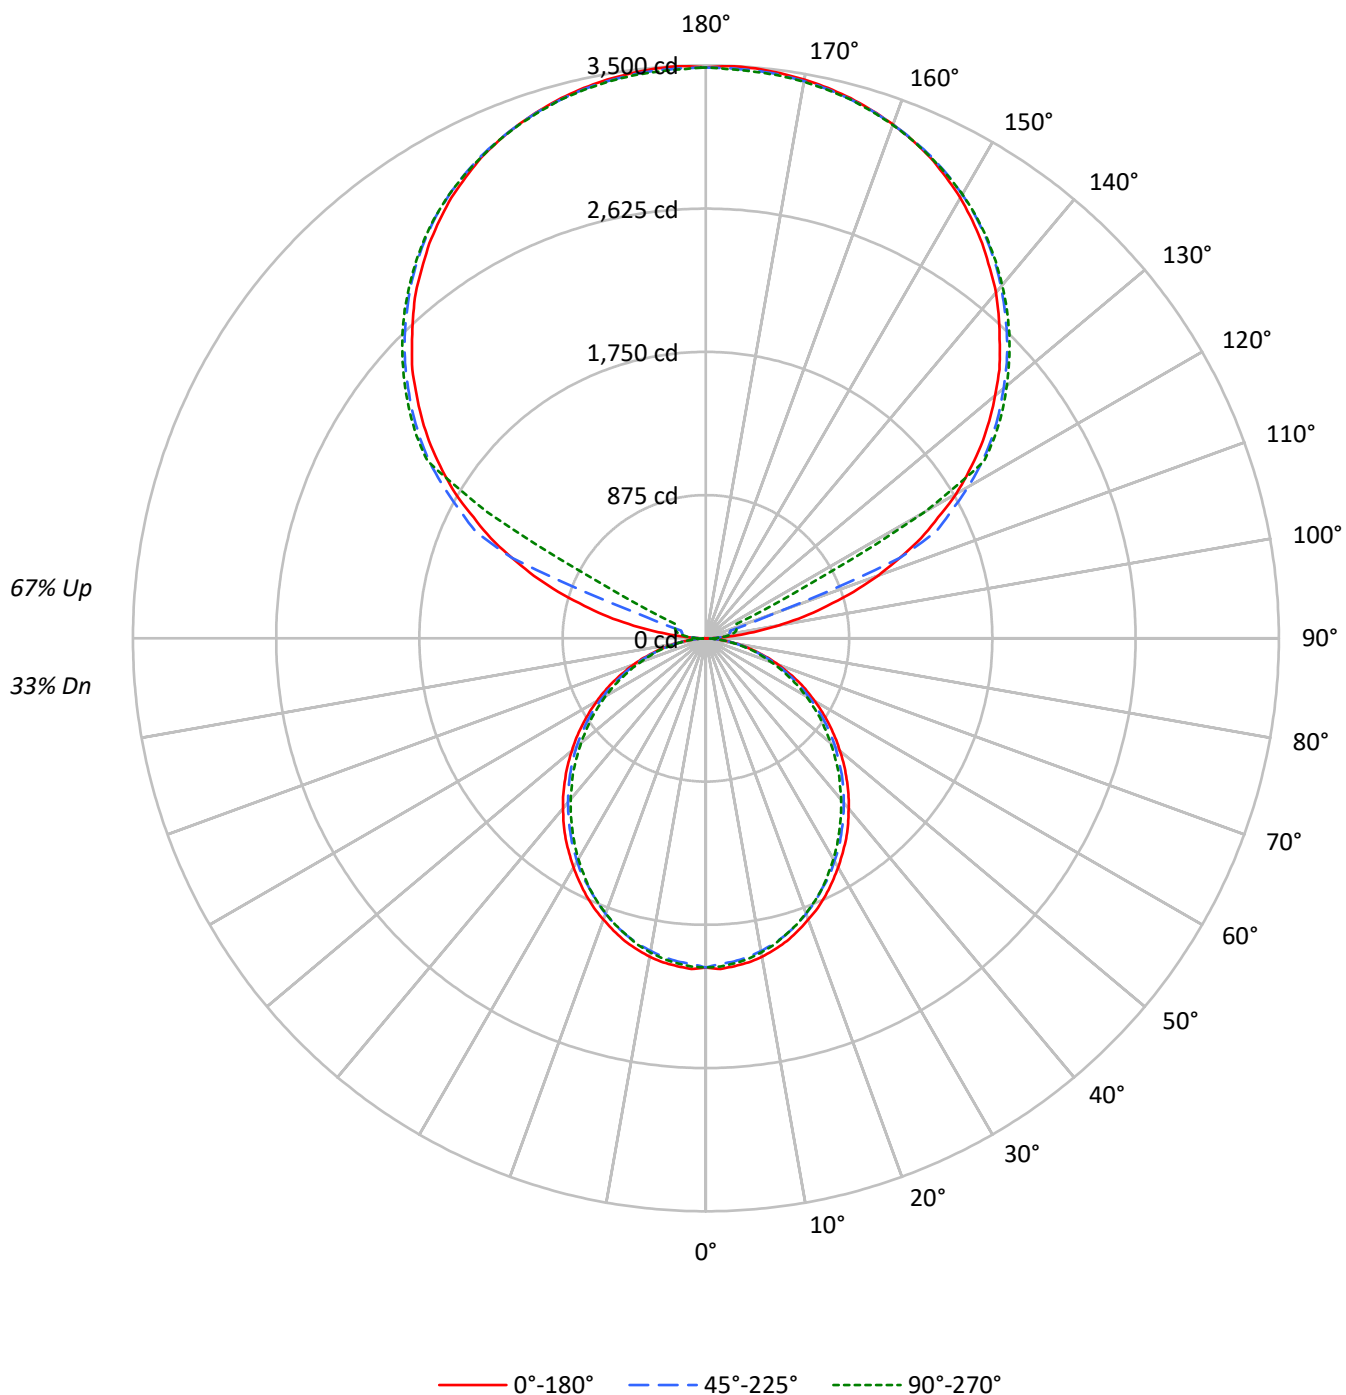

TEST NUMBER: P920085

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41			33
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34			28
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29			24
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25			20
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21			17
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18			15
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16			13
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14			12
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13			10
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12			9
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11			9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2303	2303	2303
5°	2305	2270	2286
10°	2285	2237	2254
15°	2250	2199	2205
20°	2203	2146	2155
25°	2157	2084	2097
30°	2099	2025	2023
35°	2043	1956	1945
40°	1975	1887	1871
45°	1908	1817	1796
50°	1834	1744	1708
55°	1756	1659	1627
60°	1668	1559	1535
65°	1572	1455	1425
70°	1450	1327	1308
75°	1281	1175	1198
80°	1077	980	990
85°	757	649	648

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2388 cd/sqm

TEST NUMBER: P920085

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	1.2
10°-20°	532.3	3.5
20°-30°	782.3	5.1
30°-40°	908.6	5.9
40°-50°	907.5	5.9
50°-60°	791.3	5.2
60°-70°	584.9	3.8
70°-80°	330.9	2.2
80°-90°	93.5	0.6
90°-100°	115.0	0.7
100°-110°	428.6	2.8
110°-120°	1136.8	7.4
120°-130°	1885.4	12.3
130°-140°	2002.8	13.1
140°-150°	1861.3	12.1
150°-160°	1496.5	9.8
160°-170°	964.3	6.3
170°-180°	331.9	2.2
0°-30°	1503.8	9.8
0°-40°	2412.4	15.7
0°-60°	4111.1	26.8
0°-90°	5120.5	33.4
90°-120°	1680.4	11.0
90°-150°	7429.9	48.4
90°-180°	10223.0	66.6
0°-180°	15343.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	2	30	50	63	68	14
95°	164	81	98	111	108	194
105°	767	843	154	182	192	820
115°	1451	1494	1557	389	207	1428
125°	2051	2084	2132	2150	2157	1829
135°	2538	2579	2601	2627	2622	1961
145°	2945	2942	2985	3002	2990	1842
155°	3242	3220	3250	3265	3245	1494
165°	3416	3401	3409	3426	3409	965
175°	3494	3477	3482	3500	3474	333
180°	3487	3487	3487	3487	3487	

TEST NUMBER: P920085

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	2.4	30.2	50.4	63.2	68.0
92.5°	63.2	53.0	60.5	65.6	68.0
95°	163.8	80.6	98.2	111.2	108.5
97.5°	295.2	88.4	128.5	136.3	138.7
100°	446.7	101.0	143.8	163.8	169.0
102.5°	613.0	608.2	148.9	176.5	184.3
105°	767.0	842.8	154.0	181.6	191.7
107.5°	946.2	1009.1	159.1	186.7	196.8
110°	1117.8	1170.6	441.6	189.3	199.2

TEST NUMBER: P920085

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1279.4	1324.6	1281.8	194.2	201.9
115°	1450.7	1493.6	1556.8	388.6	207.1
117.5°	1599.6	1650.0	1693.2	1332.0	671.1
120°	1766.3	1804.0	1849.5	1879.8	1539.1
122.5°	1907.4	1947.8	1998.5	2013.4	2016.1
125°	2051.2	2084.1	2132.1	2149.7	2157.2
127.5°	2182.4	2217.8	2255.8	2281.0	2283.4
130°	2306.1	2346.6	2374.1	2402.0	2399.6
132.5°	2432.2	2465.2	2492.8	2515.6	2513.2
135°	2538.3	2578.8	2601.2	2626.7	2621.7
137.5°	2649.2	2679.4	2704.9	2730.1	2722.6
140°	2757.7	2778.0	2805.6	2828.4	2815.8
142.5°	2848.7	2866.4	2899.1	2919.1	2906.6
145°	2944.6	2941.9	2984.7	3002.5	2989.8
147.5°	3027.6	3020.1	3063.0	3075.6	3065.7
150°	3108.5	3090.8	3131.3	3146.3	3133.7
152.5°	3176.5	3156.4	3194.2	3209.5	3191.8
155°	3242.1	3219.6	3249.9	3264.9	3244.8
157.5°	3295.1	3275.1	3297.9	3315.5	3295.1
160°	3340.7	3325.4	3340.7	3355.7	3338.0
162.5°	3380.9	3365.9	3378.5	3396.1	3373.4
165°	3416.2	3401.2	3408.7	3426.4	3408.7
167.5°	3444.1	3428.8	3436.6	3454.2	3431.5
170°	3466.8	3451.6	3456.6	3474.3	3451.6
172.5°	3481.8	3466.8	3472.0	3489.6	3466.8
175°	3494.4	3476.7	3481.8	3499.5	3474.3
177.5°	3499.5	3481.8	3484.5	3502.2	3479.5
180°	3487.0	3487.0	3487.0	3487.0	3487.0

TEST NUMBER: P920085

CATALOG NUMBER: DFN2DIP-SQ3F0-060D120US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.36	9.09	9.45	10.18	11.67	7.92	8.65	9.01	9.74	11.23
	3H	10.01	10.66	11.11	11.76	13.27	9.52	10.17	10.62	11.27	12.78
	4H	10.59	11.21	11.70	12.30	13.82	10.09	10.71	11.20	11.81	13.32
	6H	10.98	11.55	12.09	12.65	14.17	10.48	11.05	11.59	12.15	13.67
	8H	11.08	11.62	12.20	12.73	14.25	10.57	11.12	11.69	12.23	13.75
	12H	11.12	11.63	12.24	12.74	14.29	10.61	11.13	11.73	12.23	13.78
4H	2H	8.81	9.43	9.92	10.52	12.04	8.45	9.07	9.56	10.17	11.68
	3H	10.65	11.17	11.77	12.29	13.82	10.25	10.76	11.37	11.89	13.41
	4H	11.36	11.83	12.48	12.95	14.49	10.93	11.41	12.06	12.52	14.07
	6H	11.86	12.27	12.99	13.40	14.94	11.43	11.84	12.56	12.97	14.51
	8H	12.01	12.39	13.14	13.51	15.07	11.57	11.95	12.70	13.08	14.63
	12H	12.07	12.41	13.22	13.55	15.11	11.62	11.97	12.77	13.11	14.66
8H	4H	11.54	11.92	12.67	13.05	14.60	11.16	11.54	12.29	12.67	14.23
	6H	12.16	12.47	13.31	13.64	15.19	11.78	12.09	12.93	13.26	14.81
	8H	12.38	12.65	13.53	13.80	15.37	11.98	12.26	13.14	13.41	14.98
	12H	12.50	12.74	13.66	13.88	15.49	12.09	12.33	13.25	13.47	15.08
12H	4H	11.52	11.86	12.67	13.00	14.56	11.15	11.49	12.30	12.63	14.19
	6H	12.19	12.46	13.34	13.61	15.18	11.81	12.09	12.97	13.24	14.81
	8H	12.42	12.66	13.58	13.81	15.41	12.04	12.28	13.20	13.42	15.03

END OF REPORT