

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920106

Luminaire Tested: DFN2DIP-SQ3F0-070D080US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920106
REPORT IS A COMBINATION OF REPORTS P899940 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D080US935-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11218.8 lumens
Efficiency: N/A
Efficacy: 89.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 126
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920106

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US935-RLLFLL

Luminous Intensity Polar Plot

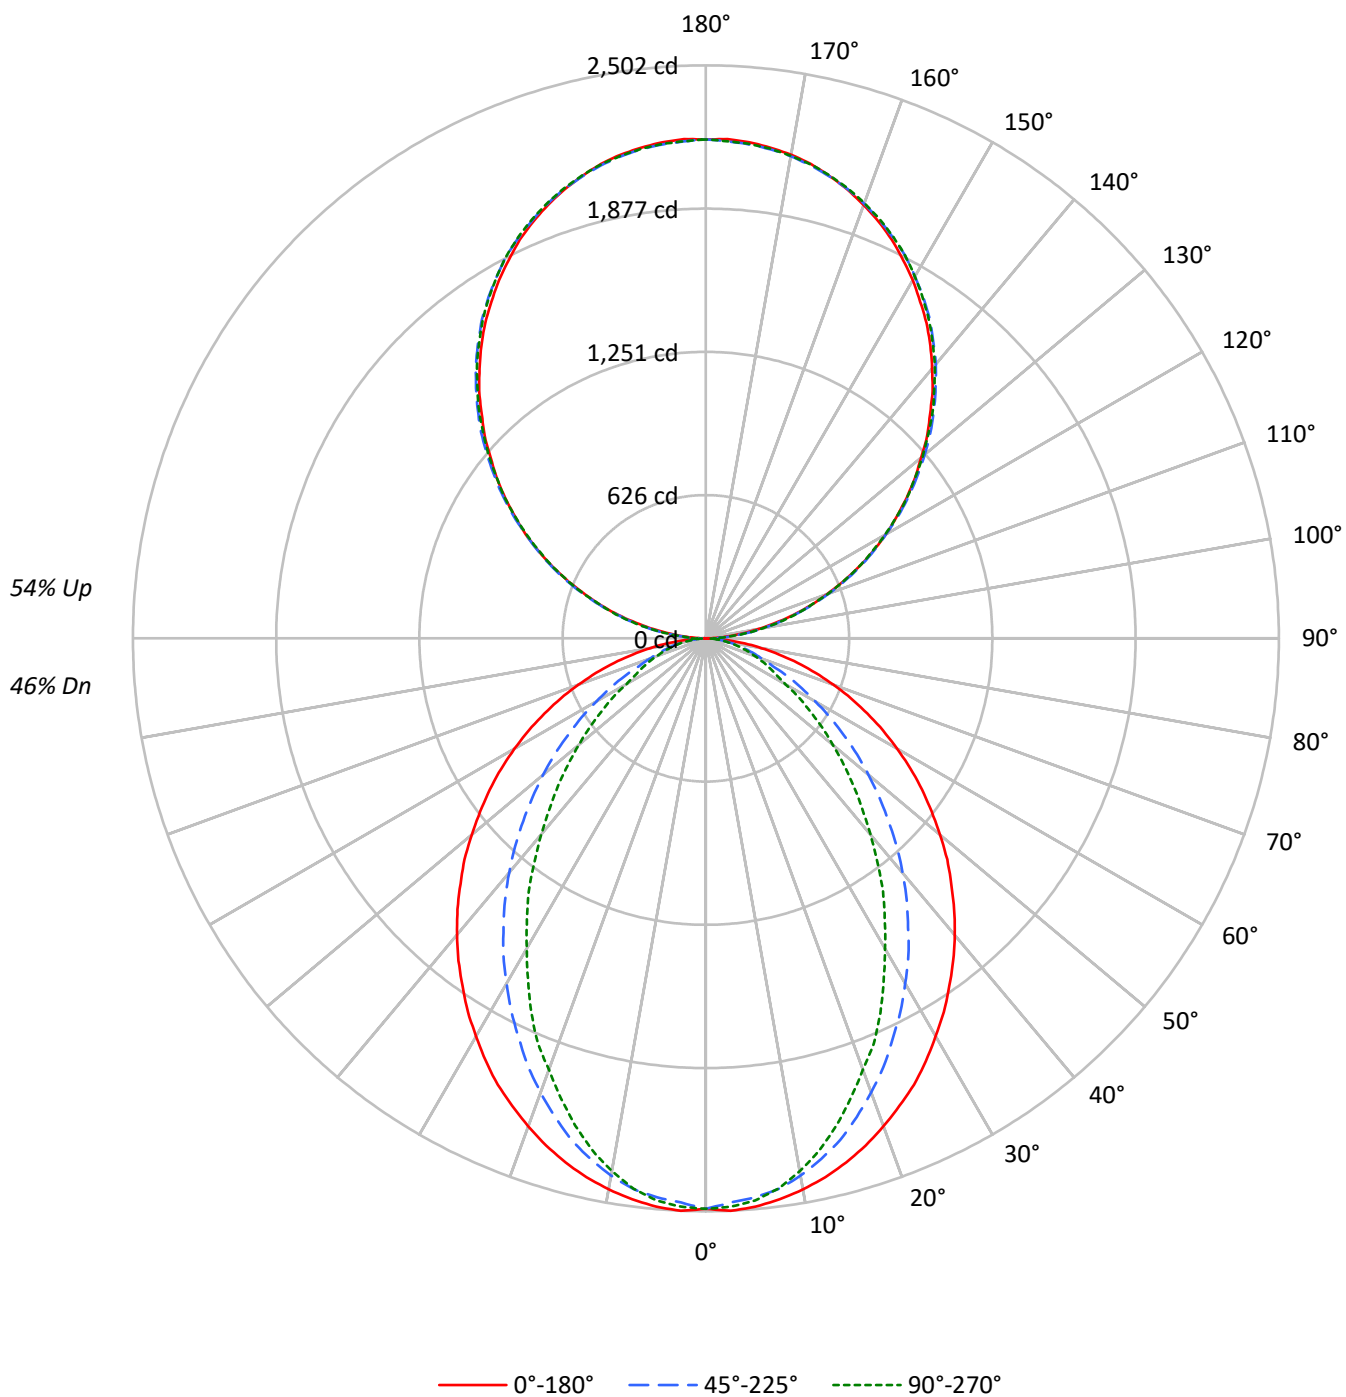

TEST NUMBER: P920106

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US935-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	86	82	80	72	69	67	59	57	56	47	46	45
2	89	82	76	71	81	75	70	66	63	60	56	52	49	47	42	40	38
3	81	72	65	60	74	67	61	56	56	52	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	48	50	45	41	42	38	35	34	31	29
5	69	57	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	37	32	37	32	28	31	27	24	26	23	20
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	20	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2854	2854	2854
5°	2857	2807	2826
10°	2827	2750	2733
15°	2786	2657	2590
20°	2733	2530	2415
25°	2678	2388	2246
30°	2606	2243	2032
35°	2534	2086	1843
40°	2461	1925	1628
45°	2377	1746	1433
50°	2290	1565	1242
55°	2198	1373	1059
60°	2093	1172	870
65°	1971	968	782
70°	1823	777	707
75°	1637	681	641
80°	1368	565	553
85°	928	368	410

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2377 cd/sqm

TEST NUMBER: P920106

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.1
10°-20°	640.9	5.7
20°-30°	899.8	8.0
30°-40°	980.8	8.7
40°-50°	901.5	8.0
50°-60°	708.0	6.3
60°-70°	460.8	4.1
70°-80°	237.2	2.1
80°-90°	66.7	0.6
90°-100°	134.8	1.2
100°-110°	428.3	3.8
110°-120°	733.0	6.5
120°-130°	964.0	8.6
130°-140°	1082.0	9.6
140°-150°	1061.0	9.5
150°-160°	890.1	7.9
160°-170°	590.3	5.3
170°-180°	206.3	1.8
0°-30°	1774.1	15.8
0°-40°	2754.9	24.6
0°-60°	4364.3	38.9
0°-90°	5129.1	45.7
90°-120°	1296.1	11.6
90°-150°	4403.1	39.2
90°-180°	6090.0	54.3
0°-180°	11218.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	2	24	64	60	62	11
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P920106

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P920106

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P920106

CATALOG NUMBER: DFN2DIP-SQ3F0-070D080US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.34	11.14	11.34	12.14	13.48	6.30	7.10	7.30	8.10	9.44
	3H	12.01	12.72	13.02	13.74	15.09	7.48	8.19	8.49	9.21	10.56
	4H	12.62	13.29	13.64	14.31	15.67	7.93	8.60	8.95	9.62	10.98
	6H	13.03	13.65	14.06	14.67	16.05	8.24	8.86	9.27	9.88	11.26
	8H	13.16	13.74	14.19	14.78	16.15	8.33	8.92	9.36	9.95	11.32
	12H	13.21	13.77	14.26	14.81	16.20	8.37	8.93	9.41	9.96	11.35
4H	2H	10.35	11.03	11.38	12.05	13.41	6.89	7.56	7.92	8.58	9.95
	3H	12.17	12.73	13.21	13.78	15.16	8.23	8.79	9.27	9.84	11.21
	4H	12.86	13.37	13.91	14.41	15.81	8.77	9.28	9.82	10.32	11.72
	6H	13.37	13.81	14.42	14.87	16.27	9.18	9.62	10.24	10.68	12.08
	8H	13.54	13.95	14.60	15.01	16.42	9.31	9.72	10.36	10.77	12.18
	12H	13.63	14.00	14.70	15.07	16.49	9.37	9.74	10.44	10.81	12.22
8H	4H	12.83	13.24	13.88	14.29	15.70	9.05	9.46	10.10	10.51	11.92
	6H	13.38	13.72	14.46	14.82	16.23	9.56	9.89	10.63	10.99	12.40
	8H	13.60	13.90	14.68	14.98	16.40	9.74	10.04	10.83	11.12	12.54
	12H	13.73	13.99	14.82	15.07	16.53	9.85	10.11	10.94	11.19	12.66
12H	4H	12.78	13.15	13.85	14.21	15.63	9.05	9.42	10.12	10.49	11.90
	6H	13.36	13.66	14.44	14.74	16.16	9.60	9.90	10.69	10.98	12.41
	8H	13.57	13.84	14.66	14.91	16.38	9.81	10.07	10.89	11.14	12.61

END OF REPORT