

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920133

Luminaire Tested: DFN2DIP-SQ3F0-080D060US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920133
REPORT IS A COMBINATION OF REPORTS P901425 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D060US935-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 11933.4 lumens
Efficiency: N/A
Efficacy: 98.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 121.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920133
CATALOG NUMBER: DFN2DIP-SQ3F0-080D060US935-FLLONL

Luminous Intensity Polar Plot

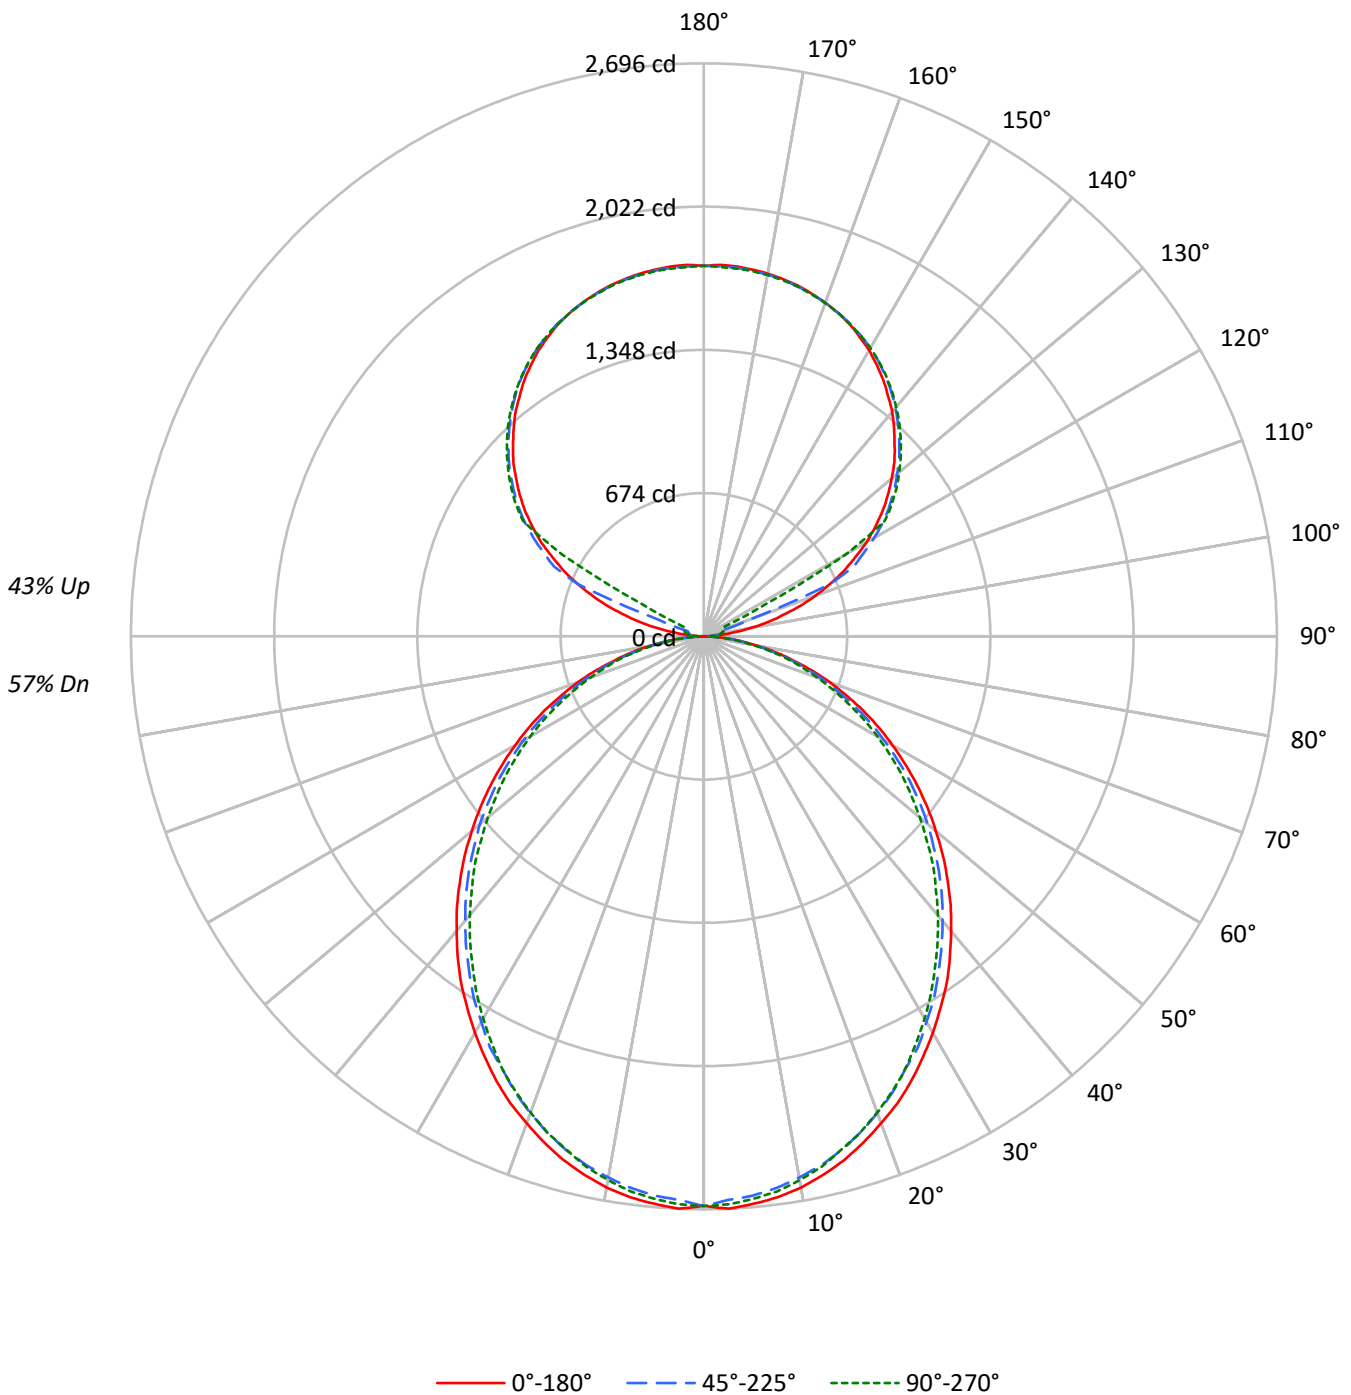



TEST NUMBER: P920133

CATALOG NUMBER: DFN2DIP-SQ3F0-080D060US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63	57	57	57	57
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53	48	48	48	48
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45	40	40	40	40
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38	34	34	34	34
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33	29	29	29	29
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29	26	26	26	26
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25	22	22	22	22
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22	20	20	20	20
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20	18	18	18	18
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18	16	16	16	16
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17	15	15	15	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3071	3071	3071
5°	3074	3026	3048
10°	3047	2983	3005
15°	3000	2932	2940
20°	2938	2862	2873
25°	2876	2778	2796
30°	2798	2700	2697
35°	2724	2609	2594
40°	2634	2516	2495
45°	2544	2423	2394
50°	2445	2325	2277
55°	2342	2212	2169
60°	2225	2078	2046
65°	2097	1939	1900
70°	1934	1770	1744
75°	1708	1567	1597
80°	1436	1307	1320
85°	1011	867	864

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2544 cd/sqm



TEST NUMBER: P920133

CATALOG NUMBER: DFN2DIP-SQ3F0-080D060US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	2.1
10°-20°	709.8	5.9
20°-30°	1043.1	8.7
30°-40°	1211.4	10.2
40°-50°	1209.9	10.1
50°-60°	1055.0	8.8
60°-70°	779.9	6.5
70°-80°	441.2	3.7
80°-90°	119.5	1.0
90°-100°	57.5	0.5
100°-110°	214.3	1.8
110°-120°	568.4	4.8
120°-130°	942.7	7.9
130°-140°	1001.4	8.4
140°-150°	930.7	7.8
150°-160°	748.2	6.3
160°-170°	482.1	4.0
170°-180°	165.9	1.4
0°-30°	2005.1	16.8
0°-40°	3216.5	27.0
0°-60°	5481.5	45.9
0°-90°	6822.2	57.2
90°-120°	840.2	7.0
90°-150°	3714.9	31.1
90°-180°	5111.0	42.8
0°-180°	11933.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	1	15	25	32	34	11
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	



TEST NUMBER: P920133

CATALOG NUMBER: DFN2DIP-SQ3F0-080D060US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6



TEST NUMBER: P920133

CATALOG NUMBER: DFN2DIP-SQ3F0-080D060US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4



TEST NUMBER: P920133
 CATALOG NUMBER: DFN2DIP-SQ3F0-080D060US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.77	12.70	12.67	13.62	14.78	11.33	12.26	12.22	13.17	14.34
	3H	13.43	14.27	14.34	15.19	16.38	12.94	13.78	13.85	14.70	15.89
	4H	14.02	14.81	14.94	15.74	16.94	13.53	14.32	14.45	15.24	16.44
	6H	14.42	15.15	15.35	16.08	17.30	13.92	14.65	14.85	15.58	16.80
	8H	14.53	15.22	15.47	16.17	17.38	14.02	14.72	14.96	15.67	16.88
	12H	14.58	15.23	15.52	16.18	17.42	14.07	14.73	15.01	15.67	16.91
4H	2H	12.24	13.03	13.16	13.96	15.15	11.88	12.67	12.81	13.60	14.80
	3H	14.11	14.76	15.04	15.72	16.94	13.70	14.36	14.63	15.31	16.53
	4H	14.82	15.42	15.76	16.37	17.61	14.39	15.00	15.34	15.95	17.19
	6H	15.33	15.85	16.29	16.83	18.07	14.90	15.42	15.86	16.40	17.63
	8H	15.48	15.97	16.44	16.94	18.19	15.04	15.53	16.01	16.50	17.75
	12H	15.56	15.99	16.54	16.98	18.24	15.11	15.54	16.09	16.53	17.79
8H	4H	15.02	15.50	15.98	16.47	17.72	14.64	15.12	15.60	16.09	17.35
	6H	15.64	16.05	16.63	17.06	18.31	15.26	15.66	16.25	16.67	17.93
	8H	15.86	16.22	16.86	17.22	18.49	15.47	15.82	16.47	16.82	18.09
	12H	15.99	16.31	16.99	17.30	18.62	15.58	15.89	16.58	16.89	18.21
12H	4H	15.00	15.44	15.99	16.43	17.69	14.64	15.07	15.62	16.06	17.32
	6H	15.67	16.03	16.67	17.03	18.30	15.30	15.66	16.30	16.66	17.93
	8H	15.91	16.23	16.91	17.22	18.54	15.53	15.85	16.53	16.84	18.16