

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920145

Luminaire Tested: DFN2DIP-SQ3F0-080D090US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920145
REPORT IS A COMBINATION OF REPORTS P901479 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D090US935-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14490.6 lumens
Efficiency: N/A
Efficacy: 100.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 144.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920145

CATALOG NUMBER: DFN2DIP-SQ3F0-080D090US935-FLLONL

Luminous Intensity Polar Plot

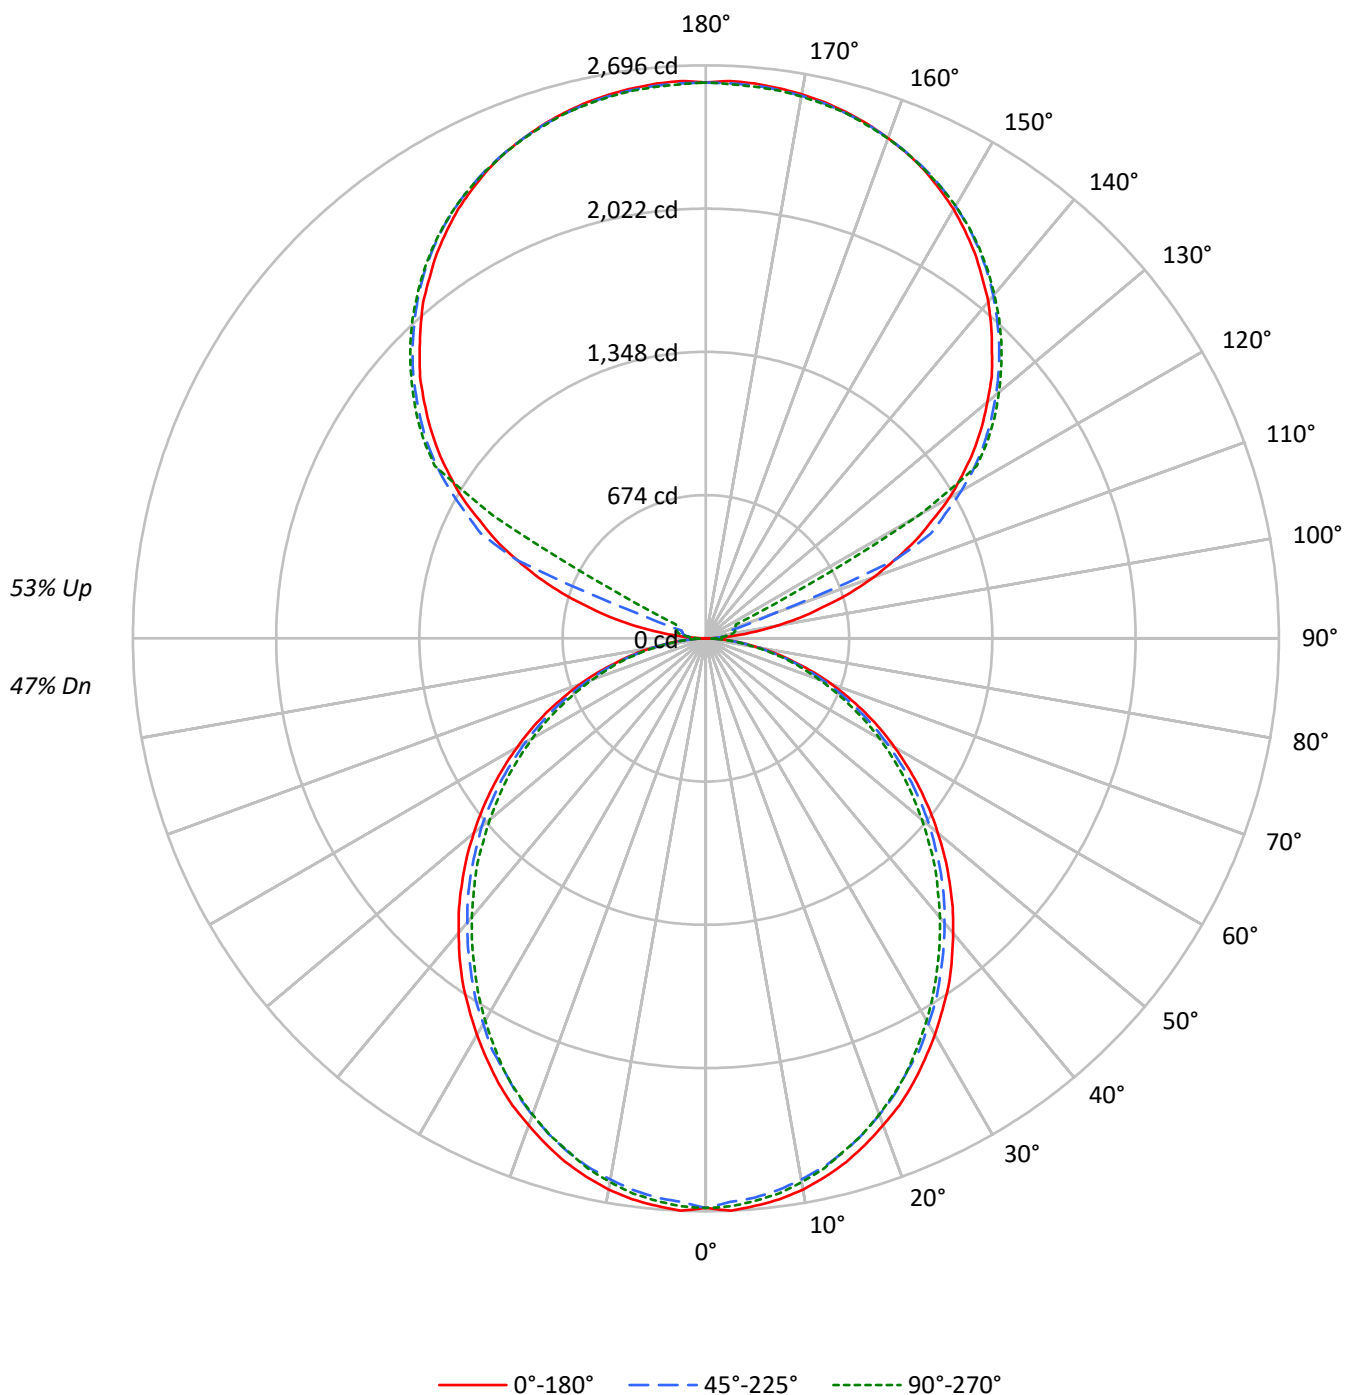

TEST NUMBER: P920145

CATALOG NUMBER: DFN2DIP-SQ3F0-080D090US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	82	82	82	67	67	67	53	53	53
1	97	93	89	85	89	85	82	79	72	69	67	59	57	56	47	46	45
2	88	81	75	70	81	75	69	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	39	37	34	32
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	39	34	37	32	29	30	27	24
6	62	50	42	36	57	47	39	34	40	34	30	33	29	26	27	24	21
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	21	19
8	53	41	34	28	49	38	31	27	33	27	23	28	23	20	23	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	34	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3071	3071	3071
5°	3074	3026	3048
10°	3047	2983	3005
15°	3000	2932	2940
20°	2938	2862	2873
25°	2876	2778	2796
30°	2798	2700	2697
35°	2724	2609	2594
40°	2634	2516	2495
45°	2544	2423	2394
50°	2445	2325	2277
55°	2342	2212	2169
60°	2225	2078	2046
65°	2097	1939	1900
70°	1934	1770	1744
75°	1708	1567	1597
80°	1436	1307	1320
85°	1011	867	864

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2544 cd/sqm

TEST NUMBER: P920145

CATALOG NUMBER: DFN2DIP-SQ3F0-080D090US935-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	1.7
10°-20°	709.8	4.9
20°-30°	1043.1	7.2
30°-40°	1211.4	8.4
40°-50°	1209.9	8.3
50°-60°	1055.0	7.3
60°-70°	779.9	5.4
70°-80°	441.2	3.0
80°-90°	121.1	0.8
90°-100°	86.2	0.6
100°-110°	321.5	2.2
110°-120°	852.6	5.9
120°-130°	1414.1	9.8
130°-140°	1502.1	10.4
140°-150°	1396.0	9.6
150°-160°	1122.4	7.7
160°-170°	723.2	5.0
170°-180°	248.9	1.7
0°-30°	2005.1	13.8
0°-40°	3216.5	22.2
0°-60°	5481.5	37.8
0°-90°	6823.7	47.1
90°-120°	1260.3	8.7
90°-150°	5572.4	38.5
90°-180°	7667.0	52.9
0°-180°	14490.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	2	23	38	47	51	13
95°	123	60	74	83	81	146
105°	575	632	116	136	144	615
115°	1088	1120	1168	291	155	1071
125°	1538	1563	1599	1612	1618	1372
135°	1904	1934	1951	1970	1966	1471
145°	2208	2206	2239	2252	2242	1381
155°	2432	2415	2437	2449	2434	1121
165°	2562	2551	2557	2570	2557	724
175°	2621	2608	2611	2625	2606	249
180°	2615	2615	2615	2615	2615	

TEST NUMBER: P920145

CATALOG NUMBER: DFN2DIP-SQ3F0-080D090US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	1.8	22.7	37.7	47.4	51.0
92.5°	47.4	39.8	45.4	49.2	51.0
95°	123.0	60.4	73.7	83.3	81.4
97.5°	221.4	66.3	96.4	102.2	104.0
100°	335.0	75.8	107.9	123.0	126.7
102.5°	459.8	456.2	111.7	132.3	138.2
105°	575.2	632.1	115.5	136.2	143.8
107.5°	709.6	756.8	119.3	140.0	147.7
110°	838.4	878.0	331.2	142.0	149.5

TEST NUMBER: P920145

CATALOG NUMBER: DFN2DIP-SQ3F0-080D090US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	959.5	993.4	961.3	145.6	151.4
115°	1088.0	1120.2	1167.6	291.4	155.2
117.5°	1199.7	1237.5	1269.8	999.1	503.3
120°	1324.6	1353.0	1387.2	1409.8	1154.3
122.5°	1430.5	1460.9	1498.8	1510.0	1512.1
125°	1538.3	1563.1	1599.0	1612.3	1617.9
127.5°	1636.8	1663.3	1691.9	1710.7	1712.5
130°	1729.6	1760.0	1780.6	1801.5	1799.7
132.5°	1824.2	1848.9	1869.6	1886.7	1884.9
135°	1903.8	1934.1	1950.9	1970.0	1966.3
137.5°	1986.9	2009.6	2028.7	2047.5	2041.9
140°	2068.2	2083.5	2104.2	2121.2	2111.9
142.5°	2136.6	2149.8	2174.3	2189.3	2180.0
145°	2208.5	2206.4	2238.6	2251.9	2242.4
147.5°	2270.7	2265.1	2297.2	2306.7	2299.2
150°	2331.4	2318.2	2348.5	2359.7	2350.3
152.5°	2382.4	2367.3	2395.6	2407.1	2393.8
155°	2431.6	2414.8	2437.4	2448.7	2433.6
157.5°	2471.4	2456.3	2473.4	2486.6	2471.4
160°	2505.5	2494.1	2505.5	2516.8	2503.5
162.5°	2535.6	2524.4	2533.8	2547.1	2530.0
165°	2562.2	2550.9	2556.6	2569.8	2556.6
167.5°	2583.1	2571.6	2577.4	2590.7	2573.6
170°	2600.1	2588.7	2592.5	2605.7	2588.7
172.5°	2611.4	2600.1	2603.9	2617.2	2600.1
175°	2620.8	2607.5	2611.4	2624.6	2605.7
177.5°	2624.6	2611.4	2613.4	2626.6	2609.6
180°	2615.2	2615.2	2615.2	2615.2	2615.2

TEST NUMBER: P920145

CATALOG NUMBER: DFN2DIP-SQ3F0-080D090US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.86	11.70	11.84	12.69	14.00	10.42	11.25	11.40	12.25	13.56
	3H	12.51	13.26	13.51	14.27	15.60	12.02	12.77	13.02	13.78	15.11
	4H	13.10	13.81	14.10	14.81	16.16	12.60	13.31	13.61	14.32	15.66
	6H	13.49	14.15	14.51	15.16	16.51	12.99	13.65	14.01	14.66	16.01
	8H	13.60	14.22	14.62	15.25	16.60	13.09	13.72	14.12	14.74	16.09
	12H	13.64	14.23	14.67	15.26	16.63	13.13	13.72	14.16	14.75	16.12
4H	2H	11.32	12.02	12.33	13.03	14.37	10.96	11.67	11.97	12.68	14.02
	3H	13.17	13.77	14.19	14.80	16.16	12.77	13.36	13.79	14.39	15.75
	4H	13.88	14.42	14.91	15.45	16.83	13.46	14.00	14.49	15.03	16.41
	6H	14.39	14.86	15.43	15.91	17.28	13.96	14.43	15.00	15.48	16.85
	8H	14.54	14.97	15.58	16.02	17.41	14.10	14.54	15.14	15.58	16.97
	12H	14.61	15.00	15.67	16.06	17.46	14.16	14.55	15.22	15.61	17.01
8H	4H	14.07	14.51	15.11	15.55	16.94	13.70	14.13	14.74	15.18	16.56
	6H	14.70	15.06	15.76	16.14	17.53	14.31	14.67	15.38	15.76	17.15
	8H	14.91	15.23	15.98	16.30	17.71	14.52	14.84	15.59	15.91	17.31
	12H	15.04	15.32	16.12	16.39	17.83	14.63	14.91	15.71	15.97	17.42
12H	4H	14.06	14.45	15.11	15.51	16.90	13.69	14.08	14.75	15.14	16.53
	6H	14.72	15.04	15.80	16.11	17.52	14.35	14.67	15.42	15.74	17.15
	8H	14.96	15.24	16.04	16.31	17.75	14.58	14.86	15.66	15.92	17.37

END OF REPORT