

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920168

Luminaire Tested: DFN2DIP-SQ3F0-090D060US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920168
REPORT IS A COMBINATION OF REPORTS P899907 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D060US935-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12243.4 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 132.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920168

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US935-FLLFLL

Luminous Intensity Polar Plot

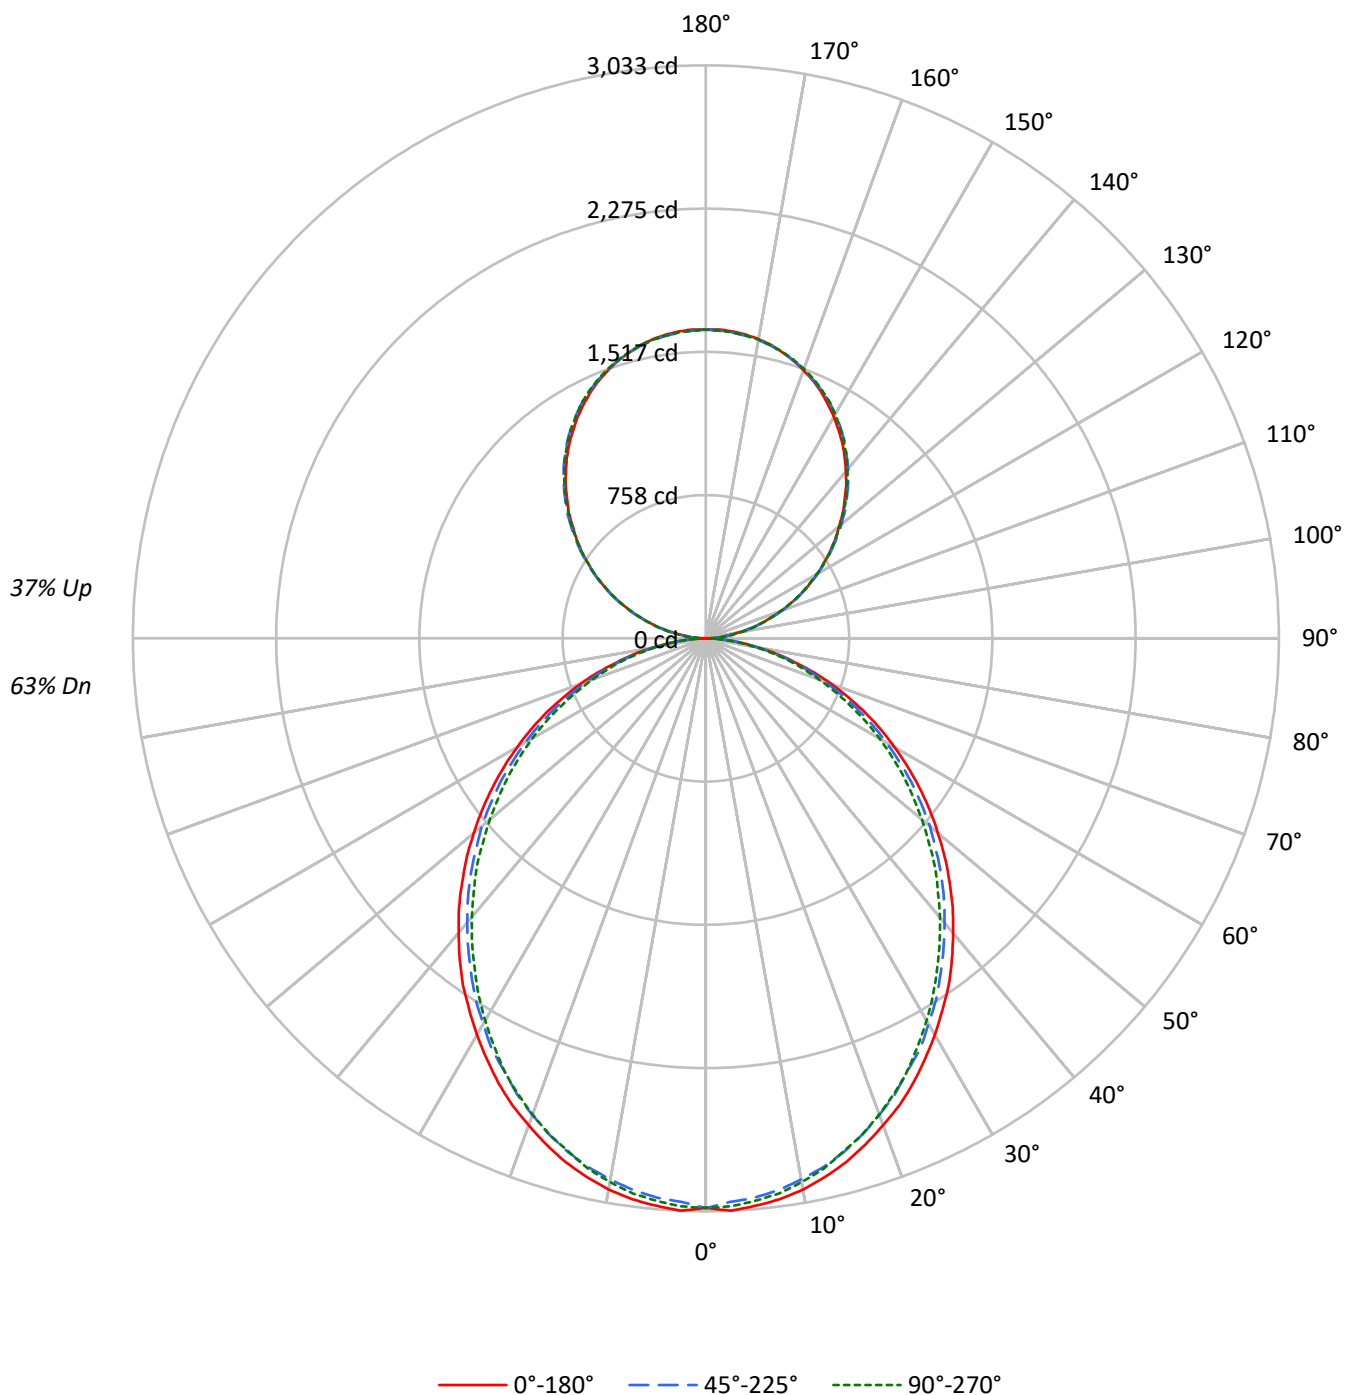

TEST NUMBER: P920168

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3455	3455	3455
5°	3458	3404	3428
10°	3428	3356	3381
15°	3375	3299	3307
20°	3305	3220	3232
25°	3235	3126	3145
30°	3148	3038	3035
35°	3065	2935	2918
40°	2963	2830	2807
45°	2862	2726	2694
50°	2751	2616	2562
55°	2635	2489	2441
60°	2503	2338	2302
65°	2359	2182	2138
70°	2175	1991	1962
75°	1922	1763	1797
80°	1615	1470	1485
85°	1137	974	972

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2862 cd/sqm

TEST NUMBER: P920168

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.3
10°-20°	798.5	6.5
20°-30°	1173.4	9.6
30°-40°	1362.9	11.1
40°-50°	1361.2	11.1
50°-60°	1186.9	9.7
60°-70°	877.4	7.2
70°-80°	496.4	4.1
80°-90°	135.7	1.1
90°-100°	101.1	0.8
100°-110°	321.2	2.6
110°-120°	549.7	4.5
120°-130°	723.0	5.9
130°-140°	811.5	6.6
140°-150°	795.8	6.5
150°-160°	667.5	5.5
160°-170°	442.7	3.6
170°-180°	154.7	1.3
0°-30°	2255.7	18.4
0°-40°	3618.6	29.6
0°-60°	6166.7	50.4
0°-90°	7676.2	62.7
90°-120°	972.0	7.9
90°-150°	3302.3	27.0
90°-180°	4567.0	37.3
0°-180°	12243.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	2	18	48	45	47	12
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P920168

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6



TEST NUMBER: P920168

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P920168

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.64	13.63	13.48	14.49	15.57	12.20	13.18	13.04	14.05	15.12
	3H	14.31	15.19	15.16	16.06	17.17	13.82	14.70	14.67	15.57	16.68
	4H	14.90	15.73	15.76	16.61	17.73	14.40	15.24	15.27	16.12	17.23
	6H	15.30	16.07	16.18	16.96	18.09	14.80	15.57	15.68	16.46	17.59
	8H	15.41	16.14	16.29	17.05	18.17	14.90	15.64	15.79	16.54	17.67
	12H	15.46	16.16	16.35	17.05	18.21	14.95	15.65	15.84	16.55	17.70
4H	2H	13.11	13.95	13.99	14.83	15.94	12.76	13.60	13.63	14.47	15.59
	3H	14.98	15.68	15.87	16.59	17.72	14.58	15.28	15.46	16.19	17.32
	4H	15.70	16.34	16.60	17.24	18.40	15.28	15.91	16.17	16.82	17.98
	6H	16.22	16.77	17.13	17.70	18.86	15.79	16.34	16.70	17.27	18.43
	8H	16.37	16.88	17.28	17.81	18.98	15.93	16.45	16.84	17.37	18.54
	12H	16.45	16.91	17.38	17.85	19.03	16.00	16.46	16.93	17.40	18.58
8H	4H	15.90	16.42	16.82	17.34	18.51	15.53	16.04	16.44	16.97	18.14
	6H	16.53	16.96	17.47	17.93	19.10	16.15	16.58	17.09	17.54	18.71
	8H	16.75	17.13	17.70	18.09	19.28	16.36	16.74	17.31	17.69	18.88
	12H	16.89	17.22	17.84	18.17	19.41	16.47	16.81	17.43	17.76	19.00
12H	4H	15.89	16.36	16.83	17.30	18.48	15.52	15.99	16.46	16.93	18.11
	6H	16.56	16.94	17.51	17.90	19.09	16.19	16.57	17.14	17.53	18.71
	8H	16.81	17.14	17.76	18.09	19.33	16.43	16.76	17.38	17.71	18.95