

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920228

Luminaire Tested: DFN2DIP-SQ3F0-100D120US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920228
REPORT IS A COMBINATION OF REPORTS P900017 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D120US935-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17667.7 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 192.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920228

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLFLL

Luminous Intensity Polar Plot

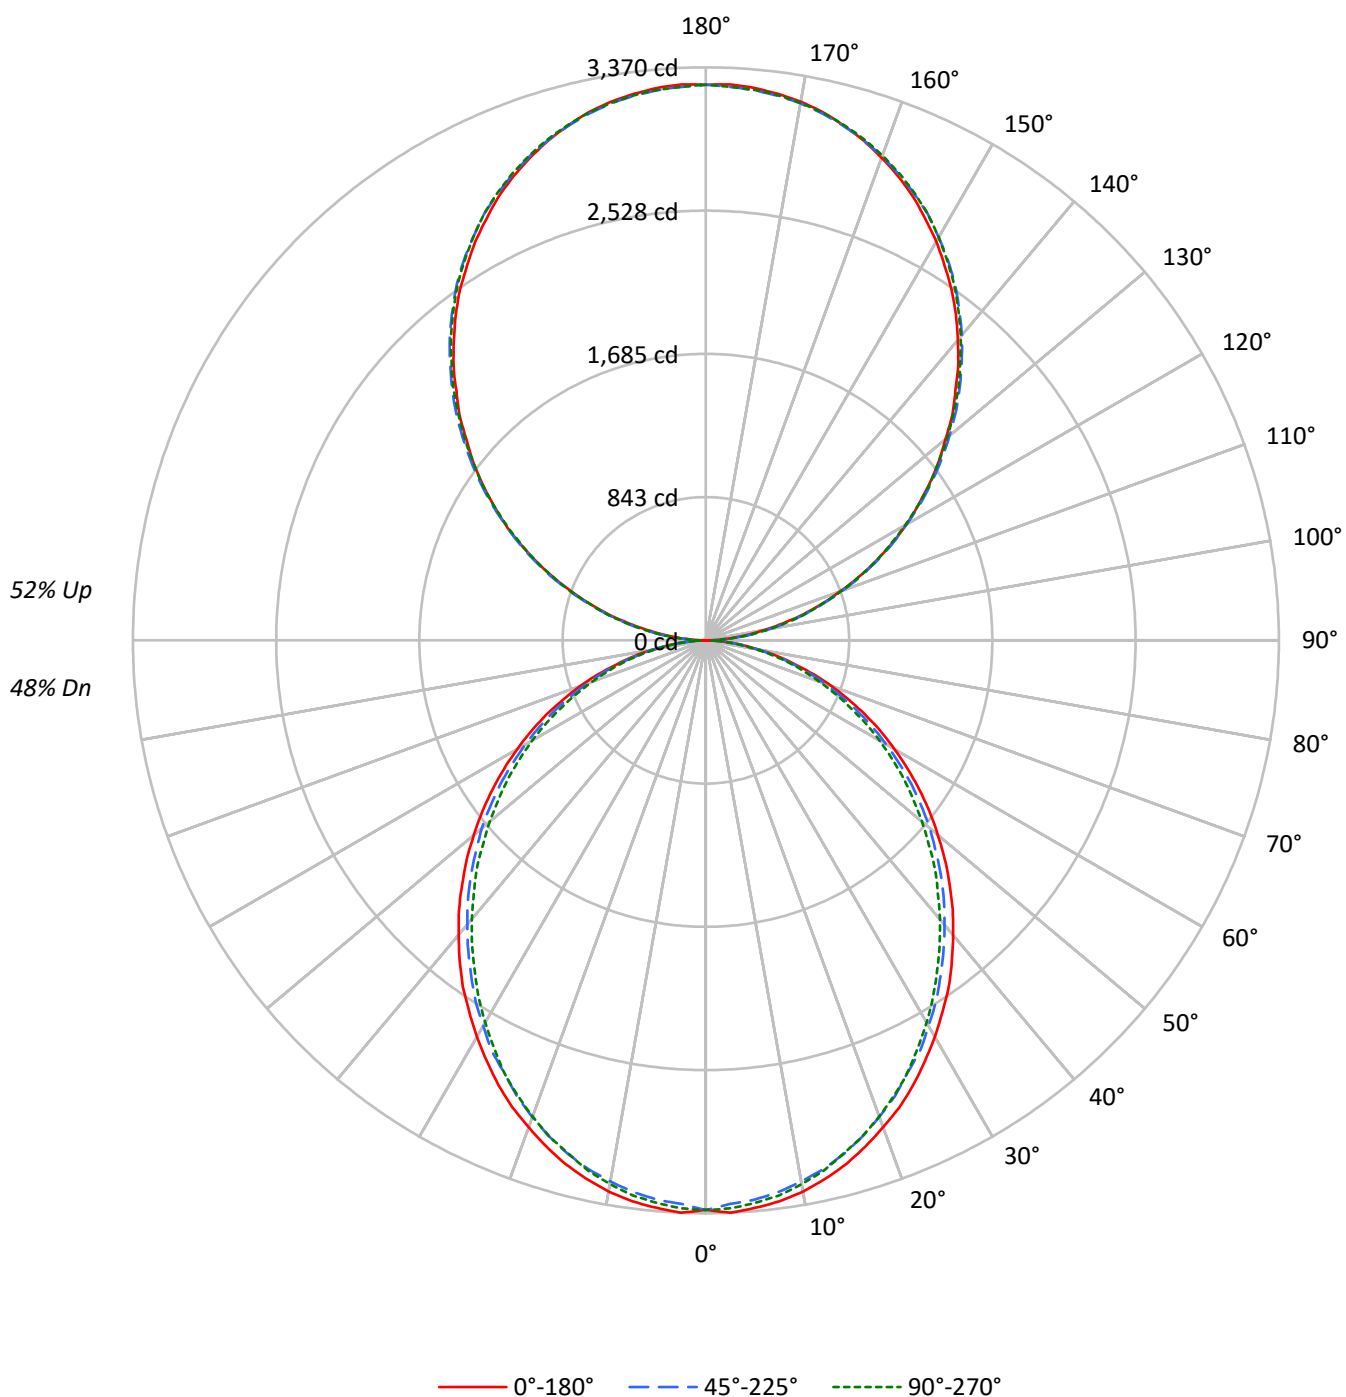

TEST NUMBER: P920228

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	97	93	89	86	89	86	82	79	72	70	68	60	58	57	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	50	47	42	41	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	38	35	33
4	74	63	55	49	68	59	52	46	50	44	40	41	37	34	34	31	28
5	68	56	48	42	62	52	45	40	44	39	35	37	33	30	30	27	25
6	63	51	42	37	57	47	40	34	40	34	30	34	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	27	30	26	23	25	22	19
8	54	41	34	28	49	39	32	27	33	28	24	28	24	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3839	3839	3839
5°	3842	3783	3809
10°	3809	3729	3757
15°	3750	3665	3675
20°	3672	3577	3591
25°	3594	3473	3494
30°	3498	3375	3372
35°	3406	3261	3242
40°	3293	3145	3119
45°	3180	3029	2993
50°	3057	2907	2847
55°	2927	2765	2712
60°	2781	2598	2558
65°	2621	2424	2376
70°	2417	2212	2180
75°	2135	1958	1996
80°	1795	1634	1650
85°	1263	1083	1080

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3287 cd/sqm

TEST NUMBER: P920228

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	1.8
10°-20°	887.2	5.0
20°-30°	1303.8	7.4
30°-40°	1514.3	8.6
40°-50°	1512.4	8.6
50°-60°	1318.8	7.5
60°-70°	974.9	5.5
70°-80°	551.6	3.1
80°-90°	154.9	0.9
90°-100°	202.2	1.1
100°-110°	642.4	3.6
110°-120°	1099.4	6.2
120°-130°	1445.9	8.2
130°-140°	1623.0	9.2
140°-150°	1591.6	9.0
150°-160°	1335.1	7.6
160°-170°	885.4	5.0
170°-180°	309.5	1.8
0°-30°	2506.3	14.2
0°-40°	4020.6	22.8
0°-60°	6851.8	38.8
0°-90°	8533.2	48.3
90°-120°	1944.1	11.0
90°-150°	6604.6	37.4
90°-180°	9134.0	51.7
0°-180°	17667.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	3	36	96	91	94	17
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P920228

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.5	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.8	2699.7
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.1	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.7
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P920228

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P920228

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.75	12.60	12.72	13.58	14.88	11.31	12.15	12.28	13.14	14.43
	3H	13.40	14.16	14.39	15.16	16.48	12.91	13.67	13.90	14.67	15.99
	4H	13.99	14.71	14.98	15.71	17.03	13.49	14.21	14.49	15.21	16.54
	6H	14.38	15.05	15.39	16.05	17.39	13.88	14.55	14.89	15.55	16.89
	8H	14.49	15.12	15.50	16.14	17.47	13.99	14.62	15.00	15.64	16.97
	12H	14.53	15.13	15.55	16.15	17.50	14.02	14.62	15.04	15.64	17.00
4H	2H	12.21	12.92	13.21	13.92	15.25	11.85	12.57	12.85	13.57	14.89
	3H	14.06	14.66	15.08	15.69	17.03	13.66	14.26	14.67	15.28	16.62
	4H	14.77	15.32	15.79	16.34	17.70	14.35	14.90	15.37	15.92	17.28
	6H	15.28	15.76	16.31	16.80	18.16	14.85	15.32	15.88	16.37	17.73
	8H	15.43	15.87	16.46	16.91	18.28	14.99	15.44	16.02	16.47	17.84
	12H	15.50	15.90	16.55	16.95	18.33	15.05	15.45	16.10	16.50	17.88
8H	4H	14.97	15.41	16.00	16.44	17.82	14.59	15.03	15.62	16.07	17.44
	6H	15.59	15.96	16.64	17.03	18.40	15.21	15.57	16.26	16.65	18.02
	8H	15.81	16.13	16.87	17.19	18.58	15.41	15.74	16.48	16.80	18.19
	12H	15.93	16.22	17.00	17.27	18.71	15.52	15.81	16.59	16.86	18.30
12H	4H	14.95	15.35	16.00	16.40	17.78	14.58	14.98	15.63	16.03	17.41
	6H	15.62	15.94	16.68	17.00	18.39	15.25	15.57	16.31	16.63	18.02
	8H	15.86	16.14	16.92	17.20	18.63	15.47	15.76	16.54	16.81	18.25