

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920229

Luminaire Tested: DFN2DIP-SQ3F0-100D120US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920229
REPORT IS A COMBINATION OF REPORTS P901537 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D120US935-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18752.5 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 192.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920229

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLONL

Luminous Intensity Polar Plot

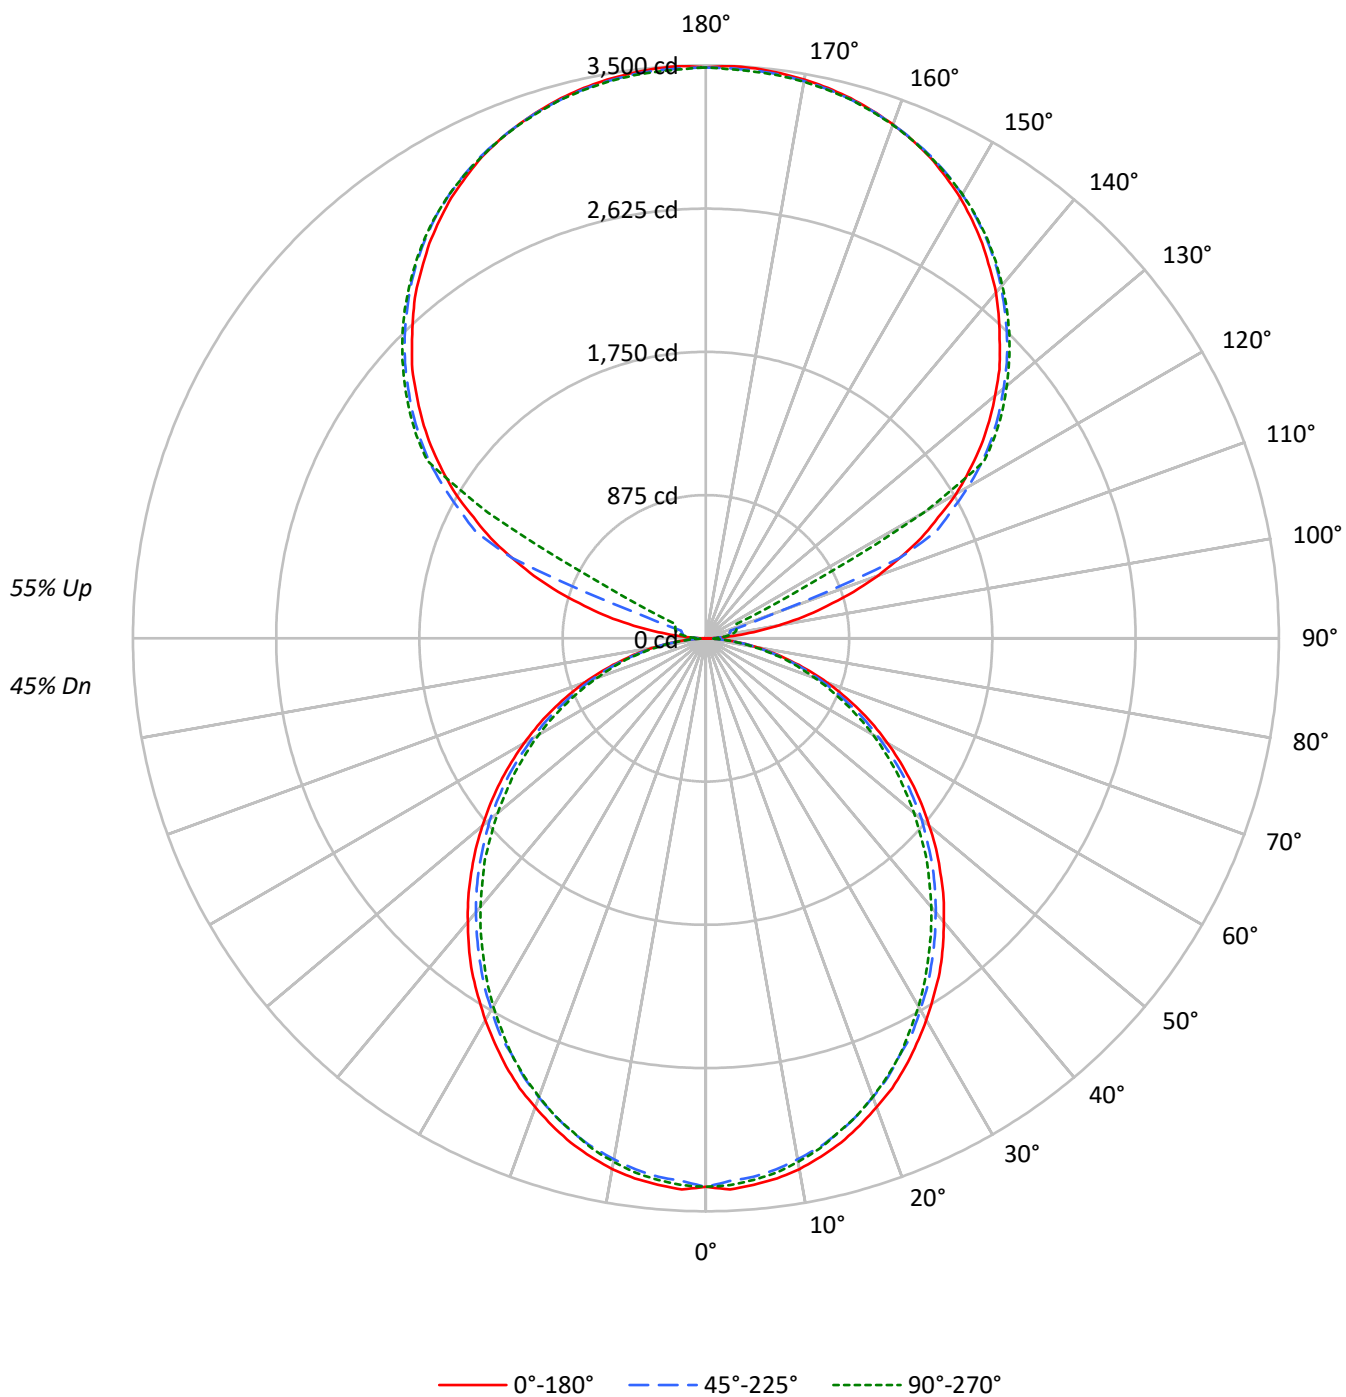

TEST NUMBER: P920229

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3839	3839	3839
5°	3842	3783	3809
10°	3809	3729	3757
15°	3750	3665	3675
20°	3672	3577	3591
25°	3594	3473	3494
30°	3498	3375	3372
35°	3406	3261	3242
40°	3293	3145	3119
45°	3180	3029	2993
50°	3057	2907	2847
55°	2927	2765	2712
60°	2781	2598	2558
65°	2621	2424	2376
70°	2417	2212	2180
75°	2135	1958	1996
80°	1795	1634	1650
85°	1263	1083	1080

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3180 cd/sqm

TEST NUMBER: P920229

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	1.7
10°-20°	887.2	4.7
20°-30°	1303.8	7.0
30°-40°	1514.3	8.1
40°-50°	1512.4	8.1
50°-60°	1318.8	7.0
60°-70°	974.9	5.2
70°-80°	551.6	2.9
80°-90°	151.7	0.8
90°-100°	115.0	0.6
100°-110°	428.6	2.3
110°-120°	1136.8	6.1
120°-130°	1885.4	10.1
130°-140°	2002.8	10.7
140°-150°	1861.3	9.9
150°-160°	1496.5	8.0
160°-170°	964.3	5.1
170°-180°	331.9	1.8
0°-30°	2506.3	13.4
0°-40°	4020.6	21.4
0°-60°	6851.8	36.5
0°-90°	8530.0	45.5
90°-120°	1680.4	9.0
90°-150°	7429.9	39.6
90°-180°	10223.0	54.5
0°-180°	18752.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	2	30	50	63	68	17
95°	164	81	98	111	108	194
105°	767	843	154	182	192	820
115°	1451	1494	1557	389	207	1428
125°	2051	2084	2132	2150	2157	1829
135°	2538	2579	2601	2627	2622	1961
145°	2945	2942	2985	3002	2990	1842
155°	3242	3220	3250	3265	3245	1494
165°	3416	3401	3409	3426	3409	965
175°	3494	3477	3482	3500	3474	333
180°	3487	3487	3487	3487	3487	

TEST NUMBER: P920229

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.5	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.8	2699.7
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.1	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.7
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	2.4	30.2	50.4	63.2	68.0
92.5°	63.2	53.0	60.5	65.6	68.0
95°	163.8	80.6	98.2	111.2	108.5
97.5°	295.2	88.4	128.5	136.3	138.7
100°	446.7	101.0	143.8	163.8	169.0
102.5°	613.0	608.2	148.9	176.5	184.3
105°	767.0	842.8	154.0	181.6	191.7
107.5°	946.2	1009.1	159.1	186.7	196.8
110°	1117.8	1170.6	441.6	189.3	199.2

TEST NUMBER: P920229

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1279.4	1324.6	1281.8	194.2	201.9
115°	1450.7	1493.6	1556.8	388.6	207.1
117.5°	1599.6	1650.0	1693.2	1332.0	671.1
120°	1766.3	1804.0	1849.5	1879.8	1539.1
122.5°	1907.4	1947.8	1998.5	2013.4	2016.1
125°	2051.2	2084.1	2132.1	2149.7	2157.2
127.5°	2182.4	2217.8	2255.8	2281.0	2283.4
130°	2306.1	2346.6	2374.1	2402.0	2399.6
132.5°	2432.2	2465.2	2492.8	2515.6	2513.2
135°	2538.3	2578.8	2601.2	2626.7	2621.7
137.5°	2649.2	2679.4	2704.9	2730.1	2722.6
140°	2757.7	2778.0	2805.6	2828.4	2815.8
142.5°	2848.7	2866.4	2899.1	2919.1	2906.6
145°	2944.6	2941.9	2984.7	3002.5	2989.8
147.5°	3027.6	3020.1	3063.0	3075.6	3065.7
150°	3108.5	3090.8	3131.3	3146.3	3133.7
152.5°	3176.5	3156.4	3194.2	3209.5	3191.8
155°	3242.1	3219.6	3249.9	3264.9	3244.8
157.5°	3295.1	3275.1	3297.9	3315.5	3295.1
160°	3340.7	3325.4	3340.7	3355.7	3338.0
162.5°	3380.9	3365.9	3378.5	3396.1	3373.4
165°	3416.2	3401.2	3408.7	3426.4	3408.7
167.5°	3444.1	3428.8	3436.6	3454.2	3431.5
170°	3466.8	3451.6	3456.6	3474.3	3451.6
172.5°	3481.8	3466.8	3472.0	3489.6	3466.8
175°	3494.4	3476.7	3481.8	3499.5	3474.3
177.5°	3499.5	3481.8	3484.5	3502.2	3479.5
180°	3487.0	3487.0	3487.0	3487.0	3487.0

TEST NUMBER: P920229

CATALOG NUMBER: DFN2DIP-SQ3F0-100D120US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.48	12.30	12.47	13.31	14.64	11.03	11.86	12.03	12.86	14.20
	3H	13.13	13.87	14.14	14.88	16.24	12.64	13.38	13.65	14.39	15.75
	4H	13.71	14.41	14.73	15.43	16.79	13.22	13.92	14.24	14.94	16.30
	6H	14.11	14.75	15.14	15.78	17.15	13.61	14.25	14.64	15.28	16.65
	8H	14.21	14.82	15.25	15.86	17.23	13.71	14.32	14.74	15.36	16.73
	12H	14.26	14.84	15.30	15.87	17.27	13.75	14.33	14.79	15.36	16.76
4H	2H	11.93	12.63	12.96	13.65	15.01	11.58	12.27	12.60	13.29	14.66
	3H	13.79	14.37	14.82	15.42	16.79	13.38	13.96	14.41	15.01	16.39
	4H	14.50	15.03	15.54	16.07	17.47	14.07	14.61	15.11	15.65	17.04
	6H	15.01	15.46	16.06	16.53	17.92	14.57	15.03	15.62	16.09	17.49
	8H	15.15	15.58	16.20	16.64	18.05	14.72	15.14	15.77	16.20	17.61
	12H	15.22	15.61	16.29	16.68	18.09	14.77	15.16	15.84	16.23	17.64
8H	4H	14.69	15.12	15.74	16.17	17.58	14.31	14.74	15.36	15.79	17.20
	6H	15.31	15.66	16.38	16.76	18.17	14.93	15.28	16.00	16.38	17.78
	8H	15.53	15.84	16.61	16.92	18.35	15.13	15.45	16.22	16.53	17.95
	12H	15.65	15.93	16.74	17.00	18.47	15.24	15.52	16.33	16.59	18.06
12H	4H	14.67	15.06	15.74	16.13	17.54	14.30	14.69	15.37	15.76	17.17
	6H	15.34	15.65	16.42	16.73	18.16	14.97	15.28	16.05	16.36	17.78
	8H	15.57	15.85	16.66	16.92	18.39	15.19	15.47	16.28	16.54	18.01