

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920234

Luminaire Tested: DFN2DIP-SQ3F0-110D040US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920234
REPORT IS A COMBINATION OF REPORTS P899876 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D040US935-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11098.3 lumens
Efficiency: N/A
Efficacy: 78.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 142.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920234

CATALOG NUMBER: DFN2DIP-SQ3F0-110D040US935-RLLFLL

Luminous Intensity Polar Plot

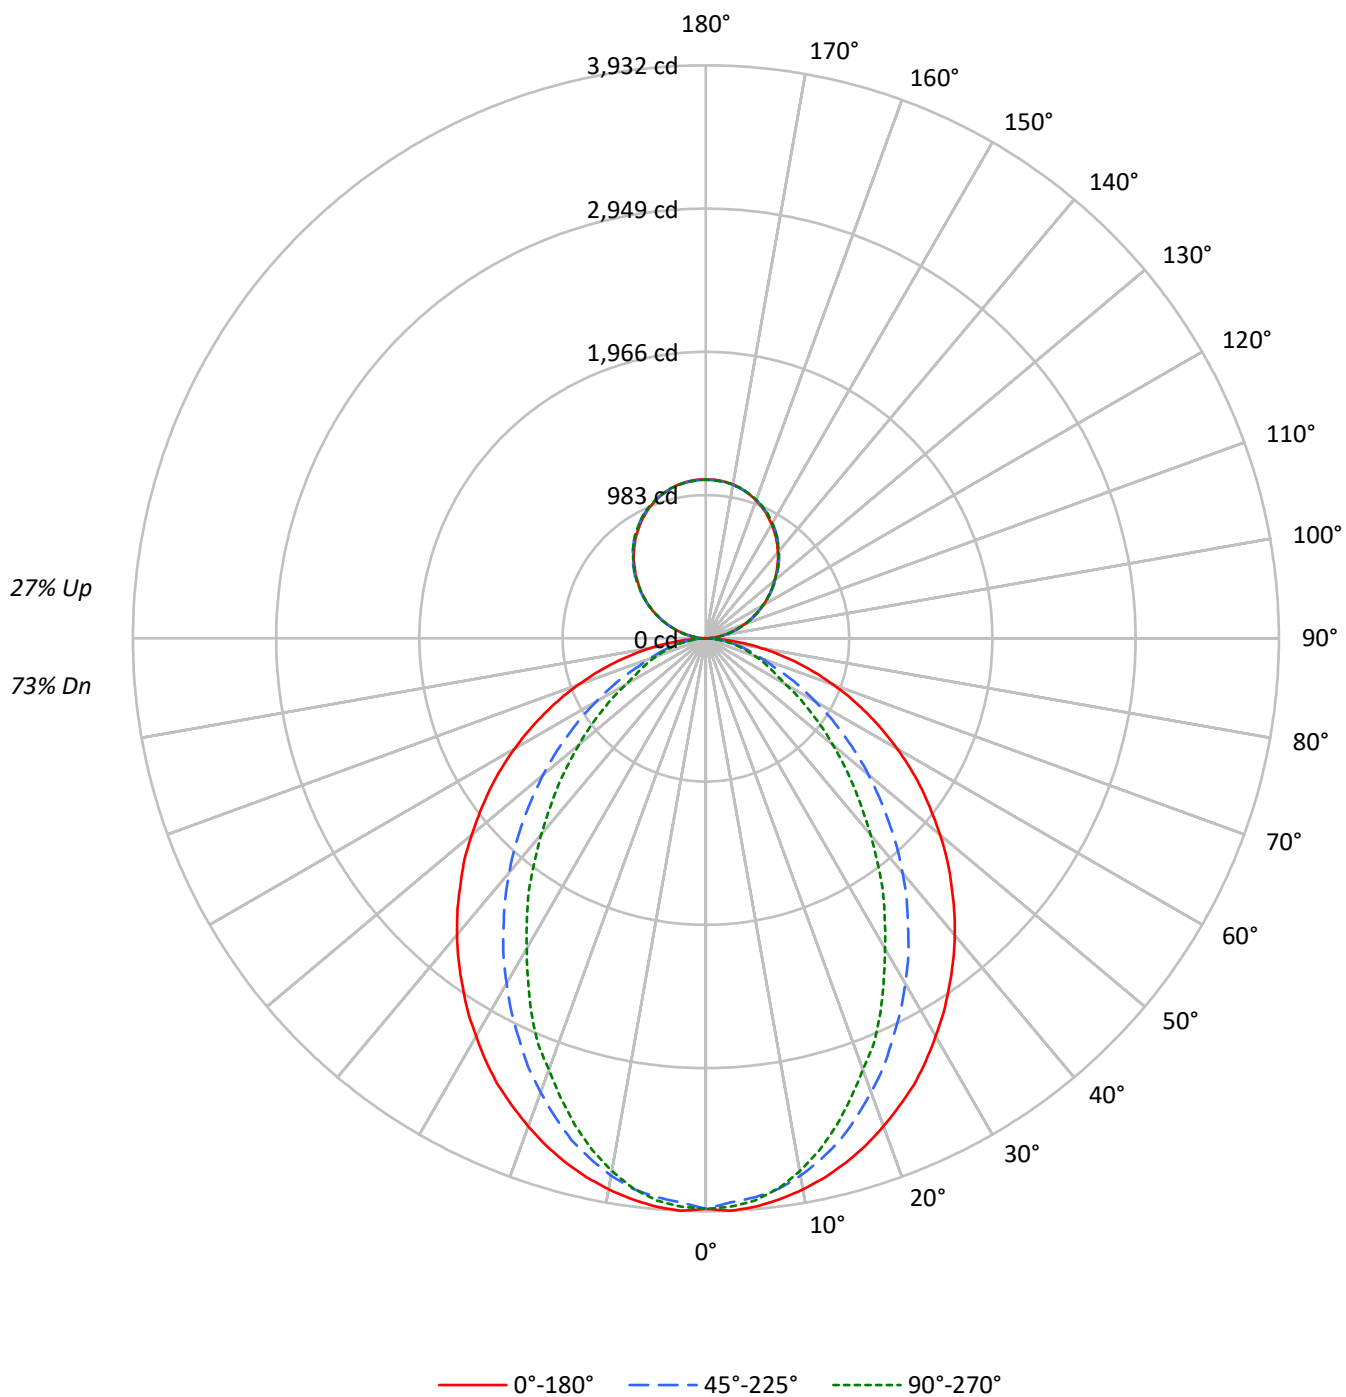

TEST NUMBER: P920234

CATALOG NUMBER: DFN2DIP-SQ3F0-110D040US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	96	96	96	86	86	86	77	77	77
1	104	99	96	92	98	94	91	88	85	83	80	77	75	73	69	68	66
2	95	88	82	77	90	83	78	74	76	71	68	68	65	62	62	59	57
3	87	78	70	65	82	74	68	62	67	62	58	61	57	53	55	52	49
4	80	69	61	55	76	66	59	54	60	55	50	55	50	47	50	46	43
5	74	62	54	48	70	60	52	47	54	48	44	50	45	41	45	41	38
6	68	56	48	42	65	54	47	41	49	43	39	45	40	36	41	37	34
7	64	51	43	38	60	49	42	37	45	39	34	41	36	32	38	34	30
8	59	47	39	34	56	45	38	33	41	35	31	38	33	29	35	31	28
9	55	43	35	30	53	41	34	30	38	32	28	35	30	27	33	28	25
10	52	40	32	28	49	38	31	27	35	30	26	33	28	24	30	26	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4485	4485	4485
5°	4489	4411	4441
10°	4442	4321	4295
15°	4378	4176	4070
20°	4294	3976	3795
25°	4209	3753	3529
30°	4094	3524	3192
35°	3982	3279	2897
40°	3868	3025	2558
45°	3736	2744	2251
50°	3598	2460	1951
55°	3455	2158	1664
60°	3288	1841	1368
65°	3097	1521	1229
70°	2865	1221	1111
75°	2572	1070	1007
80°	2149	889	869
85°	1457	578	643

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3736 cd/sqm

TEST NUMBER: P920234

CATALOG NUMBER: DFN2DIP-SQ3F0-110D040US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.9	3.3
10°-20°	1007.1	9.1
20°-30°	1413.9	12.7
30°-40°	1541.3	13.9
40°-50°	1416.6	12.8
50°-60°	1112.5	10.0
60°-70°	724.2	6.5
70°-80°	372.8	3.4
80°-90°	98.3	0.9
90°-100°	67.4	0.6
100°-110°	214.2	1.9
110°-120°	366.5	3.3
120°-130°	482.0	4.3
130°-140°	541.0	4.9
140°-150°	530.5	4.8
150°-160°	445.0	4.0
160°-170°	295.1	2.7
170°-180°	103.2	0.9
0°-30°	2787.9	25.1
0°-40°	4329.1	39.0
0°-60°	6858.3	61.8
0°-90°	8053.4	72.6
90°-120°	648.0	5.8
90°-150°	2201.5	19.8
90°-180°	3045.0	27.4
0°-180°	11098.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3914	3914	3914	3914	3914	
5°	3914	3897	3850	3882	3872	371
15°	3723	3684	3564	3496	3461	1049
25°	3380	3266	3032	2887	2834	1554
35°	2912	2731	2420	2196	2118	1823
45°	2381	2143	1771	1520	1435	1838
55°	1810	1534	1151	939	872	1617
65°	1222	935	616	496	485	1212
75°	652	404	283	259	255	689
85°	152	78	67	67	67	175
90°	1	12	32	30	31	11
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P920234

CATALOG NUMBER: DFN2DIP-SQ3F0-110D040US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3914.4	3914.4	3914.4	3914.4	3914.4
2.5°	3932.0	3914.4	3875.3	3911.0	3903.9
5°	3914.4	3896.7	3850.5	3882.4	3871.9
7.5°	3882.4	3861.3	3811.7	3825.7	3807.9
10°	3840.0	3815.1	3744.5	3733.5	3712.5
12.5°	3786.9	3755.0	3659.2	3638.1	3599.0
15°	3723.0	3684.0	3563.7	3496.4	3461.0
17.5°	3648.7	3591.9	3443.0	3365.2	3308.5
20°	3563.7	3492.6	3315.6	3227.3	3149.1
22.5°	3471.6	3390.0	3184.5	3064.2	3011.2
25°	3379.5	3266.0	3032.3	2887.2	2833.8
27.5°	3269.8	3149.1	2890.5	2724.0	2642.5
30°	3152.9	3018.0	2734.6	2554.2	2458.3
32.5°	3039.4	2876.2	2586.1	2373.4	2284.7
35°	2912.0	2731.2	2419.7	2196.4	2118.2
37.5°	2788.0	2592.9	2263.6	2019.0	1930.7
40°	2656.8	2444.5	2100.6	1849.1	1757.0
42.5°	2522.2	2295.6	1937.8	1675.5	1587.2
45°	2380.6	2143.0	1771.3	1519.5	1434.6
47.5°	2246.0	1994.6	1612.0	1360.1	1282.4
50°	2097.1	1845.7	1456.0	1211.3	1137.3
52.5°	1951.7	1686.0	1307.2	1073.4	1006.1
55°	1810.0	1533.8	1151.2	938.8	871.6
57.5°	1665.0	1381.6	1013.2	814.8	758.0
60°	1516.1	1232.8	867.8	687.4	630.7
62.5°	1371.1	1087.7	743.8	573.9	545.7
65°	1222.2	935.0	616.4	496.1	485.2
67.5°	1080.6	793.4	496.1	435.6	425.1
70°	931.7	655.5	410.8	375.5	361.2
72.5°	790.0	527.7	343.5	315.3	308.2
75°	651.7	403.6	283.4	258.6	255.2
77.5°	513.8	286.8	223.3	209.0	201.8
80°	386.0	205.6	169.9	156.0	156.0
82.5°	269.1	138.3	116.9	109.8	109.8
85°	152.2	77.8	67.2	67.2	67.2
87.5°	56.7	28.2	28.2	24.8	24.8
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1



TEST NUMBER: P920234

CATALOG NUMBER: DFN2DIP-SQ3F0-110D040US935-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P920234

CATALOG NUMBER: DFN2DIP-SQ3F0-110D040US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.22	15.27	14.96	16.03	16.94	10.18	11.23	10.92	11.99	12.90
	3H	15.91	16.85	16.66	17.62	18.56	11.38	12.32	12.13	13.09	14.03
	4H	16.52	17.41	17.30	18.19	19.15	11.83	12.72	12.61	13.50	14.46
	6H	16.95	17.77	17.74	18.56	19.53	12.16	12.98	12.95	13.77	14.73
	8H	17.08	17.86	17.88	18.67	19.64	12.25	13.03	13.05	13.84	14.81
	12H	17.15	17.89	17.95	18.69	19.69	12.30	13.05	13.10	13.84	14.84
4H	2H	14.26	15.15	15.04	15.93	16.88	10.80	11.69	11.58	12.47	13.42
	3H	16.11	16.84	16.90	17.66	18.63	12.16	12.90	12.95	13.71	14.68
	4H	16.80	17.47	17.61	18.29	19.29	12.71	13.38	13.52	14.20	15.20
	6H	17.33	17.90	18.15	18.74	19.75	13.14	13.72	13.96	14.55	15.56
	8H	17.50	18.04	18.33	18.88	19.89	13.27	13.81	14.09	14.64	15.66
	12H	17.60	18.09	18.45	18.94	19.97	13.34	13.82	14.18	14.68	15.70
8H	4H	16.79	17.33	17.61	18.16	19.18	13.01	13.55	13.83	14.38	15.40
	6H	17.35	17.80	18.21	18.68	19.69	13.52	13.97	14.38	14.85	15.86
	8H	17.57	17.96	18.43	18.84	19.87	13.71	14.11	14.58	14.98	16.01
	12H	17.71	18.06	18.58	18.92	20.01	13.84	14.18	14.70	15.05	16.14
12H	4H	16.75	17.23	17.59	18.09	19.11	13.02	13.51	13.87	14.36	15.38
	6H	17.33	17.73	18.19	18.60	19.63	13.57	13.97	14.44	14.84	15.88
	8H	17.56	17.91	18.42	18.77	19.86	13.79	14.14	14.65	15.00	16.09

END OF REPORT